



Tollway Standard Drawing Revisions


Section H	Roadway Lighting		
	Standard	Modification Summary	Effective: 07/07/15
	All	Revised detail descriptions to match Tollway Coded Pay Items	
		Updated drawings to follow IDOT highway standard levels	
		Re-arranged details between drawings for consistency	
	H1	Light Standard Foundation Details	
	Sheet 1	Changed the ground rod detail for concrete foundations showing the rod extending through the concrete foundation	
		Revised notes	
	Sheets 3-6	Moved median barrier mounted foundation details from H8 to H1	
		Added pay limits to light standard foundation and median barrier wall	
	Sheets 7-9	Simplified grading details; Combined from sheets 1-5	
		Added earthwork and seeding details for transitions into graded area	
		Moved bridge mounted light pole mounting details to H2	
	H2	Light Standard Details	
	Sheet 1	Changed light pole wall thickness from 0.25" to 0.312" minimum per IDOT.	
		Added light standard description for LED luminaires	
		Revised notes	
	Sheet 2	Moved bridge mounted light pole mounting details from H1	
		Added detail showing light pole mounting to FHWA breakaway base for ground mount units	
		Added light standard description for LED luminaires	
		Provided complete light standard handhole orientation details	
	Sheet 3	Added surge protection devices to the light standard pole wiring details	
		Revised light standard pole wiring details to show difference between ground mounted and structure mounted units	
	H3	Bridge Conduit Details	
	All Sheets	Revised title.	
	Sheet 1	Revised notes.	
	Sheets 2-4	Added details for transition from underground to conduit embedded in bridge structures with junction box mounted to back of bridge parapet (Test Level 5) similar to IDOT details. Tollway will no longer permit embedded junction boxes in bridge parapets due to Test Level 5 requirement.	
		Moved conduit embedded in bridge structures at light pole locations from H1.	
	H4	Heavy Duty Handhole and Buried Wiring Details	
		Deleted detail for trenching through pavement for conduit installation	
		Deleted non heavy-duty handhole details and notes	
		Deleted underground wiring modifications at existing light poles details.	
		Updated manufacturer's product information.	
		Revised notes.	
	H5	Service Pole and Pedestal Details	
		Revised underground metallic conduits to be stainless steel.	
		Revised above grade metallic conduits for transition to underground to be stainless steel.	
		Revised notes.	
		Deleted Pole Foundation With Unit Duct Detail	
	H6	Exterior Control Console Details	
		Revised underground metallic conduits to be stainless steel.	
		Revised above grade metallic conduits for transition to underground to be stainless steel.	
		Moved Interior Control Console Details to H8	
		Revised notes.	
	H7	Exterior Control Console Foundation Details	
	All Sheets	Revised title	
		Revised underground metallic conduits and sleeves to be stainless steel.	
		Revised notes.	
	H8	Interior Control Console Details	
	All Sheets	Revised title	
		Moved interior control console details form H6.	
		Revised indoor installation photocell to be of a kind meant for building mounting.	
		Moved median barrier mounted foundation details to H1	
	H10 H11	Bridge Mount Sign Lighting Details Span Type Structure Sign Lighting Details	
		Revised title	
		Revised underground metallic conduits to be stainless steel.	
		Revised above ground conduits to be PVC coated RGS or aluminum depending on mounting location.	
		Revised sign control panel mounting plate to stainless steel.	
		Revised notes.	
	H12	Cantilever Structure Sign Lighting Details	
	All Sheets	Revised title	
	Sheet 1	Revised notes.	
		Revised underground metallic conduits to be stainless steel.	
		Revised above ground conduits to be PVC coated RGS or aluminum depending on mounting location.	
		Revised sign control panel mounting plate to stainless steel.	
	Sheet 2	Revised detail for new structure foundation type.	
	H14	Sign Luminaire Mounting Detail and Wiring Diagrams	
		New notes 1-3.	
	H15	Reserved	
		Deleted Overhead Truss and Cantilever Sign Without Lighting or Catwalk Typical Details	

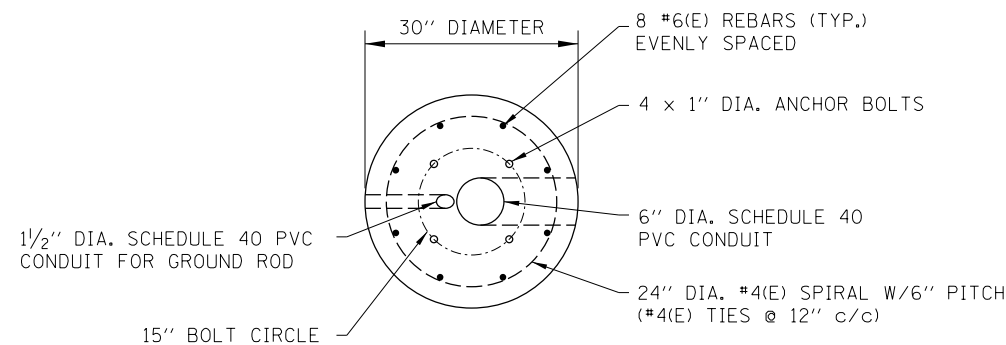

PLAN

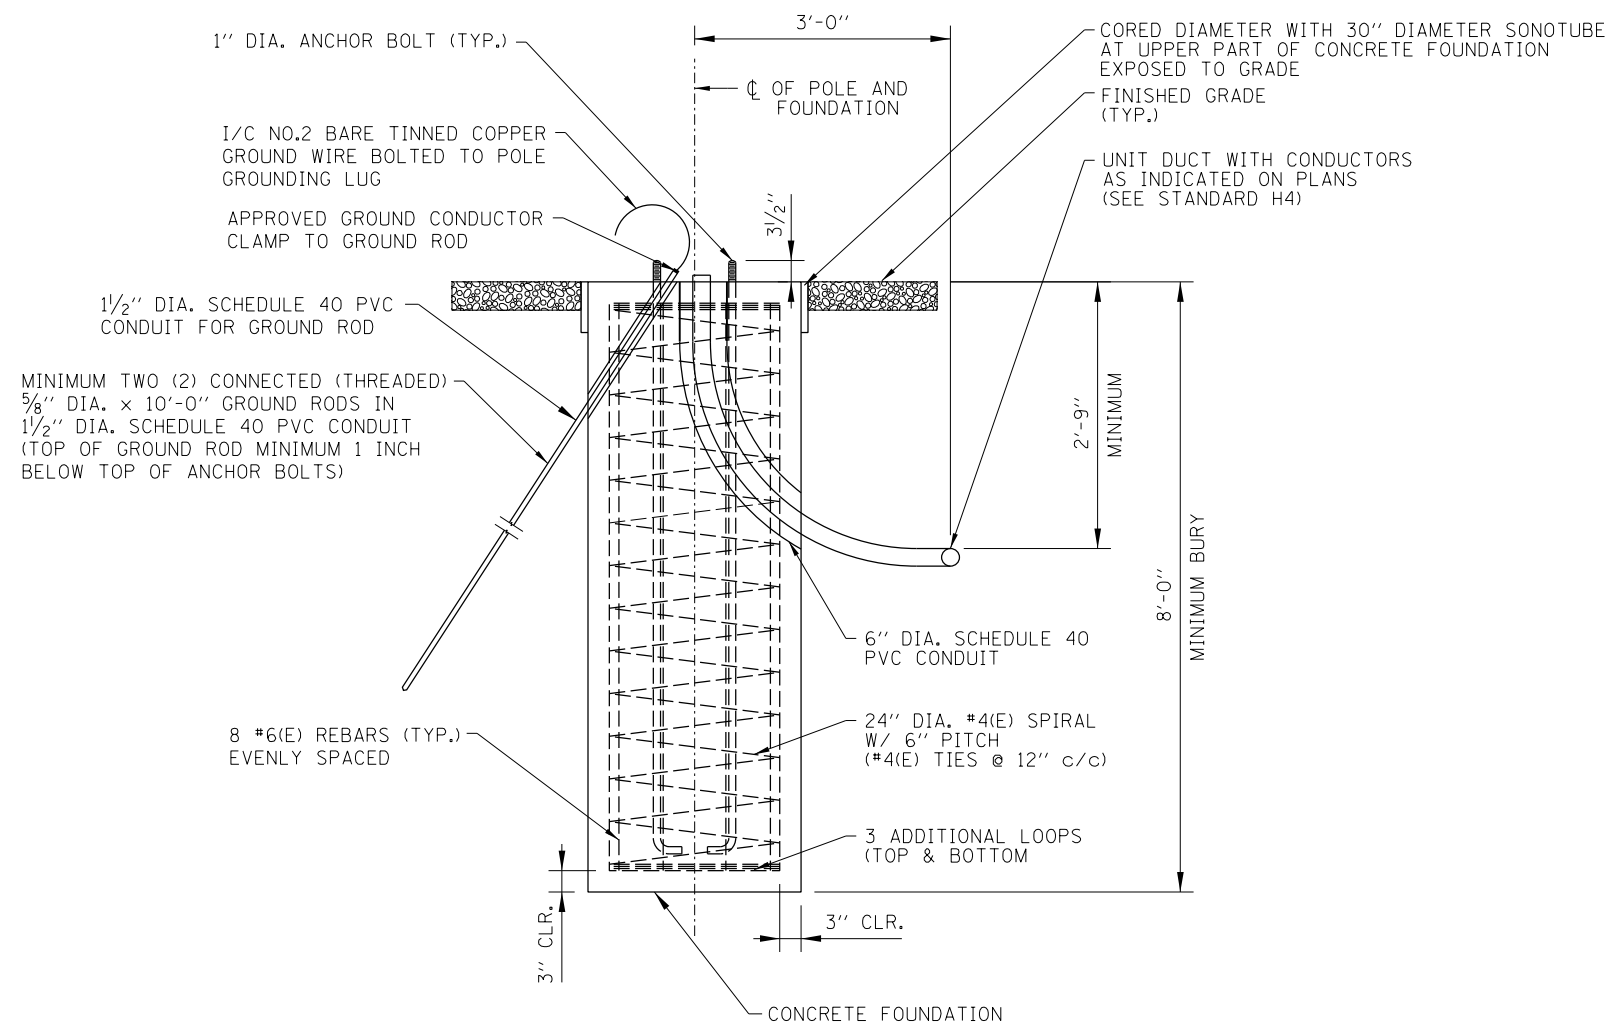

ELEVATION

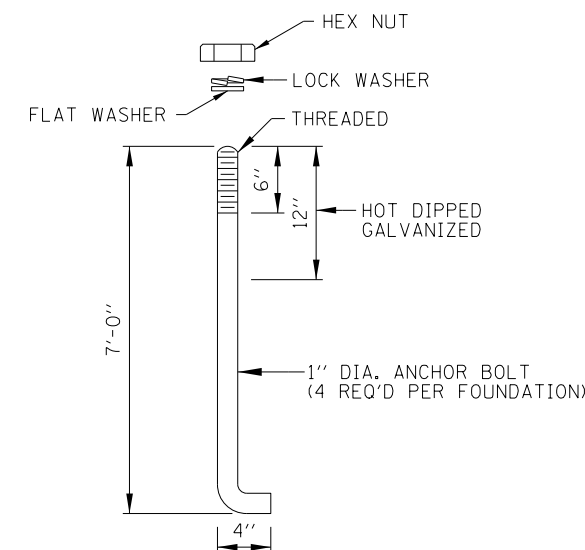

ANCHOR BOLT DETAIL


NOTES:

1. AT LOCATIONS NOT SHIELDED BY GUARDRAIL, THE LIGHT POLE FOUNDATION SHALL BE FLUSH WITH SURROUNDING GRADED ON ALL SIDES. THE SURROUNDING AREA SHALL BE A LEVEL GRADED AREA CONSTRUCTED OF AGGREGATE SHOULDERS WITH FILTER FABRIC, TYPE B, 4".
2. PROVIDE SEEDING, POTASIUUM FERTILIZER NUTRIENT, AND EROSION CONTROL BLANKET AS REQUIRED.
3. THE TOP OF FOUNDATION SHALL BE AT THE SAME ELEVATION AS THE ADJACENT TOP OF GUTTER OR WHEN ADJACENT TO AGGREGATE SHOULDER, AT THE SAME ELEVATION AS THE OUTSIDE EDGE OF THE AGGREGATE SHOULDER SLOPED A MAXIMUM 6% AWAY AND FROM THE PAVED SHOULDER.
4. ALL SLOPES ARE EXPRESSED AS UNITS OF VERTICAL DISPLACEMENT TO UNITS OF HORIZONTAL DISPLACEMENT (V:H).
5. ALL GROUND MOUNTED LIGHT POLES SHALL BE PROVIDED WITH AN ACCEPTED FHWA BREAKAWAY BASE OR DEVICE PER THE TOLLWAY SUPPLEMENTAL SPECIFICATIONS SECTION 1070.
6. FOR DETAILS OF FUSE HOLDER, POLE BASE WIRING AND JOINT ASSEMBLY SEE STANDARD H2.
7. ALL REINFORCEMENT BARS SHALL BE EPOXY COATED.
8. ALL EQUIPMENT SHALL BE GROUNDED AND BONDED IN ACCORDANCE WITH THE NATIONAL ELECTRICAL CODE AND THE NATIONAL ELECTRICAL SAFETY CODE.




DATE	REVISIONS
2-07-2012	MODIFIED FOUNDATION DETAILS, REVISED NOTES
11-01-2012	ADDED CONTROLLER NUMBER
3-31-2014	REVISED HELIX FOUNDATION, NEW DETAIL "A", AND GRADED AREA
3-11-2015	MOVED MEDIAN BARRIER MOUNTED FOUNDATION DETAILS.


LIGHT STANDARD FOUNDATION DETAILS - CONCRETE
(GROUND MOUNTED UNITS)

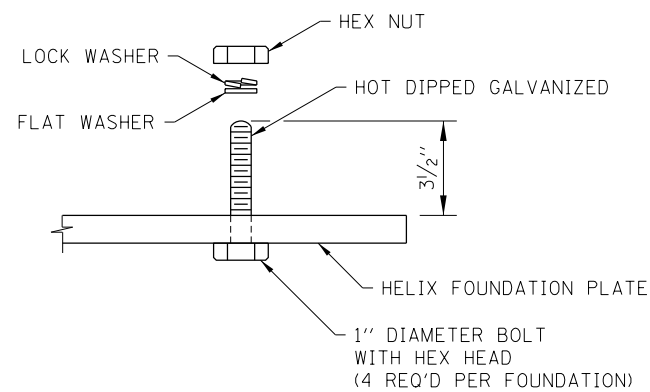

BASE ATTACHMENT DETAIL

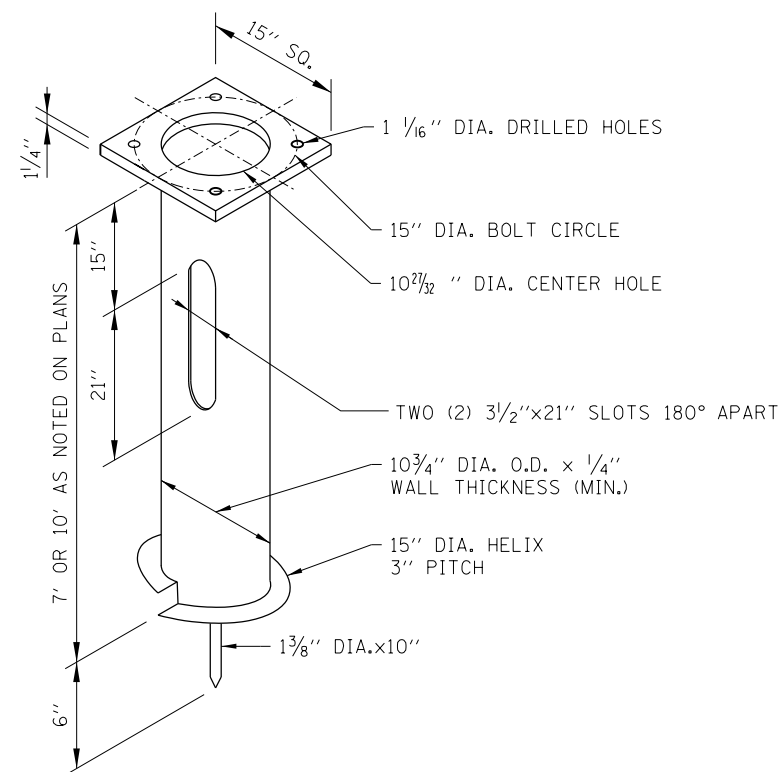

ISOMETRIC

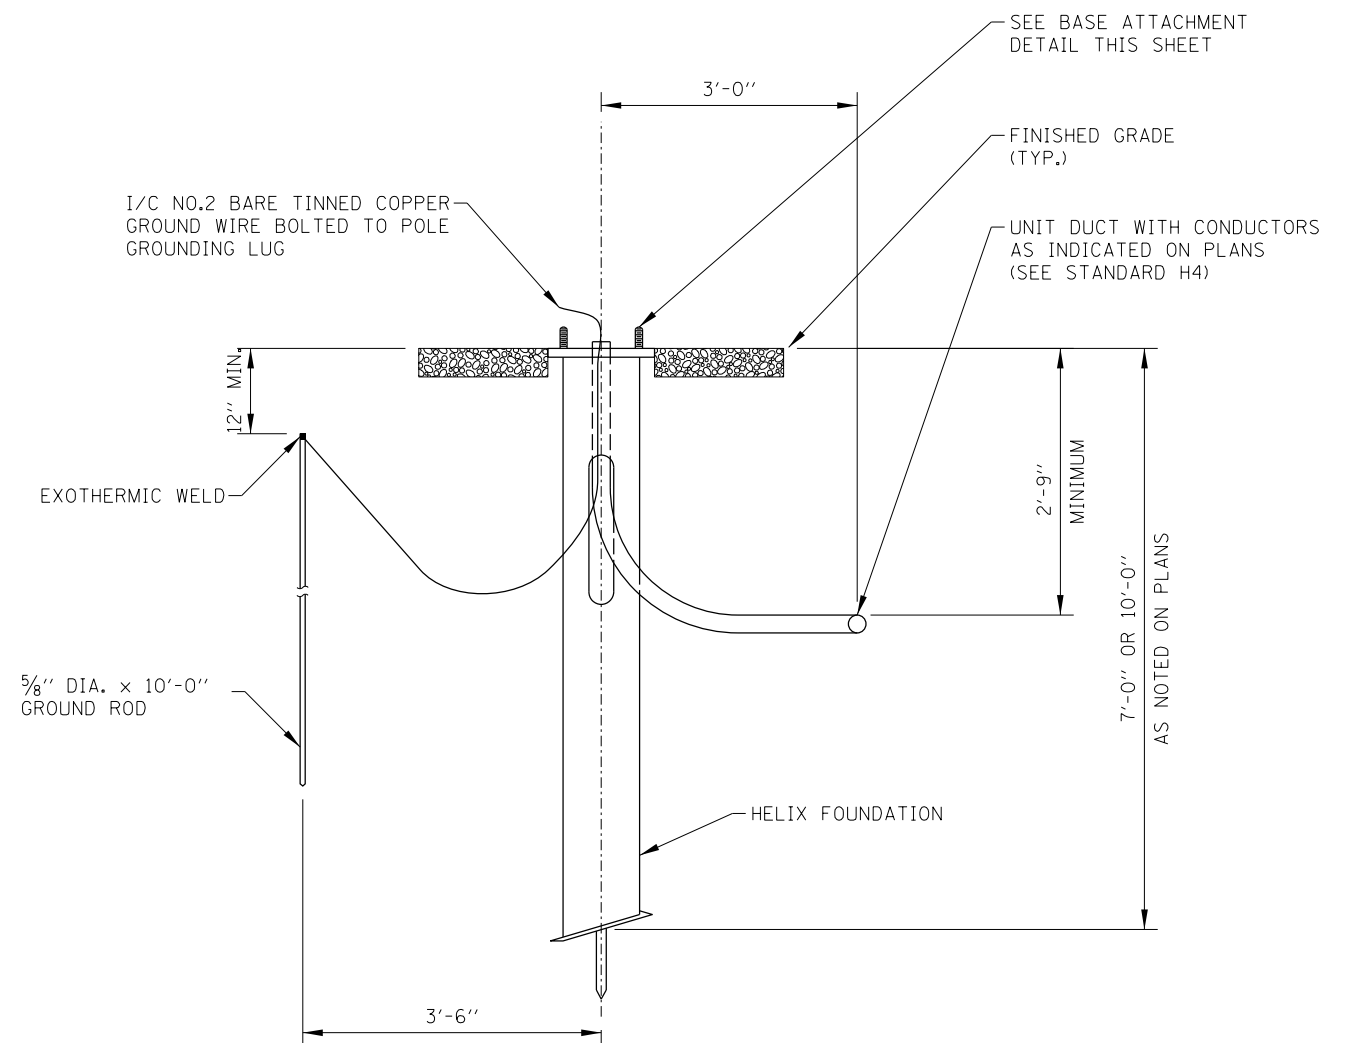

ELEVATION

SHEET 2 OF 9










LIGHT STANDARD FOUNDATION

STANDARD H1-04

APPROVED: *Paul Kovacs* CHIEF ENGINEER DATE: 2-7-2012

LIGHT STANDARD FOUNDATION DETAILS - HELIX (GROUND MOUNTED UNITS)

NOTES:
SEE SHEET 1 OF THIS SERIES FOR NOTES.

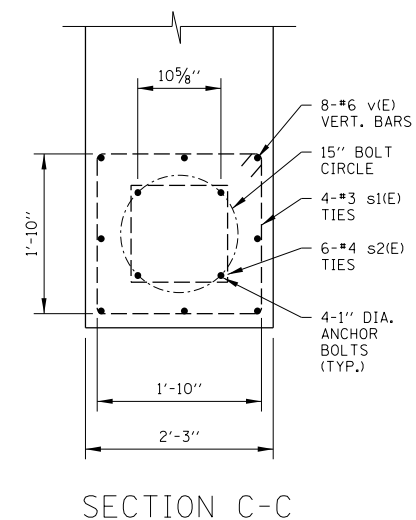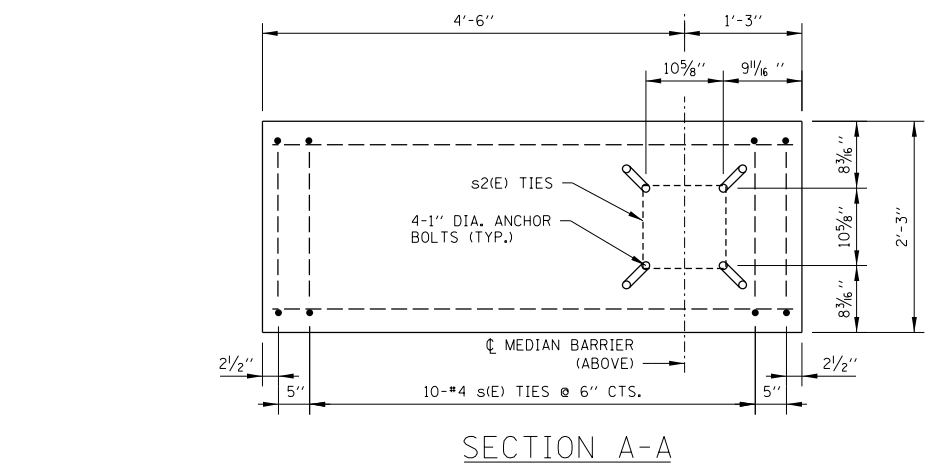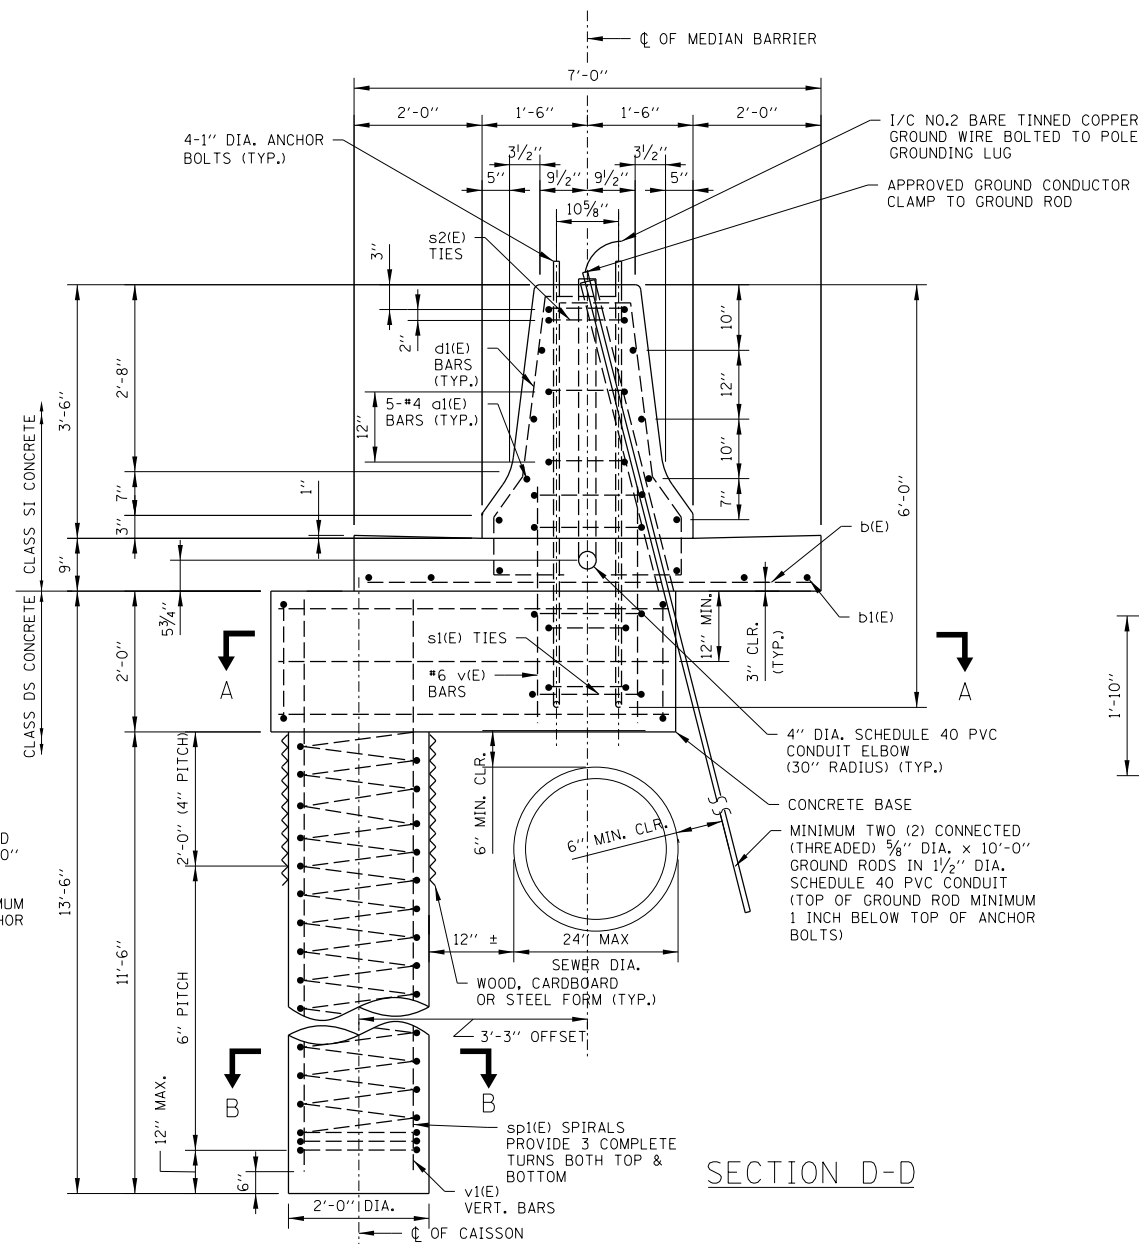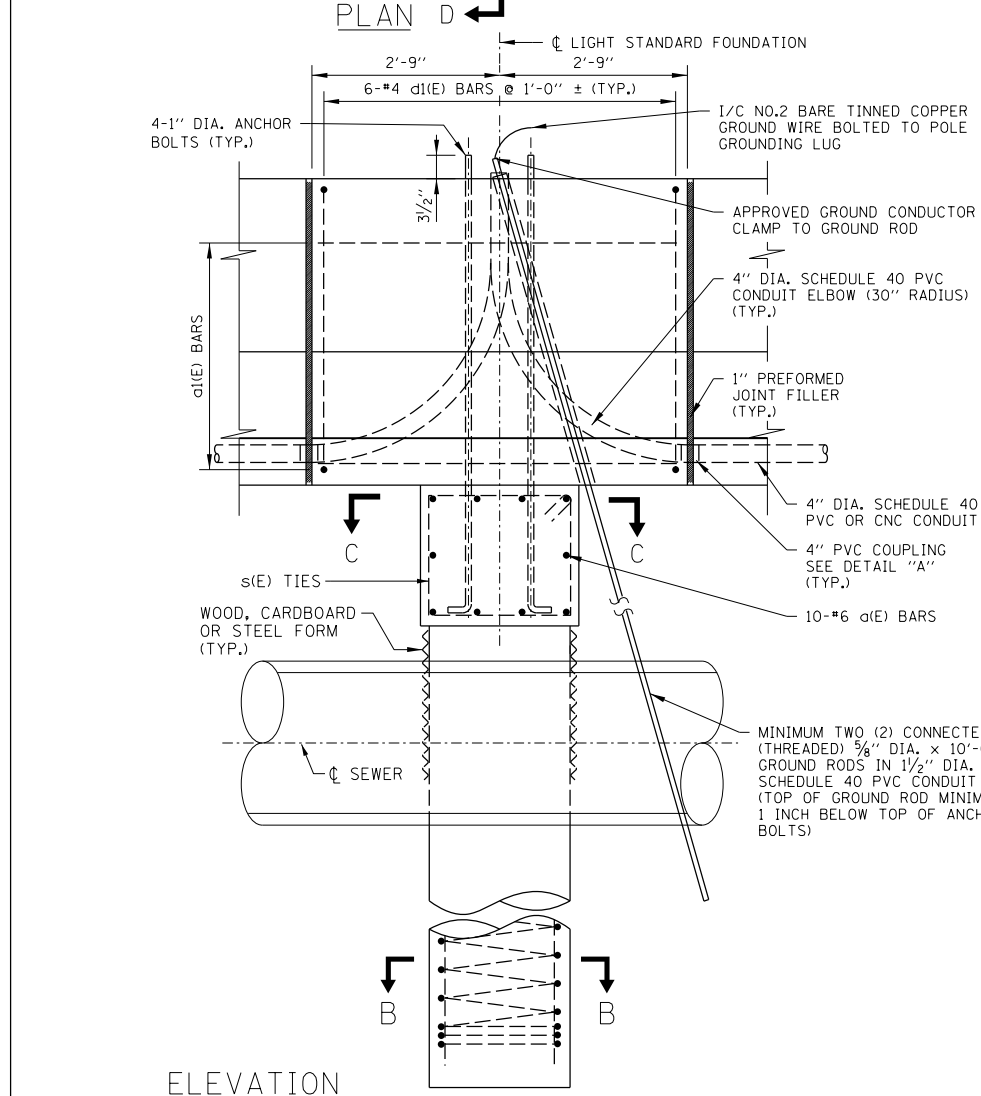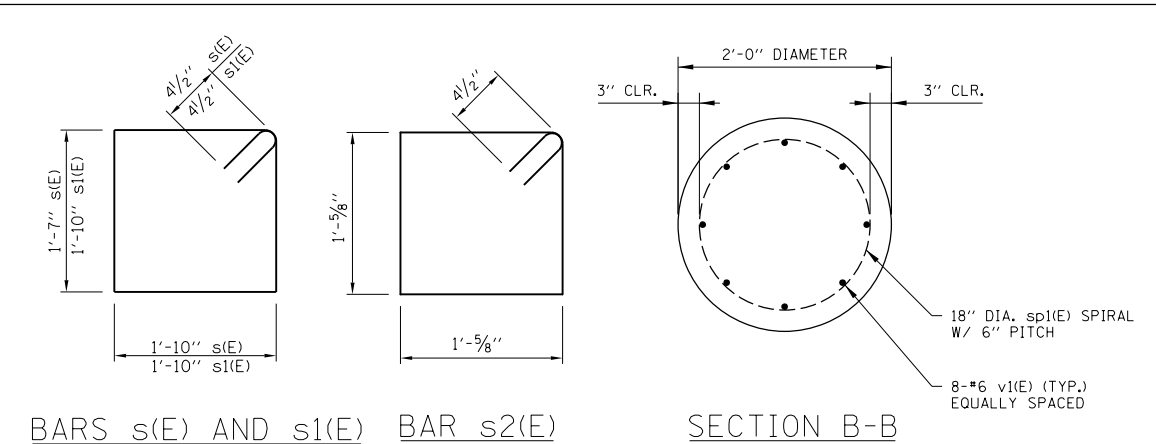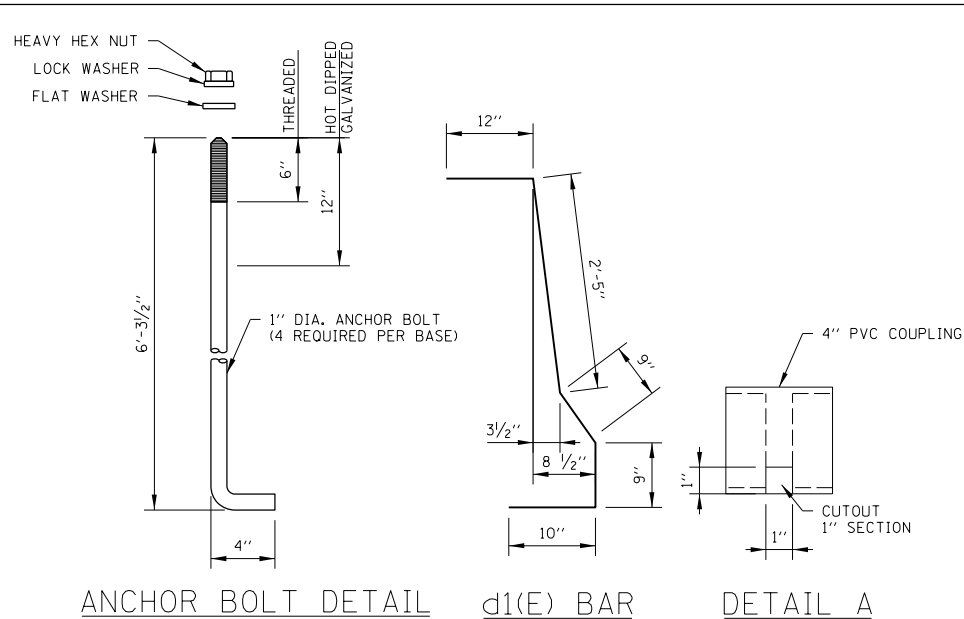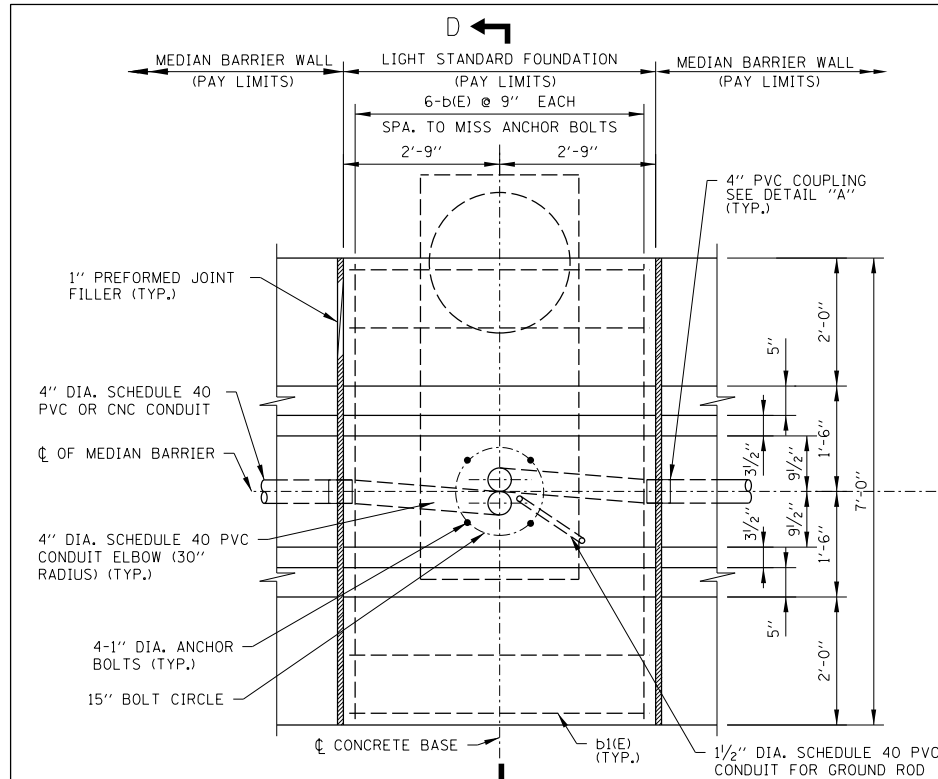

REINFORCEMENT BARS SCHEDULE					
BAR	NO.	SIZE	LENGTH	WT. LB.	SHAPE
a(E)	10	#6	5'-6"	83	
a1(E)	10	#4	5'-0"	34	
b(E)	6	#4	6'-6"	26	
b1(E)	4	#4	5'-2"	14	
d1(E)	12	#4	5'-9"	46	
s(E)	12	#4	7'-7"	61	
s1(E)	4	#4	8'-1"	22	
s2(E)	6	#4	5'-0"	20	
sp1(E)	1	#4	*		
v(E)	8	#6	3'-2"	38	
v1(E)	8	#6	12'-6"	150	

* SEE D-D

SHEET 4 OF 9




LIGHT STANDARD
FOUNDATION

STANDARD H1-04

APPROVED: *Paul Kovacs*
CHIEF ENGINEER DATE: 2-7-2012

LIGHT STANDARD FOUNDATION DETAILS - MEDIAN BARRIER
(TYPE 2 OFFSET CAISSON, 42" BARRIER)

NOTES:
SEE SHEET 1 OF THIS SERIES FOR NOTES.
FOR SLIP FORM, SEE SHEET 6 OF THIS SERIES

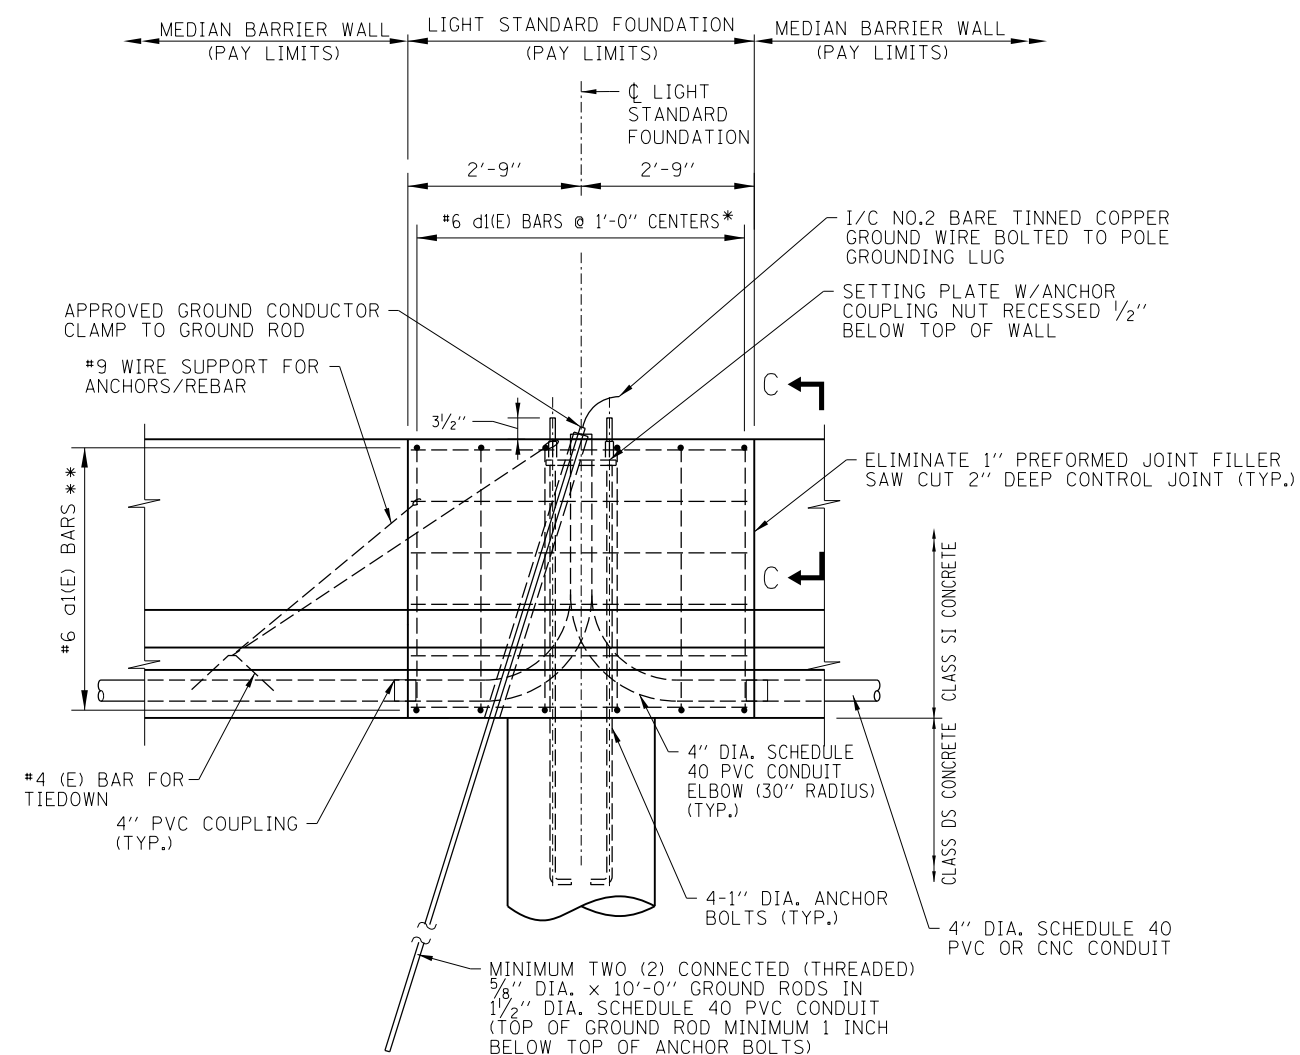

Technical drawing of a 3/4 inch hex nut. The side view on the left shows a cylinder with a length of 3 inches and a 30° chamfer at both ends. The end view on the right shows a hexagon with a 1/2 inch thickness, a pitch diameter of 1 inch to 8, and a minor diameter. A 45° center sink is also indicated at both ends.

(4) HOLES $1\frac{1}{8}"$
ON A 15" BC

10"Ø CENTER
HOLE

16"x16"x1" PLATE
(A36 STEEL-HOT
DIPPED GALVANIZED)

SETTING PLATE




STANDARD H1-04

APPROVED.....
CHIEF ENGINEER


DATE 2-7-2012

LIGHT STANDARD FOUNDATION DETAILS - MEDIAN BARRIER
(MODIFICATIONS FOR SLIPFORM POUR, 42" BARRIER)

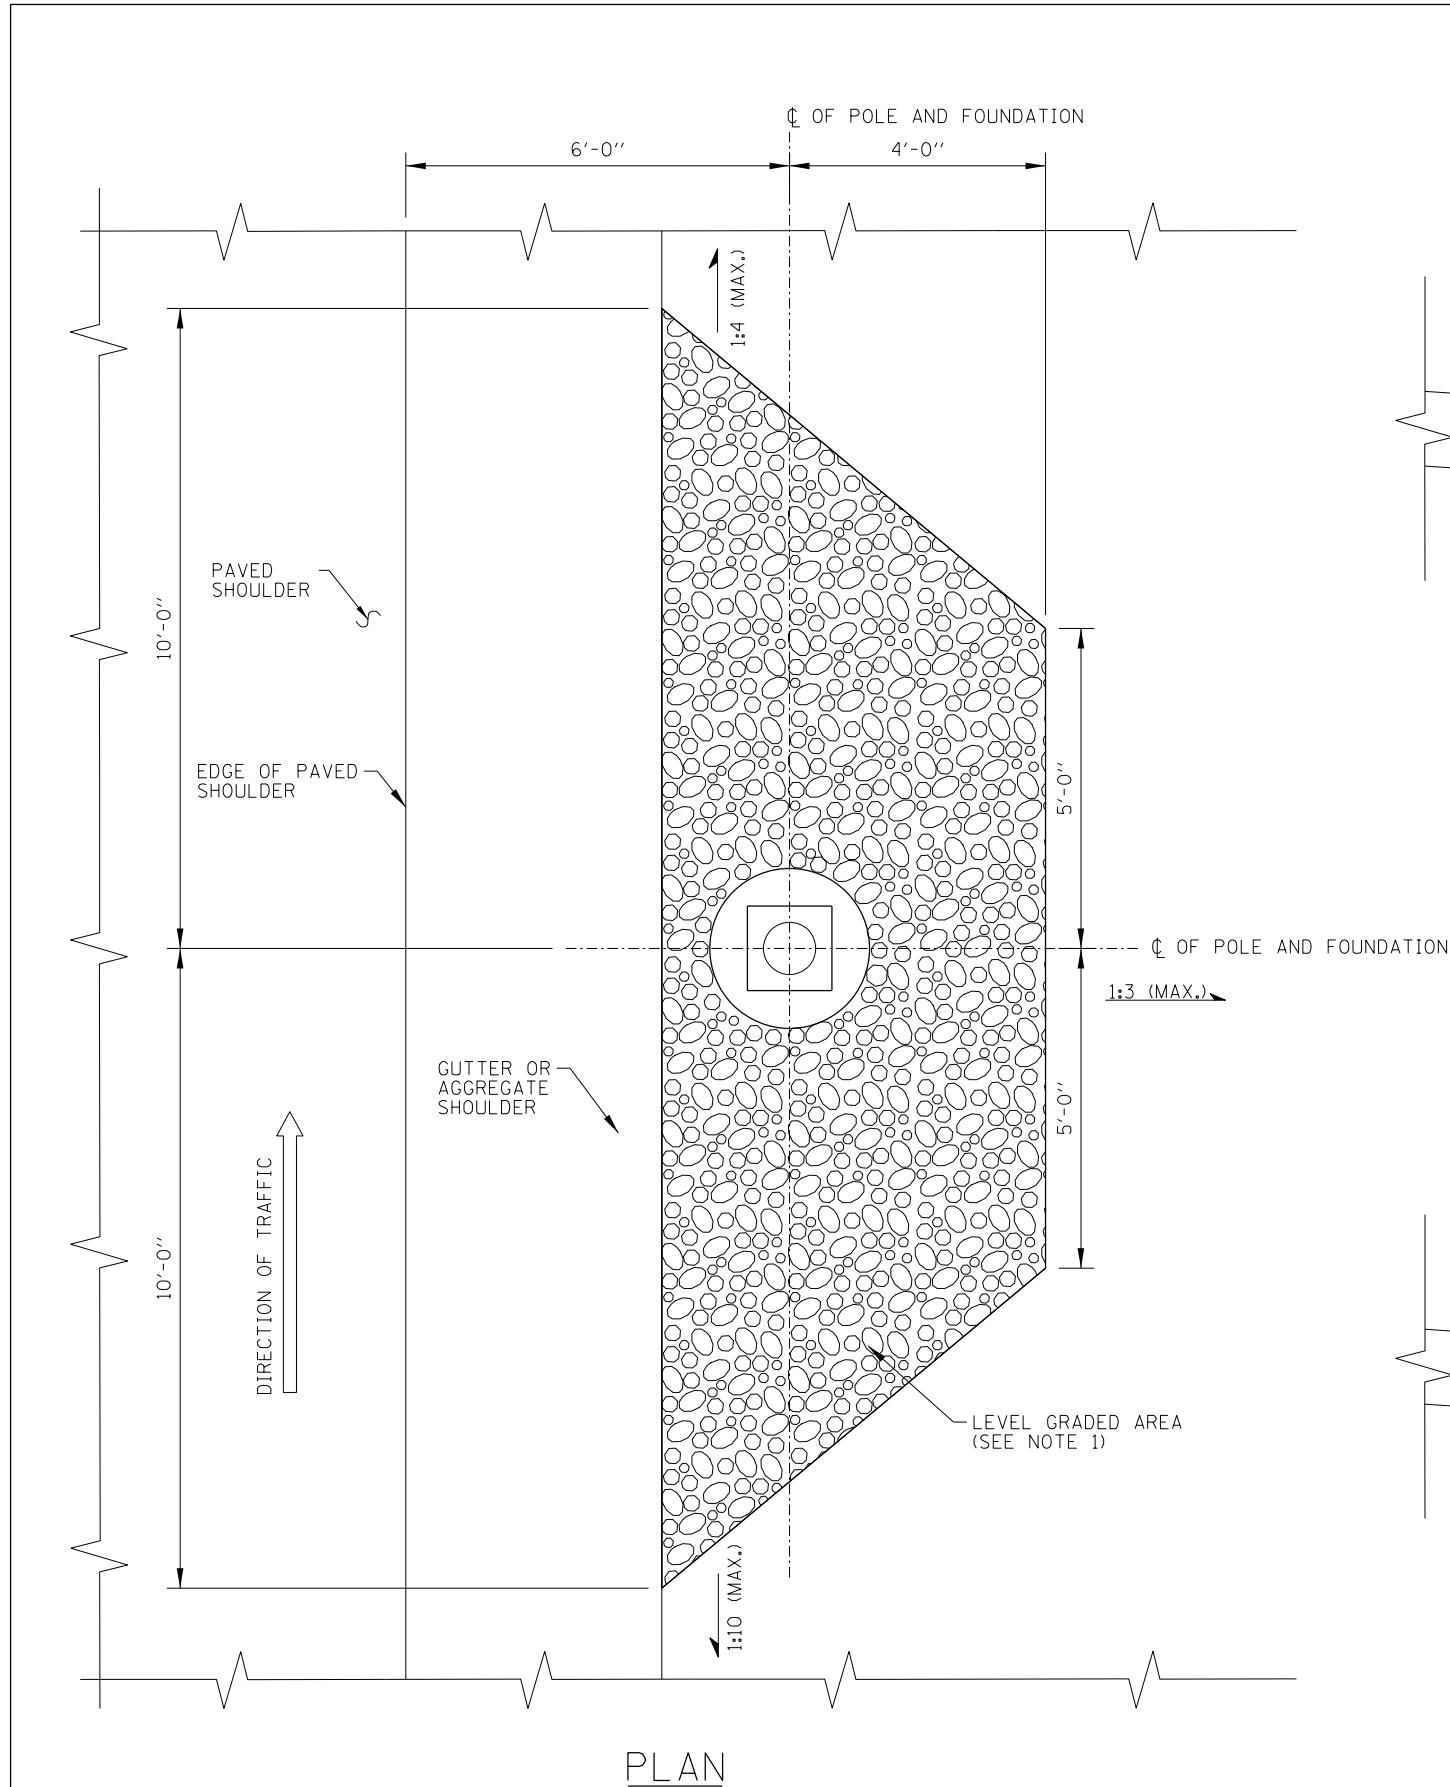


LIGHT STANDARD FOUNDATION DETAILS - GRADING W/ FORESLOPE (GROUND MOUNTED UNITS)

APPROVED: *Paul Kovacs* CHIEF ENGINEER DATE: 2-7-2012


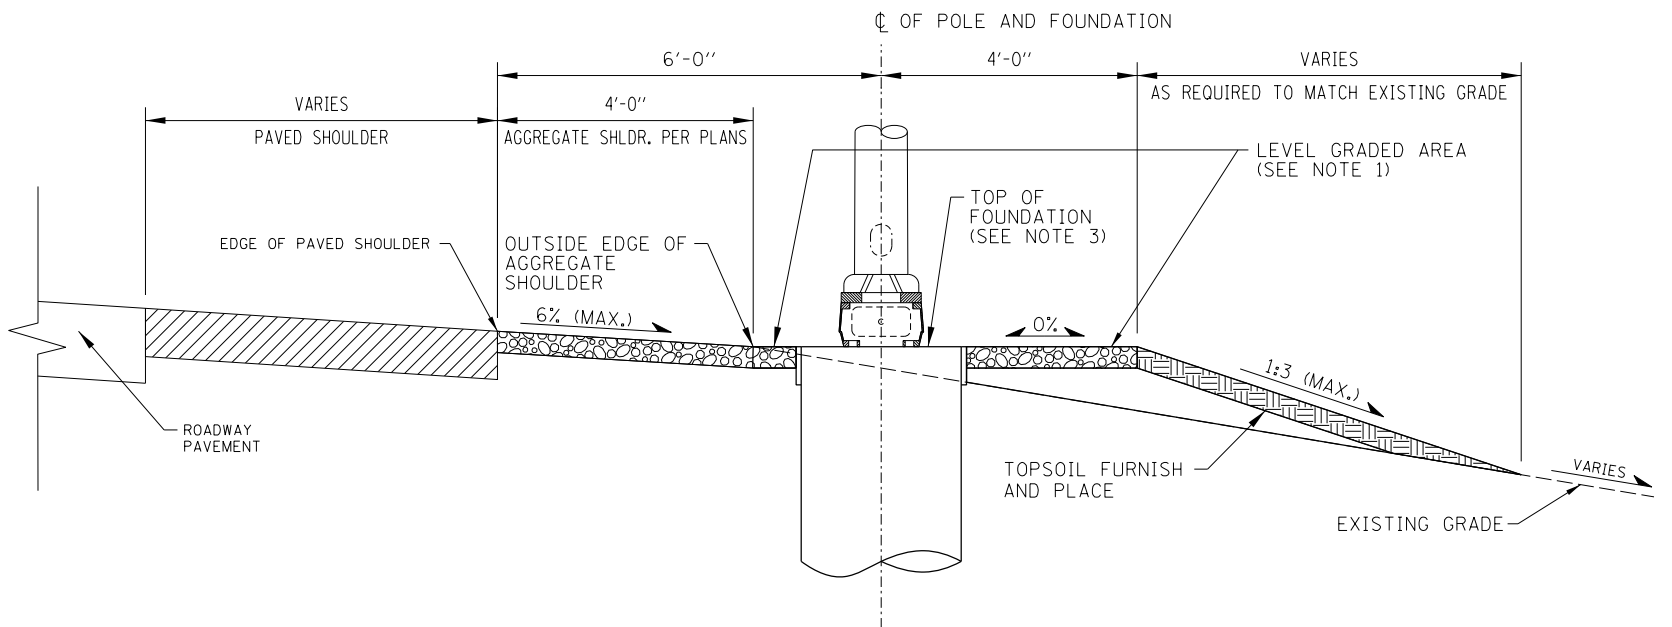


LIGHT STANDARD FOUNDATION
ADJACENT TO AGGREGATE SHOULDER

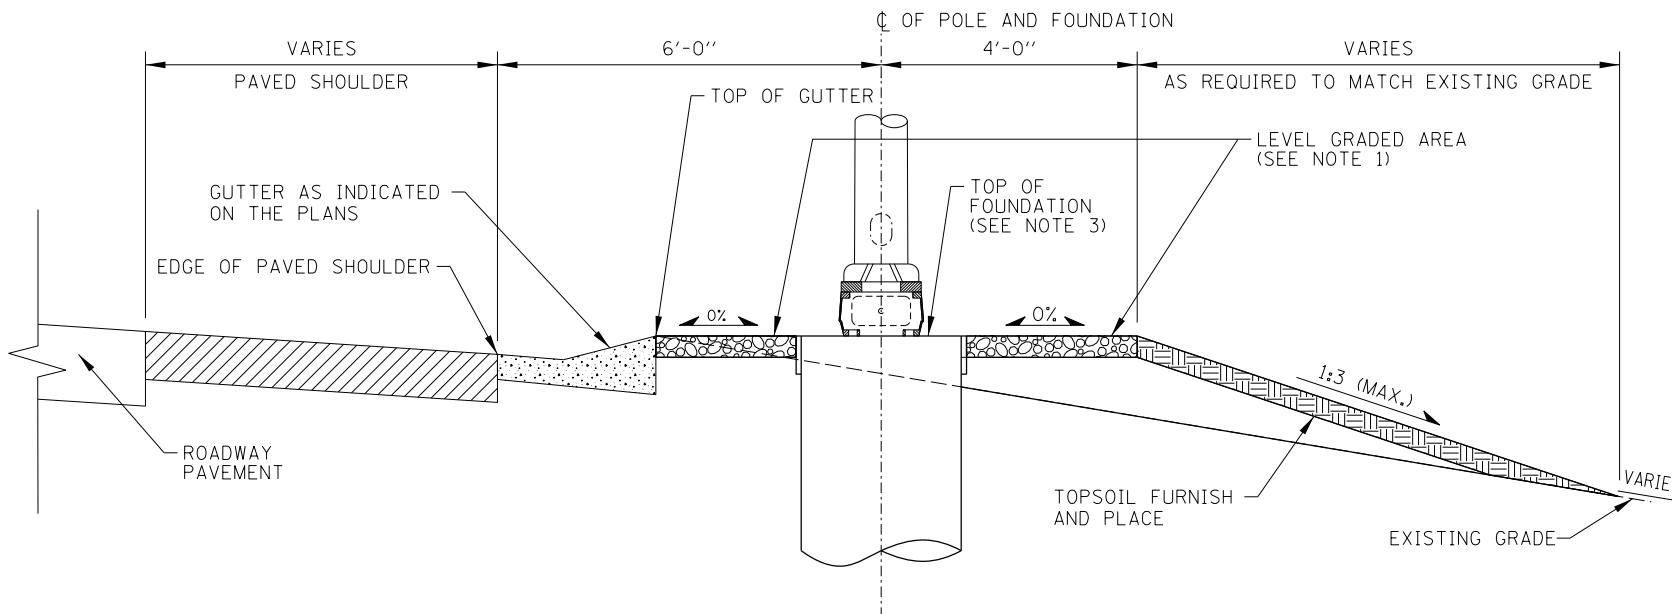

LIGHT STANDARD FOUNDATION
ADJACENT TO GUTTER

NOTE:
SEE SHEET 1 OF THIS SERIES FOR NOTES.

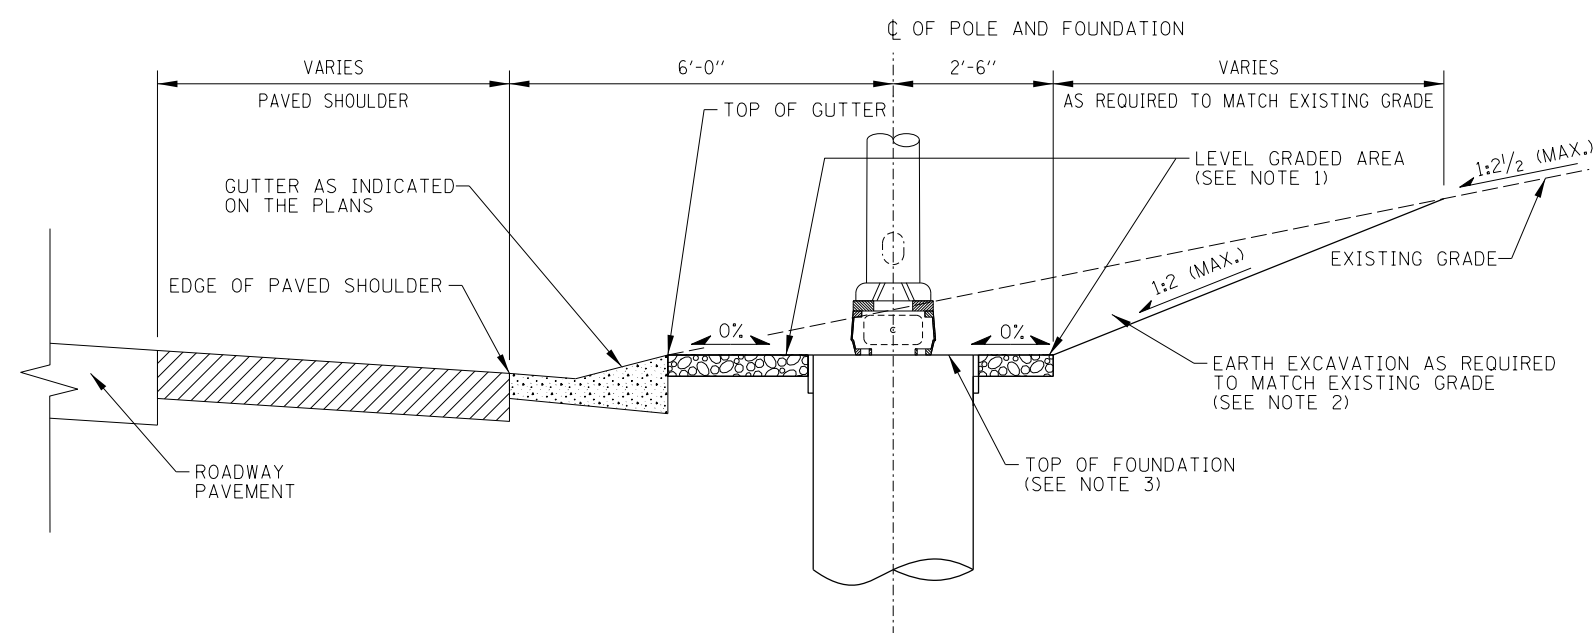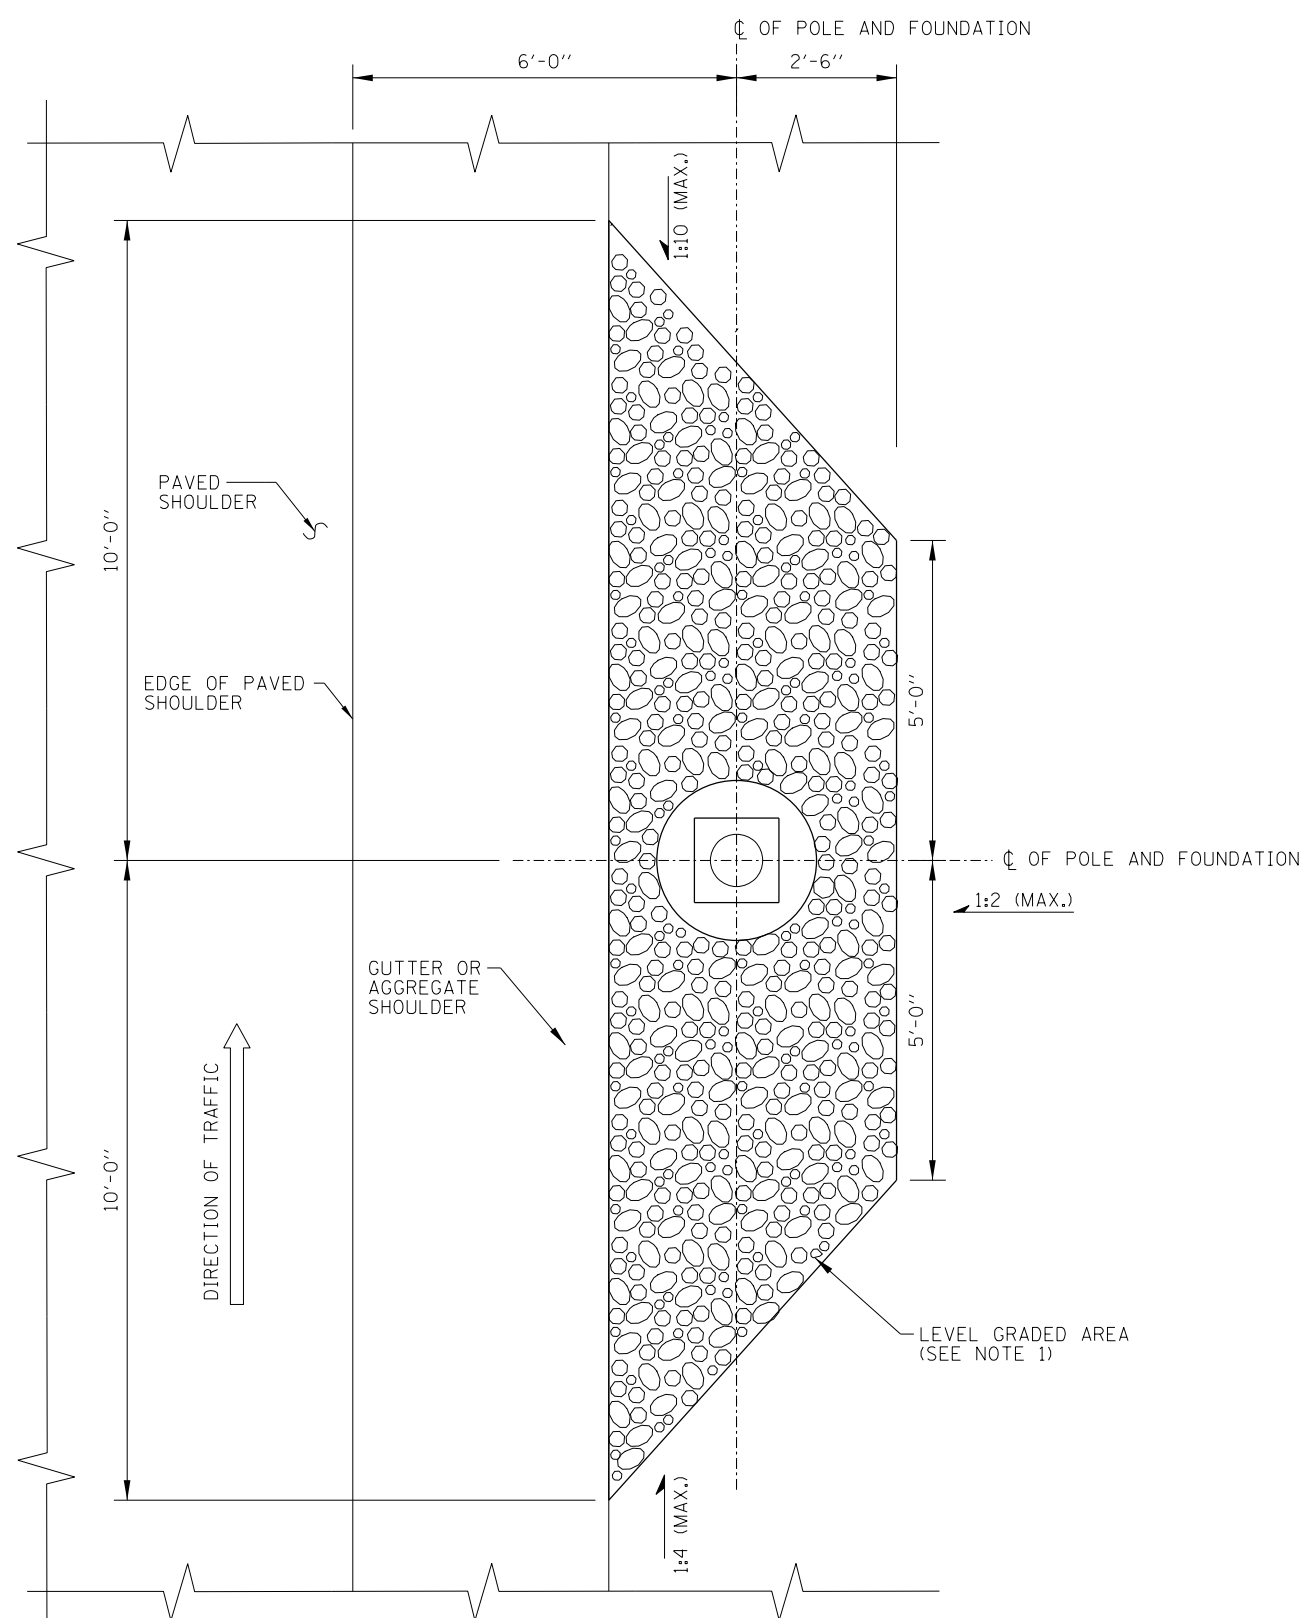

SHEET 8 OF 9




LIGHT STANDARD
FOUNDATION

STANDARD H1-04


APPROVED: Paul Kovacs DATE 2-7-2012
CHIEF ENGINEER

LIGHT STANDARD FOUNDATION DETAILS - GRADING W/ BACKSLOPE
(GROUND MOUNTED UNITS)


NOTE:
SEE SHEET 1 OF THIS SERIES FOR NOTES.

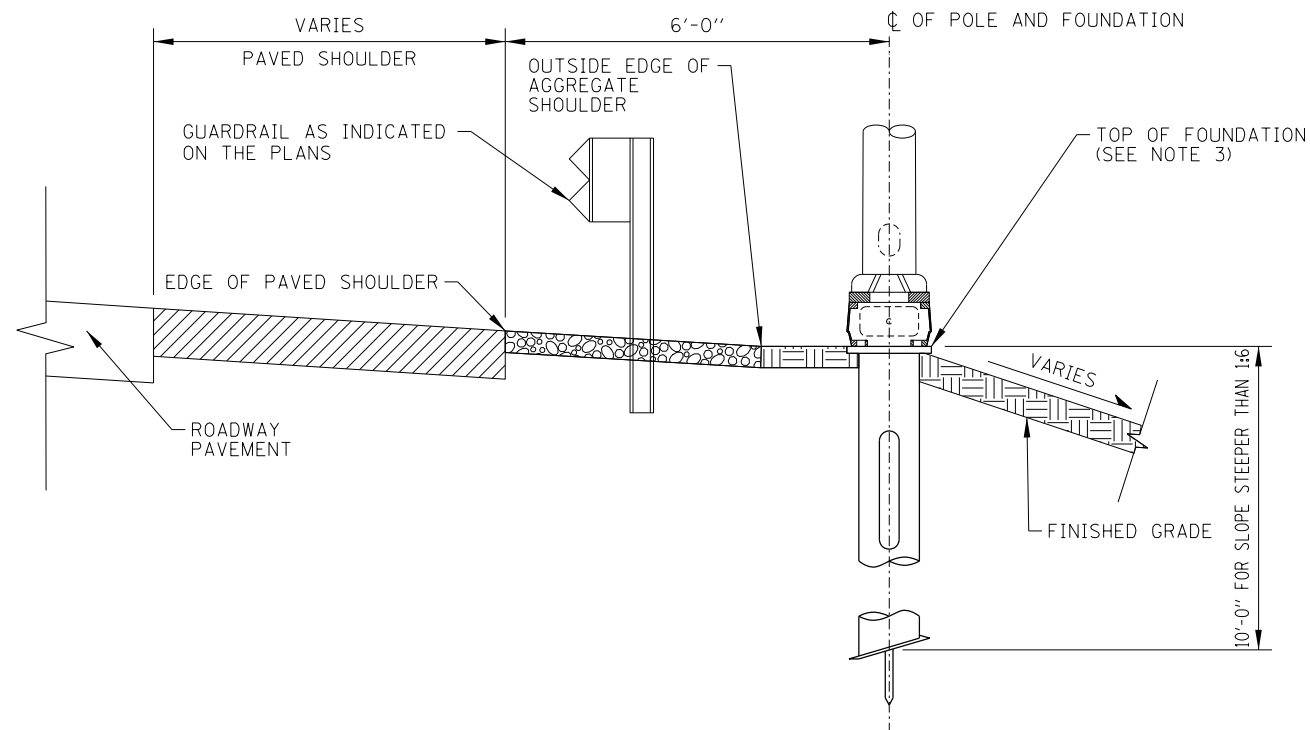


LIGHT STANDARD FOUNDATION - HELIX
ADJACENT TO AGGREGATE SHOULDER

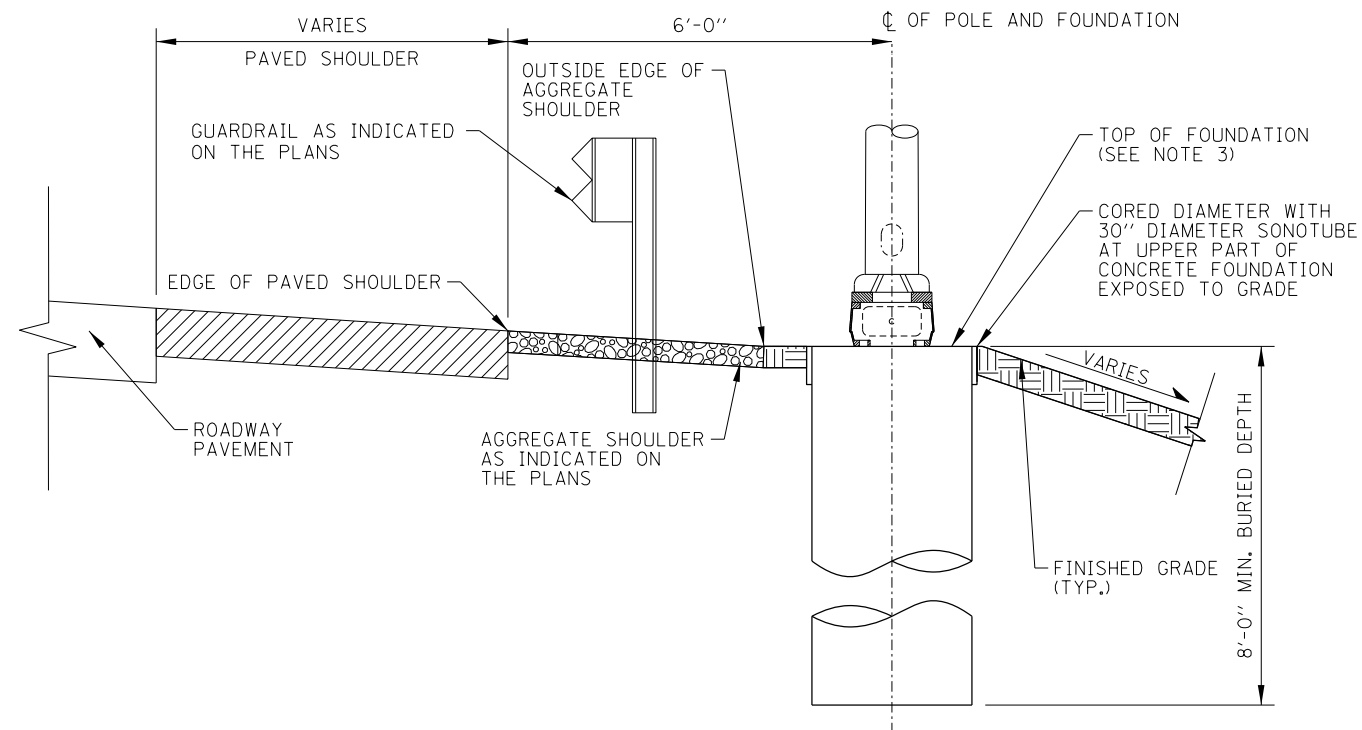

LIGHT STANDARD FOUNDATION - CONCRETE
ADJACENT TO AGGREGATE SHOULDER

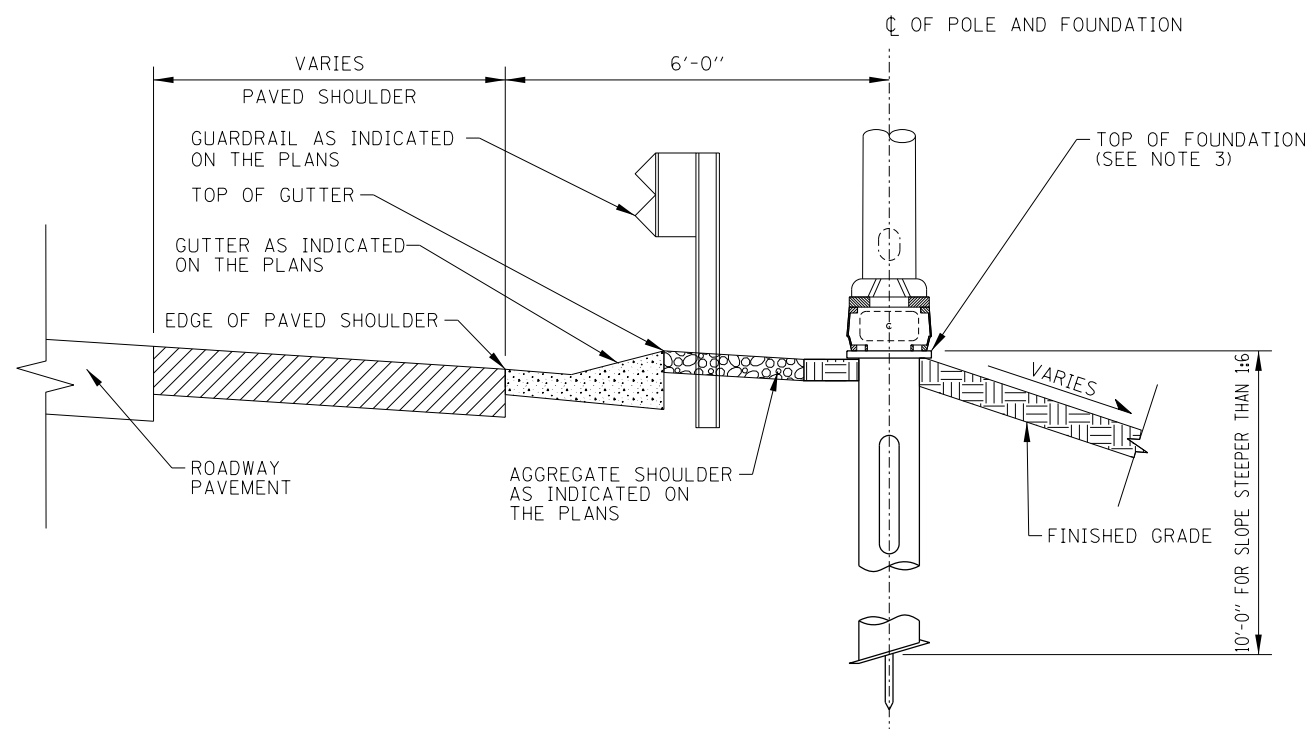

LIGHT STANDARD FOUNDATION - HELIX
ADJACENT TO GUTTER

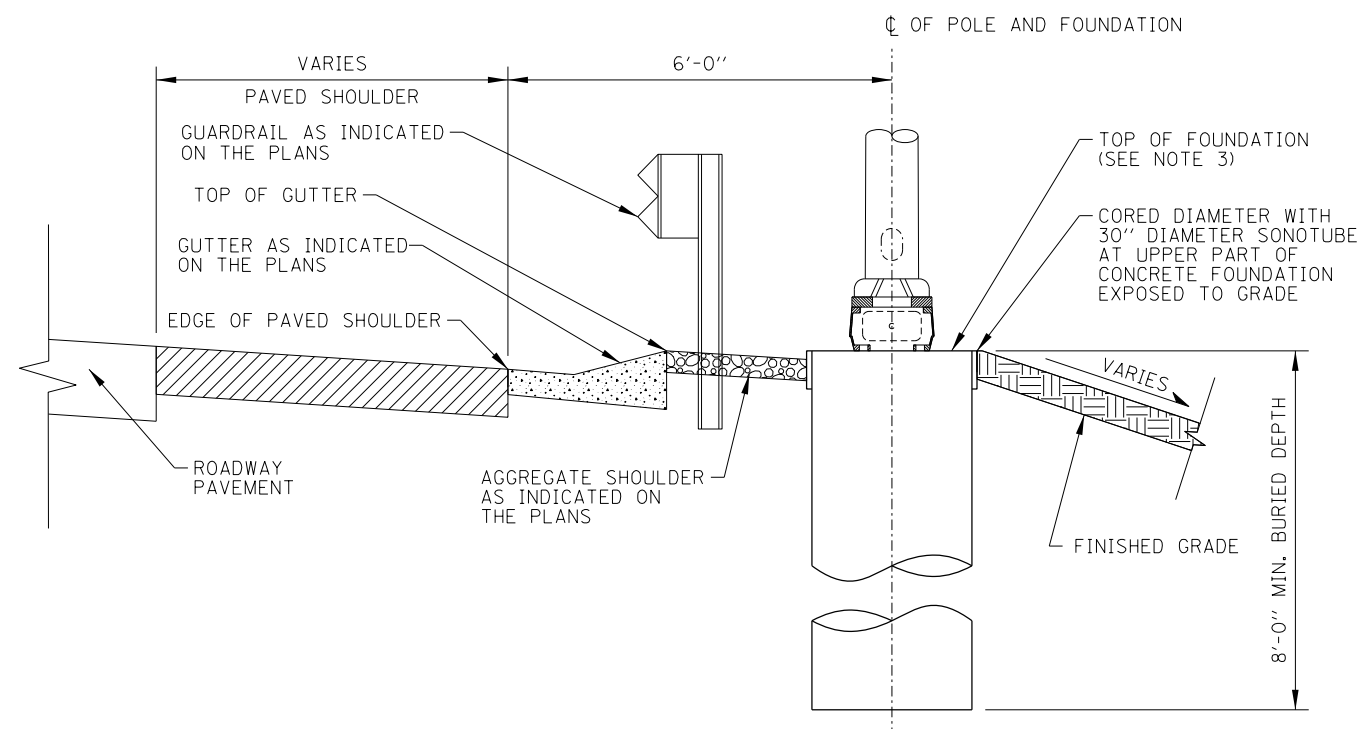

LIGHT STANDARD FOUNDATION - CONCRETE
ADJACENT TO GUTTER

LIGHT STANDARD FOUNDATION DETAILS - ADJACENT TO GUARDRAIL
(GROUND MOUNTED UNITS)

APPROVED *Paul Kovacs* DATE 2-7-2012
CHIEF ENGINEER



NOTE:
SEE SHEET 1 OF THIS SERIES FOR NOTES.

SHEET 9 OF 9




LIGHT STANDARD
FOUNDATION

STANDARD H1-04

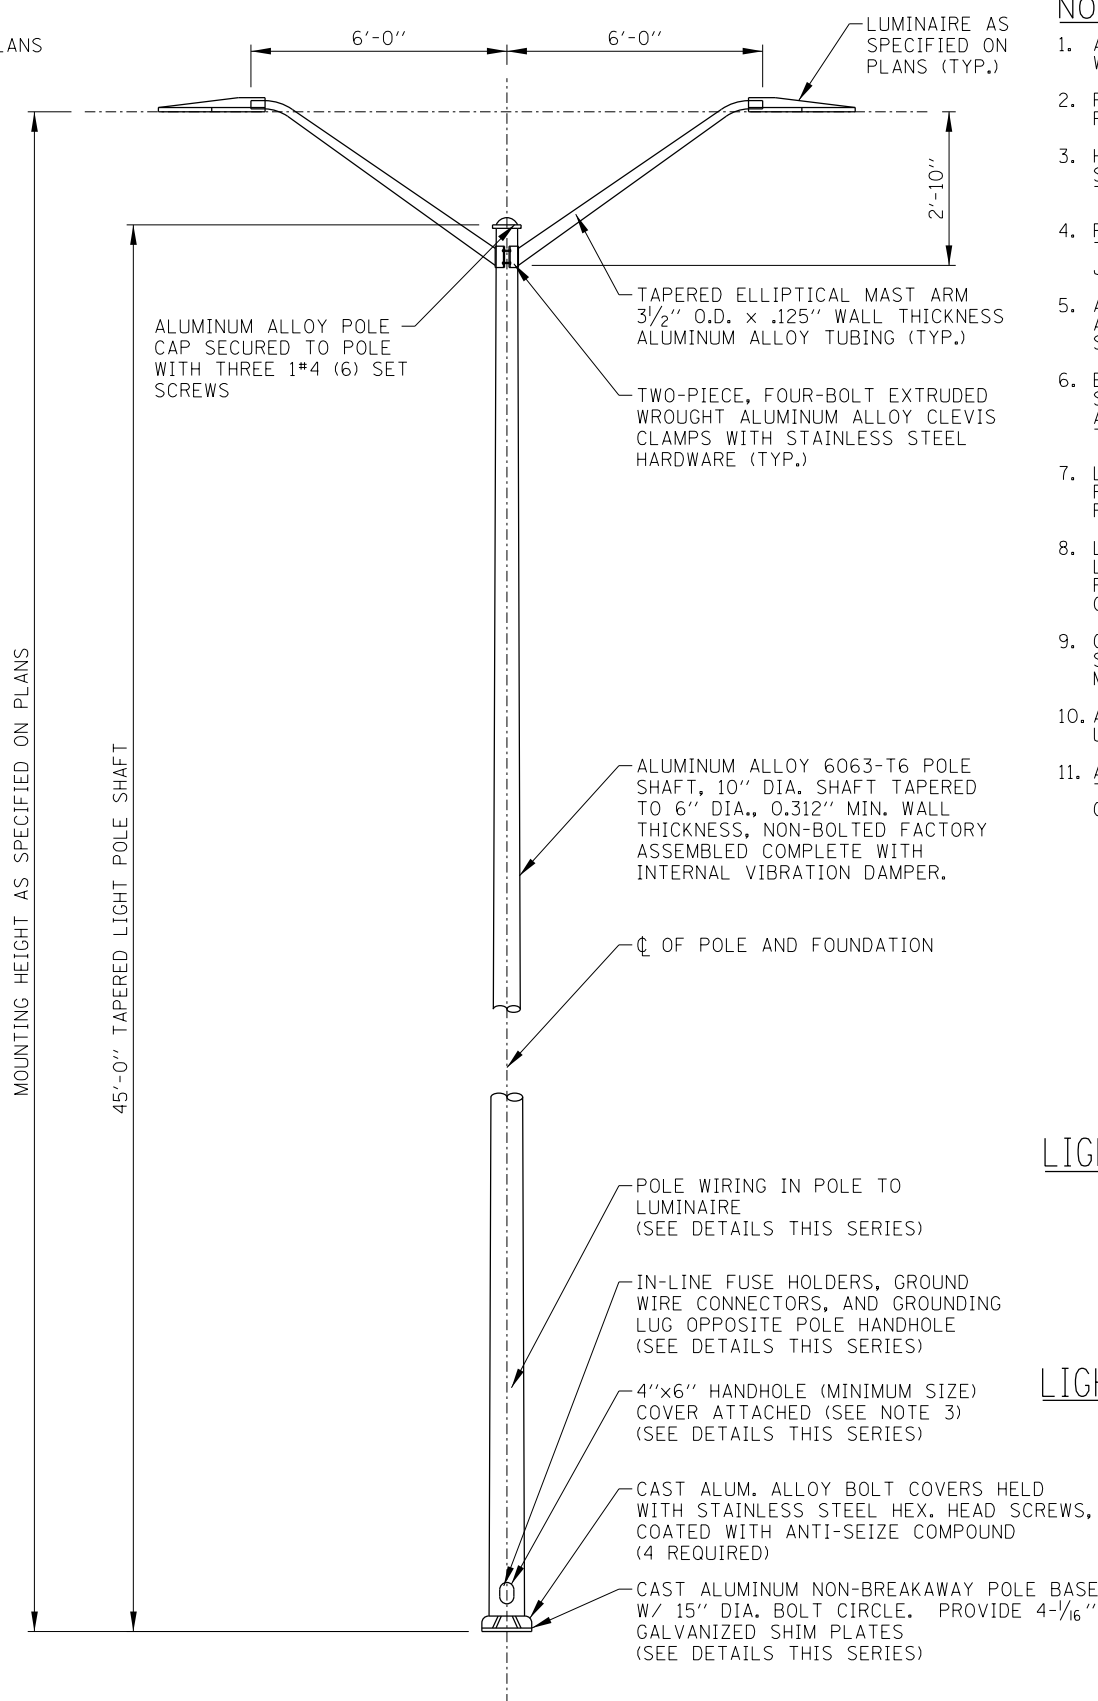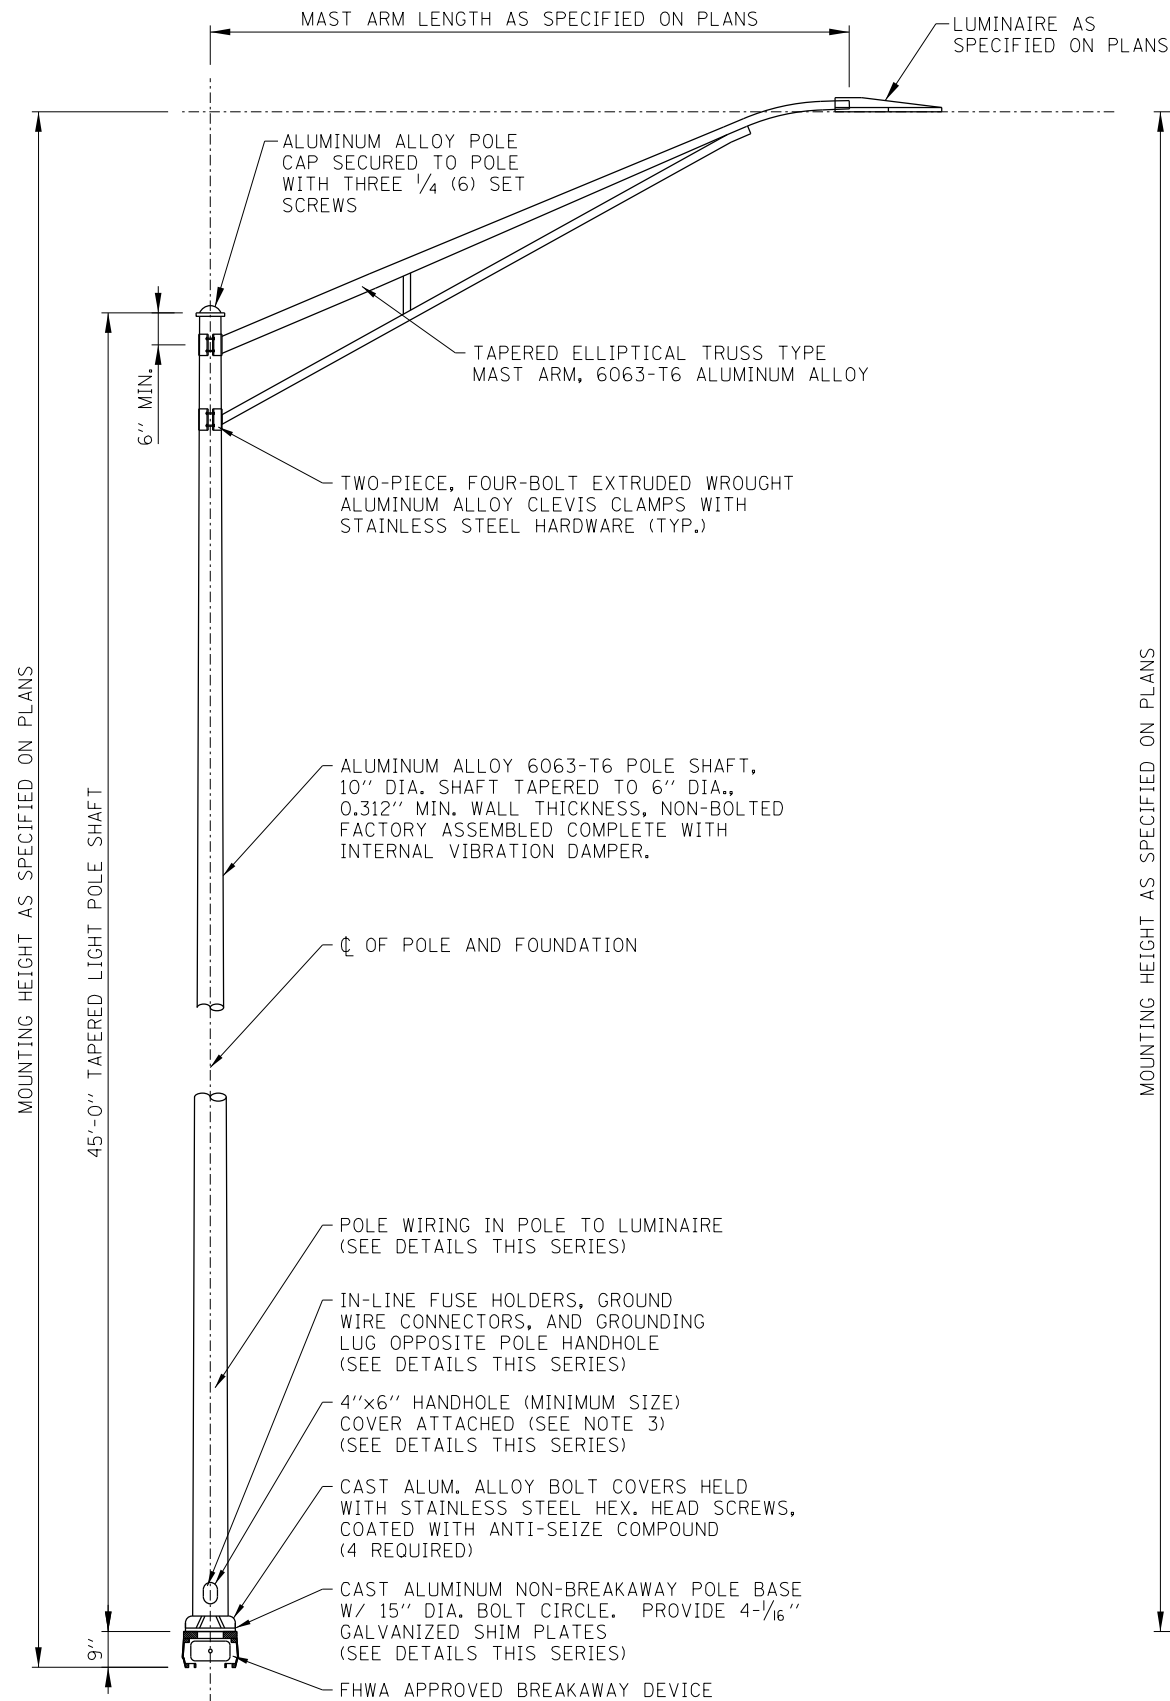


NOTES:


1. ALL LIGHT STANDARDS, BOTH NEW AND EXISTING, ARE SHOWN ON PLANS WITH THE SAMPLE DESCRIPTIONS SHOWN ON THIS SHEET.
2. FOR FOUNDATION DETAILS SEE STANDARD H1 OR FOR STRUCTURAL PARAPET FOUNDATION DETAILS, SEE STRUCTURAL PLANS.
3. HANDHOLE COVERS SHALL BE FASTENED USING TWO STAINLESS STEEL SCREWS WITH CAPTIVE STAINLESS STEEL NUTS OR INSERTS, PER TOLLWAY SUPPLEMENTAL SPECIFICATION SECTION 1069.
4. PROVIDE A 24" LONG POLYETHYLENE TUBE TO PROTECT CABLES WHERE THEY PASS THROUGH THE GROMMETED OPENING AT THE POLE/MAST ARM JUNCTION.
5. ALL GROUND MOUNTED LIGHT POLES SHALL BE PROVIDED WITH AN ACCEPTED FHWA BREAKAWAY BASE OR DEVICE PER THE TOLLWAY SUPPLEMENTAL SPECIFICATIONS SECTION 1070.
6. EACH BRIDGE MOUNTED LIGHT STANDARD SHALL BE PROVIDED WITH SHOCK ABSORBING VIBRATION PADS, NUTS, WASHERS, LEVELING PLATE AND WIRE MESH FOR ITS ERECTION ON THE FOUNDATION AS SHOWN ON THE PLANS.
7. LIGHT STANDARD WIRING DETAIL FOR INSTALLATION WITH CONCRETE FOUNDATION SHOWN. DETAIL FOR INSTALLATION WITH HELIX FOUNDATION IS SIMILAR.
8. LIGHT STANDARD WIRING DETAILS SHOWN FOR TWIN MAST ARM (2 LUMINAIRES PER POLE) INSTALLATIONS. SINGLE MAST ARM (1 LUMINAIRE PER POLE) INSTALLATIONS SHALL OMIT TWO (2) IN-LINE FUSE HOLDERS, ONE SURGE PROTECTION DEVICE AND ASSOCIATED WIRING.
9. CONDUCTORS EXTENDED INTO LIGHT POLE BASE SHALL BE OF SUFFICIENT LENGTH TO WITHDRAW SPLICES AND/OR INSULATED JOINTS A MINIMUM 18" OUT OF THE POLE HANDHOLE.
10. ALL CONDUCTORS ORIGINATING IN POLE SHALL BE A 1/C NO. 10 AWG UNLESS OTHERWISE NOTED.
11. ALL EQUIPMENT SHALL BE GROUNDED AND BONDED IN ACCORDANCE WITH THE NATIONAL ELECTRICAL CODE AND THE NATIONAL ELECTRICAL SAFETY CODE.

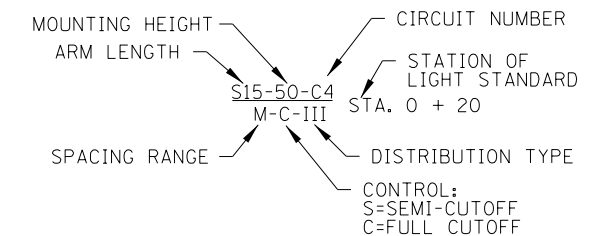

LIGHT STANDARD DESCRIPTION - HPS LUMINAIRES

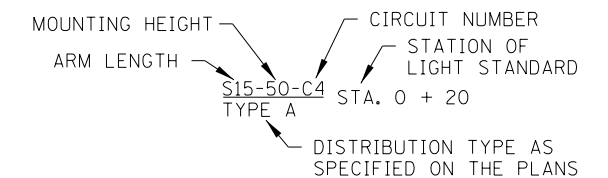

LIGHT STANDARD DESCRIPTION - LED LUMINAIRES

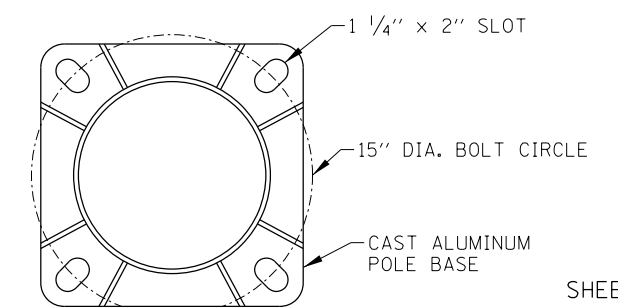

POLE BASE

LIGHT STANDARD - SINGLE MAST ARM

LIGHT STANDARD - TWIN MAST ARM

LIGHT STANDARD DETAILS

APPROVED: *Paul Kovacs* DATE: 2-7-2012
CHIEF ENGINEER


DATE	REVISIONS
02-07-12	REVISED LIGHT POLE HANDHOLE NOTES, REMOVED CABLE VOLTAGE, AND REVISED NOTES.
03-31-14	REVISED WIRING DIAGRAM.
3-11-2015	REVISED LIGHT STANDARD POLE WIRING DETAILS.




LIGHT STANDARD
DETAILS

STANDARD H2-03


SHEET 1 OF 3

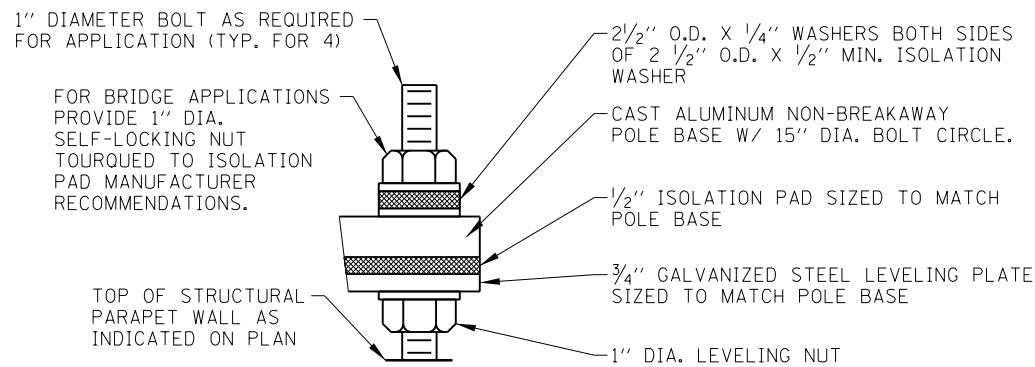


DETAIL A

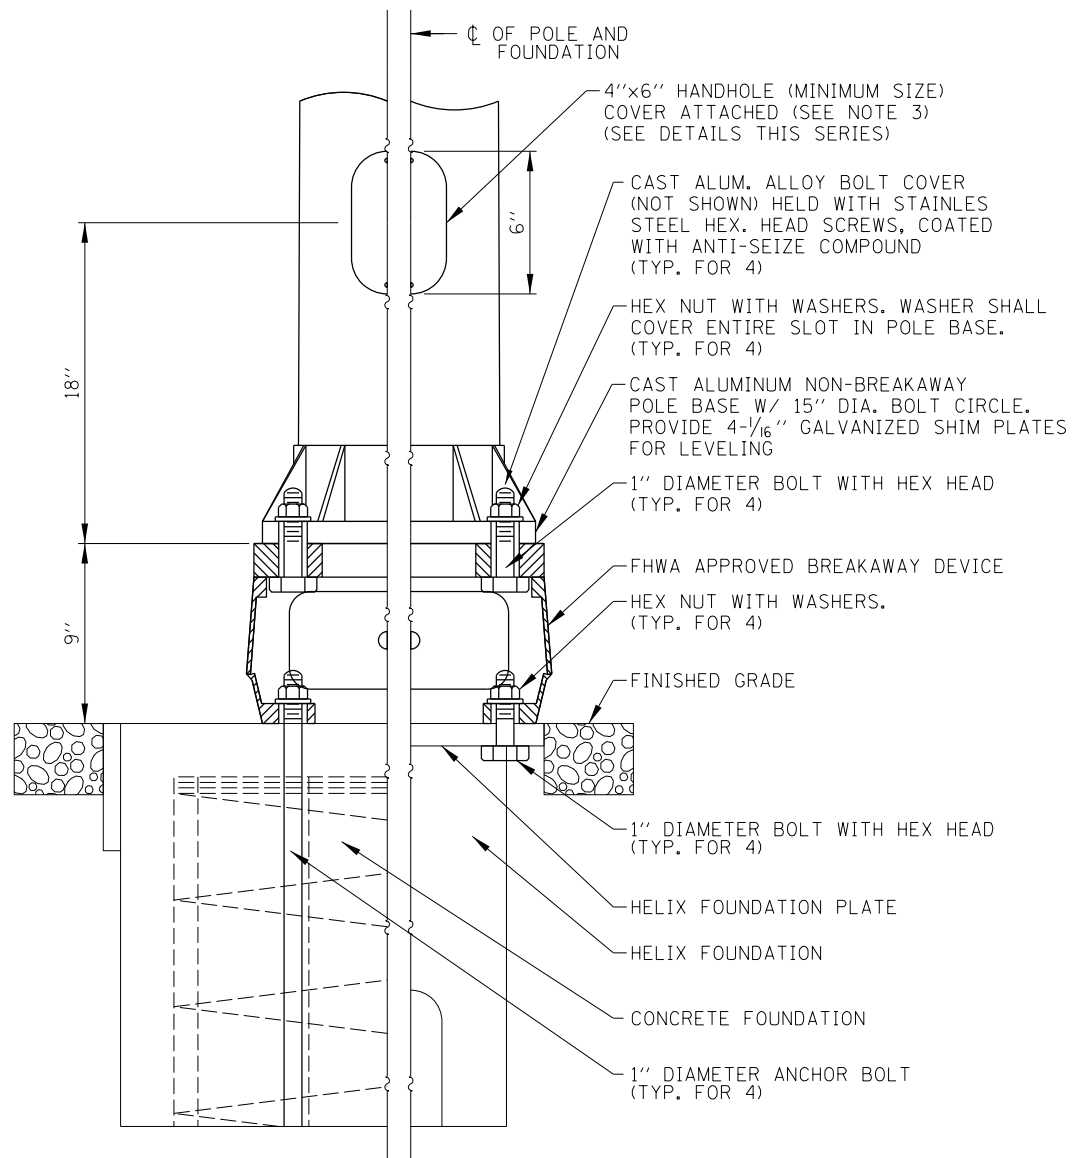


LIGHT STANDARD MOUNTING DETAIL
(GROUND MOUNTED UNITS)

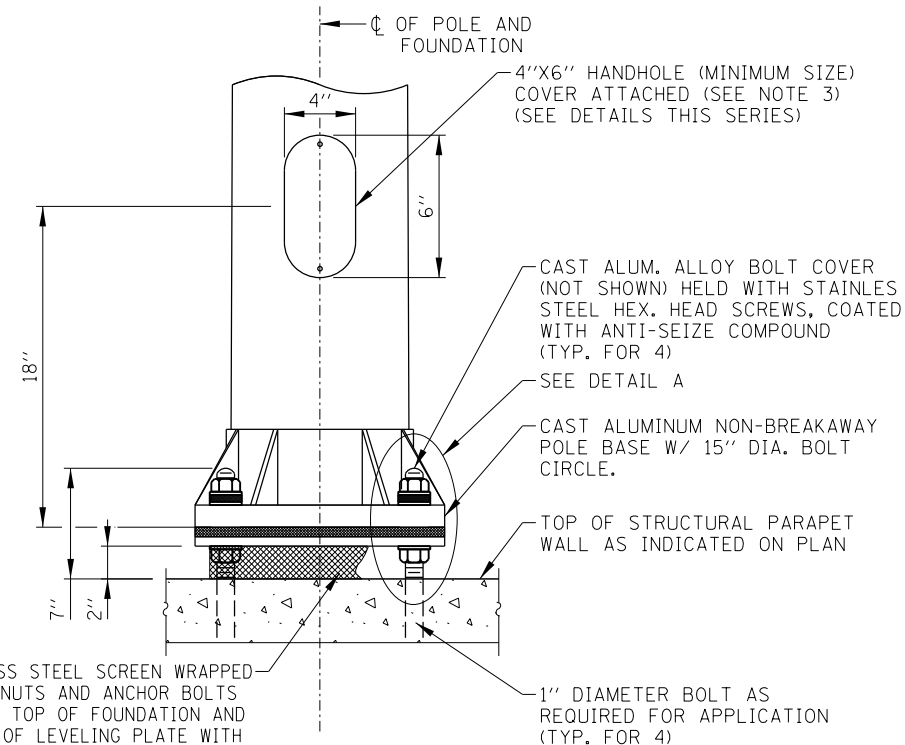


LIGHT STANDARD MOUNTING DETAIL
(STRUCTURAL PARAPET WALL MOUNTED UNITS)

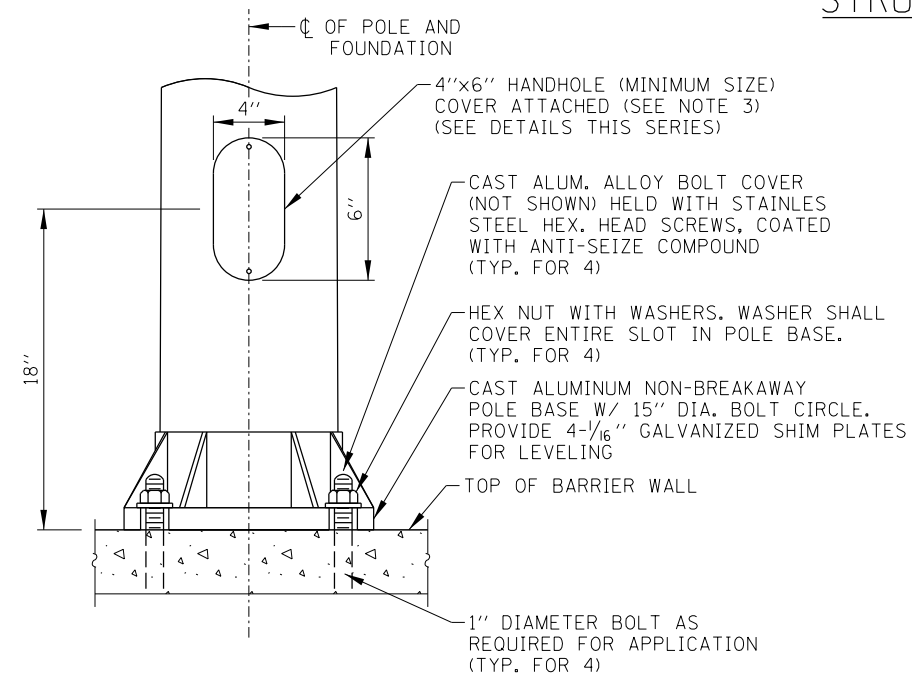


LIGHT STANDARD MOUNTING DETAIL
(BARRIER WALL MOUNTED UNITS)

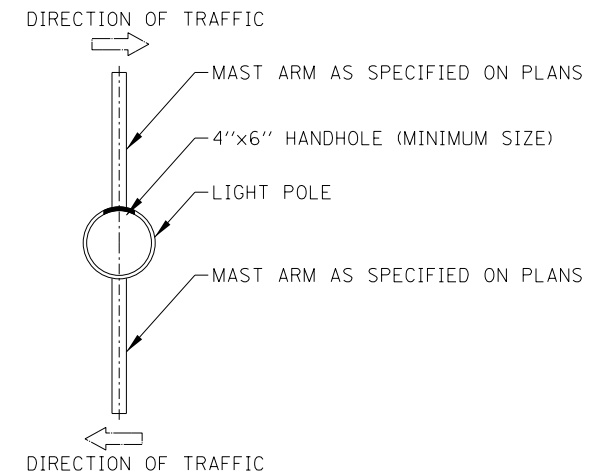

MEDIAN BARRIER WALL MOUNTED UNITS

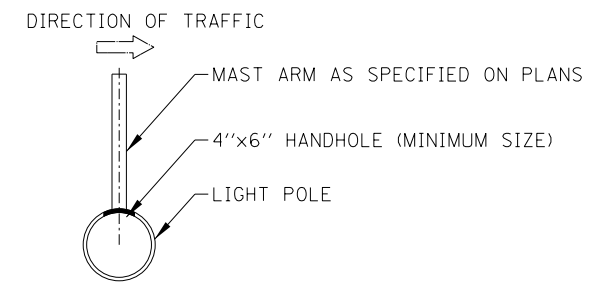

STRUCTURAL PARAPET WALL MOUNTED UNITS

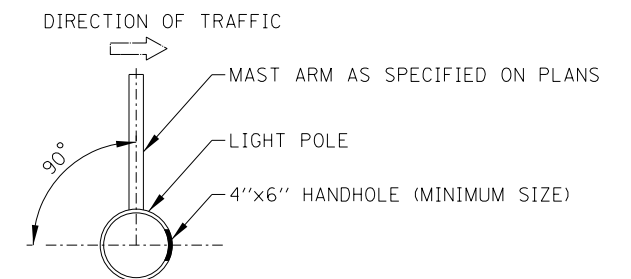

GROUND MOUNTED UNITS

LIGHT STANDARD HANDHOLE
ORIENTATION DETAIL

SHEET 2 OF 3




LIGHT STANDARD
DETAILS

STANDARD H2-03


APPROVED: *Paul Kovacs* DATE: 2-7-2012
CHIEF ENGINEER

LIGHT STANDARD MOUNTING DETAILS


NOTE:
SEE SHEET 1 OF THIS SERIES FOR NOTES.

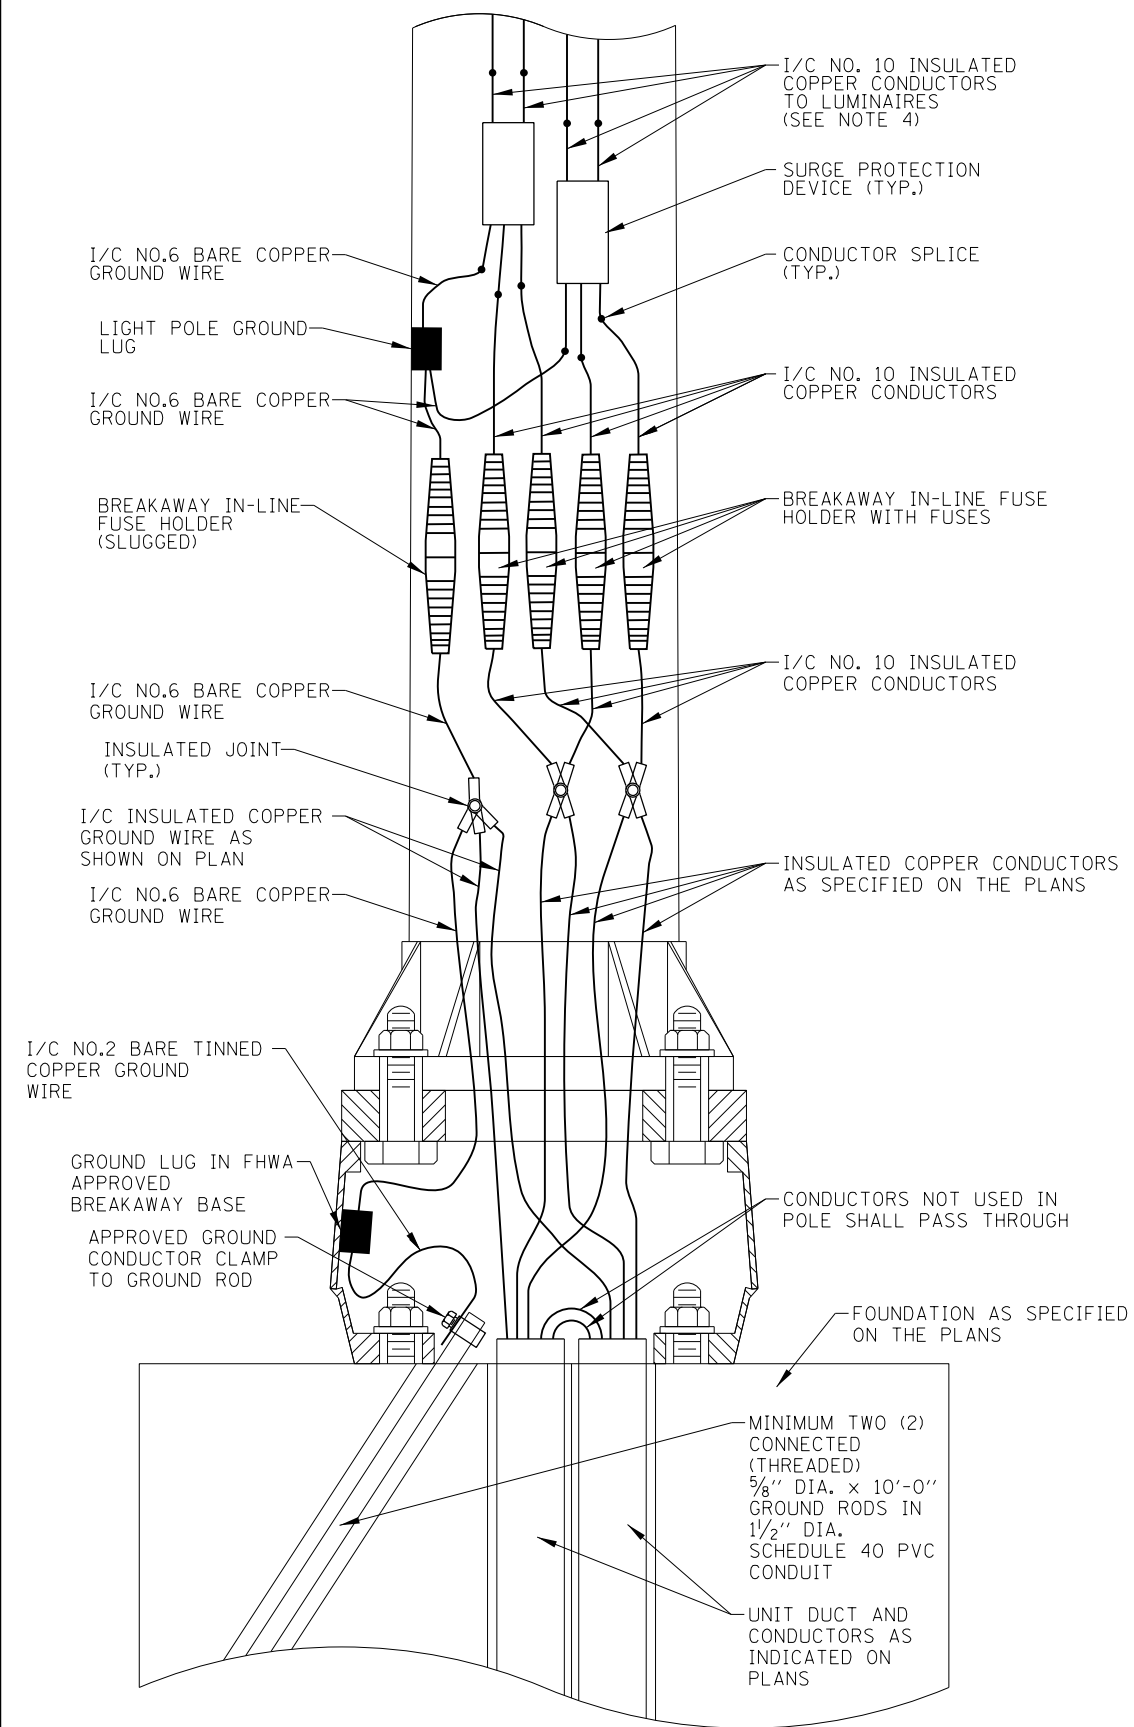


LIGHT STANDARD WIRING DETAIL
(GROUND MOUNTED UNITS)
(SEE NOTES 7 & 8)

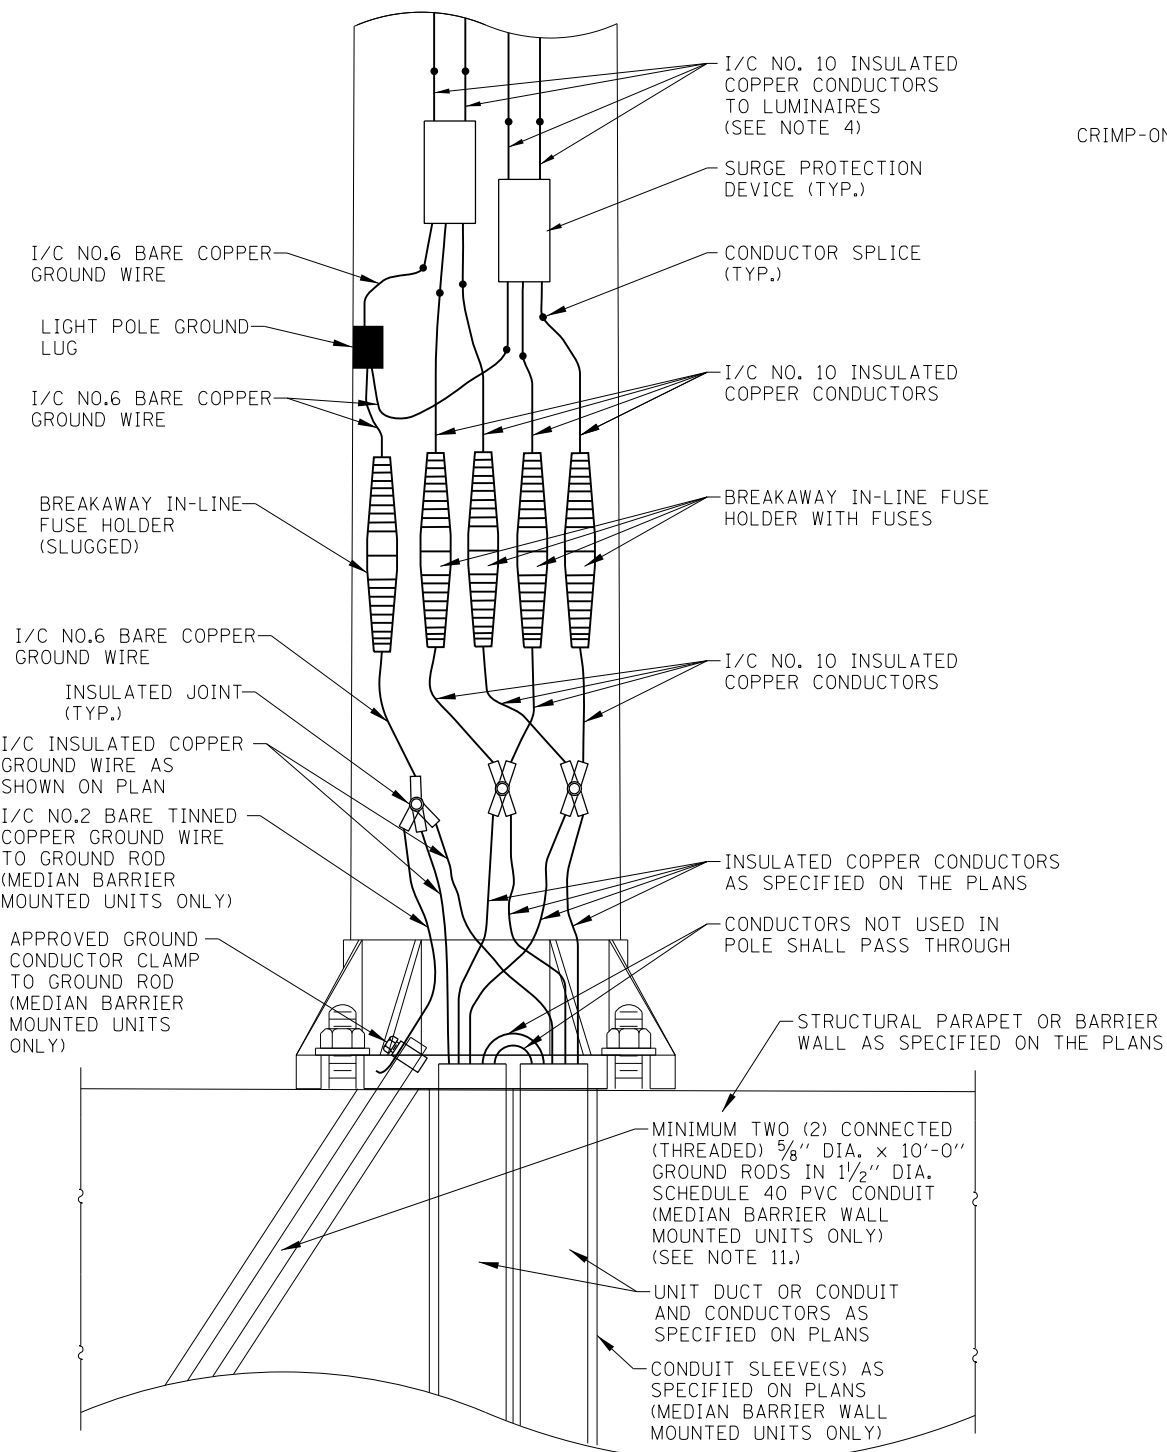


LIGHT STANDARD WIRING DETAIL
(STRUCTURAL AND BARRIER WALL MOUNTED UNITS)

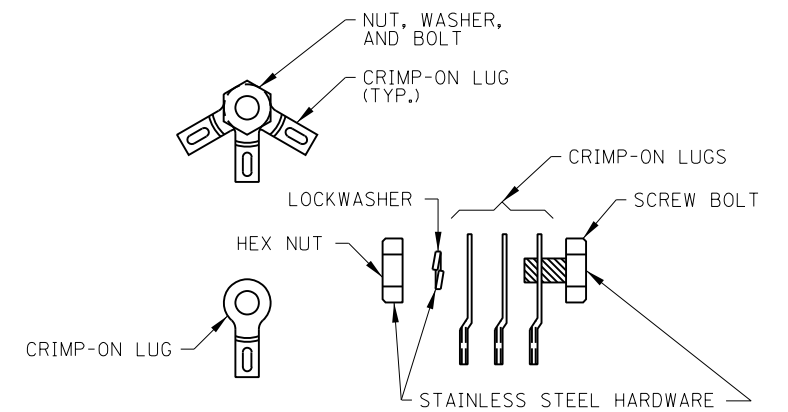

INSULATED JOINT DETAIL


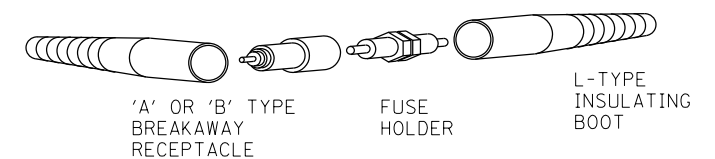


IN-LINE FUSE HOLDER WITH BREAKAWAY FEATURE DETAIL

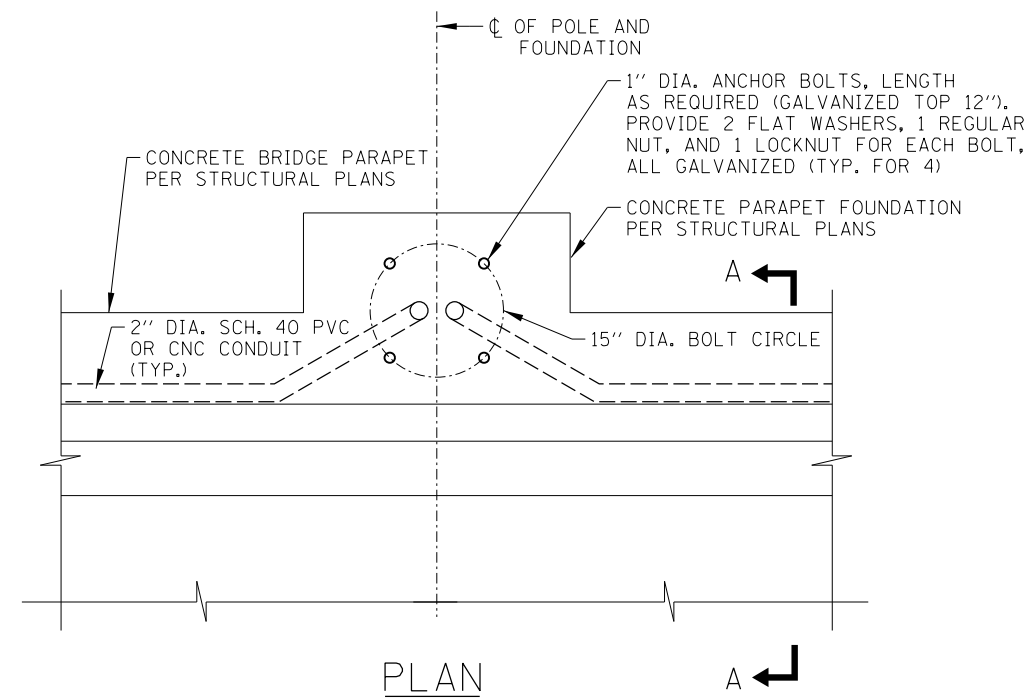

NOTES:

1. FOR STRUCTURAL PARAPET FOUNDATION DETAILS, SEE STRUCTURAL PLANS.
2. THE END 4'-0" SECTION OF WINGWALL/PARAPET SHALL BE KEPT FREE FROM ANY ATTACHMENTS TO AVOID CONFLICT FROM TRAFFIC BARRIER TERMINAL TYPE T6 ANCHORAGE ASSEMBLY.
3. ALL CONDUIT, JUNCTION BOXES AND APPURTENANCES MOUNTED TO STRUCTURE SHALL BE OFFSET FROM THE FACE OF THE STRUCTURE A MINIMUM OF ONE (1) INCH BY MEANS OF A STAINLESS STEEL C-CHANNEL. C-CHANNEL SHALL BE SECURED TO BRIDGE PARAPET WITH 1/2" DIA. EXPANSION ANCHORS (MIN. 2" LONG). EXPANSION ANCHORS SHALL BE HOT DIPPED GALVANIZED AFTER FABRICATION AND SHALL BE MADE BY PARABOLT, KWICK-BOLT OR WEJ-IT. CONDUIT SHALL BE SECURED WITH APPROVED CLAMPS A MINIMUM OF 5 FEET ON CENTER AND A MINIMUM OF 2 FEET FROM ANY CHANGE IN DIRECTION OR JUNCTION BOX.
4. THE BARREL IN THE EXPANSION JOINT FITTING SHALL BE FULLY EMBEDDED IN THE CONCRETE ON ONE SIDE OF THE EXPANSION JOINT. ONE HALF THE LENGTH OF THE DEFLECTION FITTING SHALL BE EMBEDDED IN THE CONCRETE ON THE OTHER SIDE OF THE EXPANSION JOINT.
5. EXPANSION/DELFECTION JOINTS SHALL BE PROVIDED AT ALL BRIDGE EXPANSION JOINTS.
6. ALL CLAMPS AND HARDWARE FOR CONDUIT MOUNTING SHALL BE OF LIKE MATERIAL AS THE CONDUIT.
7. ALL EQUIPMENT SHALL BE GROUNDED AND BONDED IN ACCORDANCE WITH THE NATIONAL ELECTRICAL CODE AND THE NATIONAL ELECTRICAL SAFETY CODE.

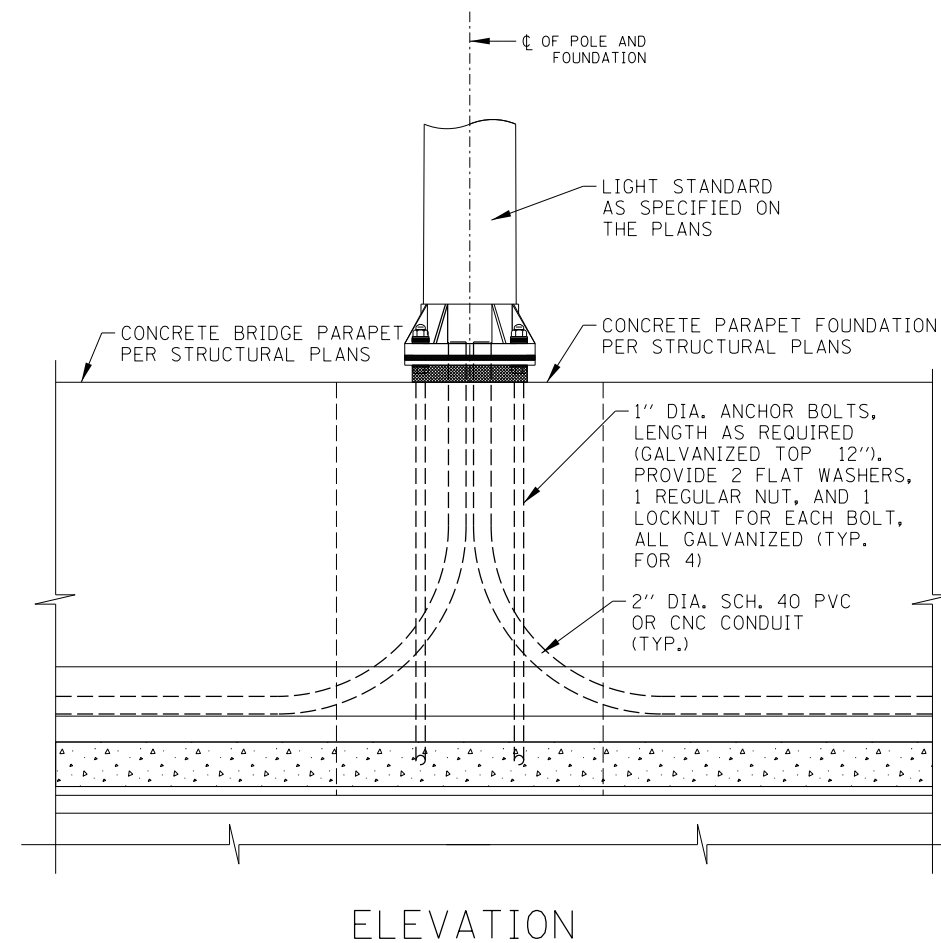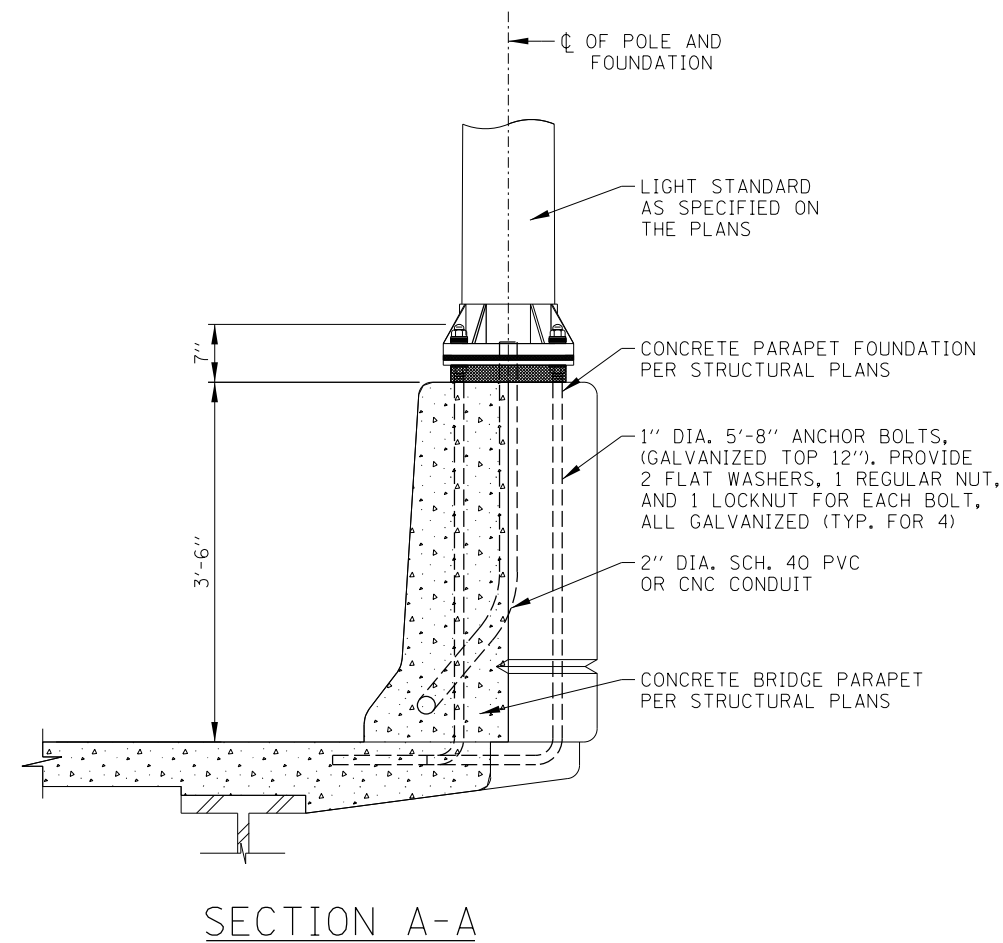

SHEET 1 OF 4




BRIDGE
CONDUIT DETAILS

STANDARD H3-03


DATE	REVISIONS
2-07-2012	REVISED NOTES
11-01-2012	REVISED JUNCTION BOX
3-11-2015	ADDED BRIDGE CONDUIT DETAILS

APPROVED: *Paul Kovacs*
CHIEF ENGINEER DATE 2-7-2012


CONDUIT EMBEDDED IN BRIDGE PARAPET

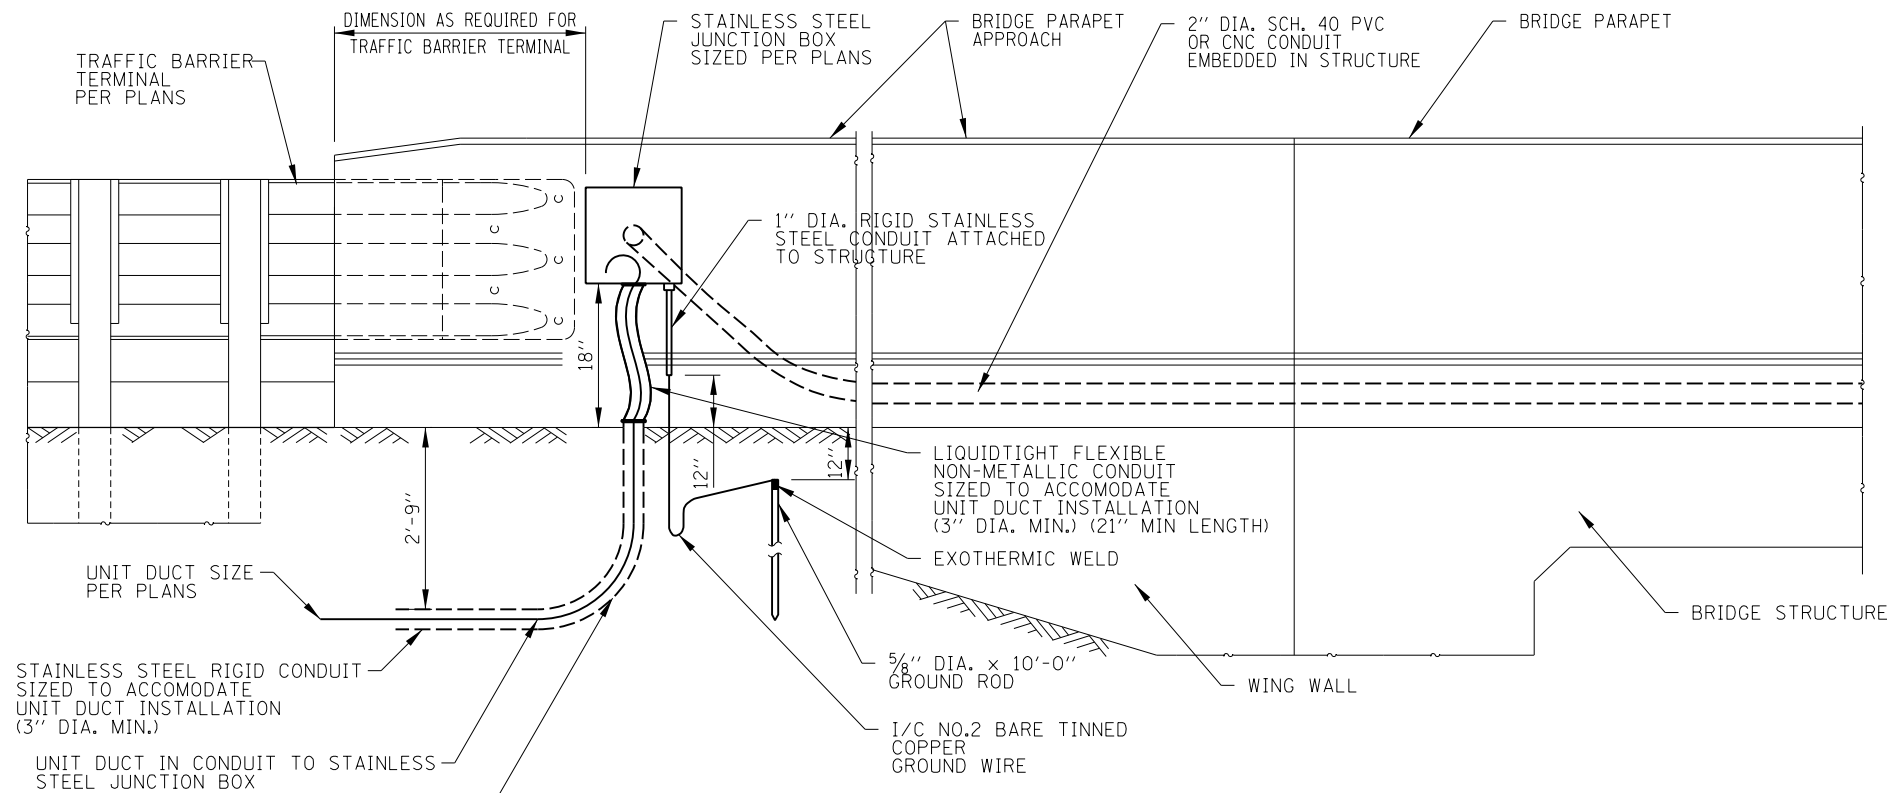

CONDUIT EMBEDDED IN BRIDGE PARAPET WALLS
(INTEGRAL/SEMI-INTEGRAL ABUTMENT WITH PARAPET ON APPROACH PAVEMENT)

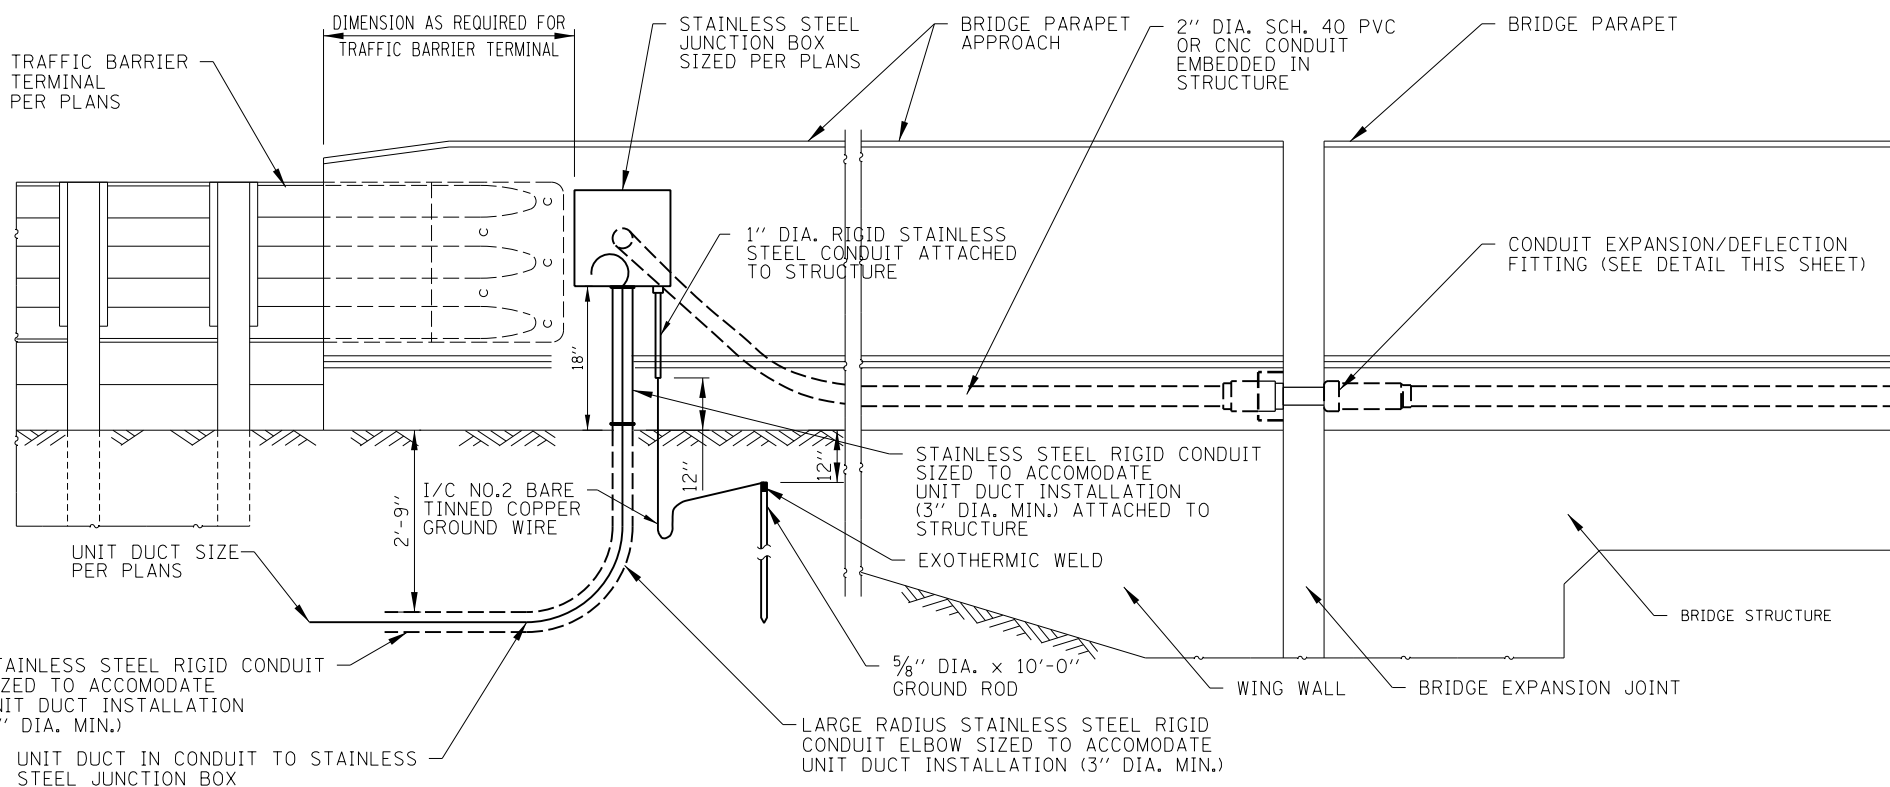


CONDUIT EMBEDDED IN BRIDGE PARAPET WALLS
(JOINTED ABUTMENT WITH PARAPET ON APPROACH PAVEMENT)

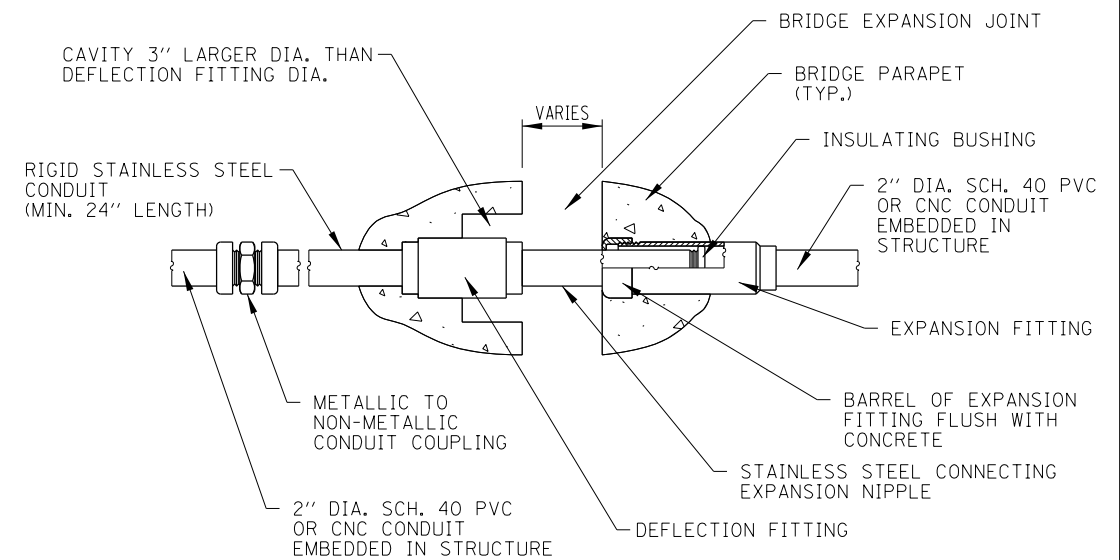


COMBINATION EXPANSION/ DEFLECTION FITTING
 (SEE NOTES 4 & 5)

Paul Kovacs
 APPROVED..... CHIEF ENGINEER..... DATE 2-7-2012


NOTE:
 SEE SHEET 1 OF THIS SERIES FOR NOTES.

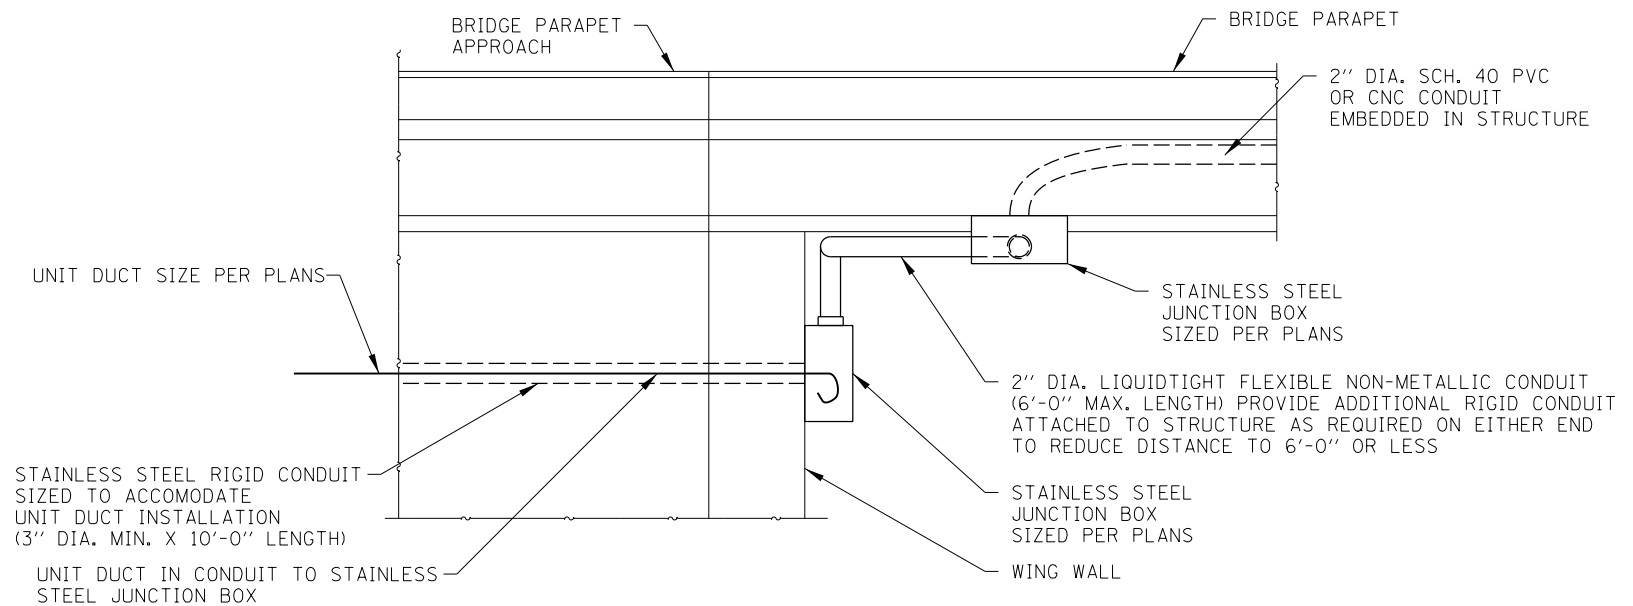

PLAN

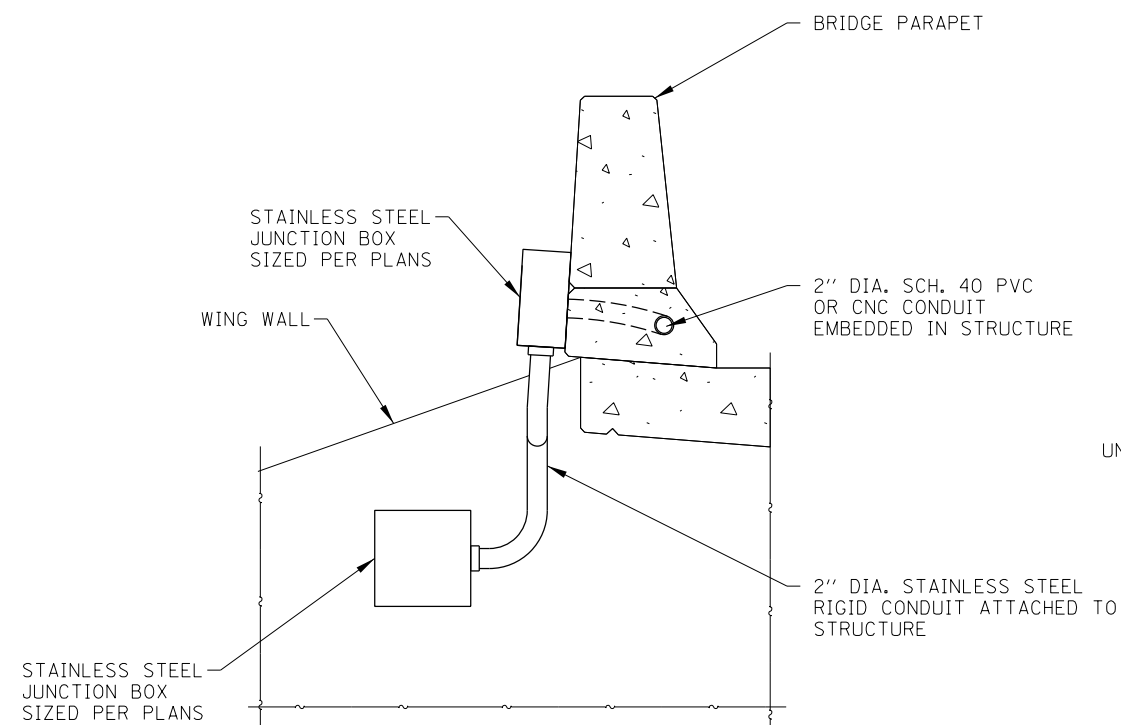

SECTION A-A

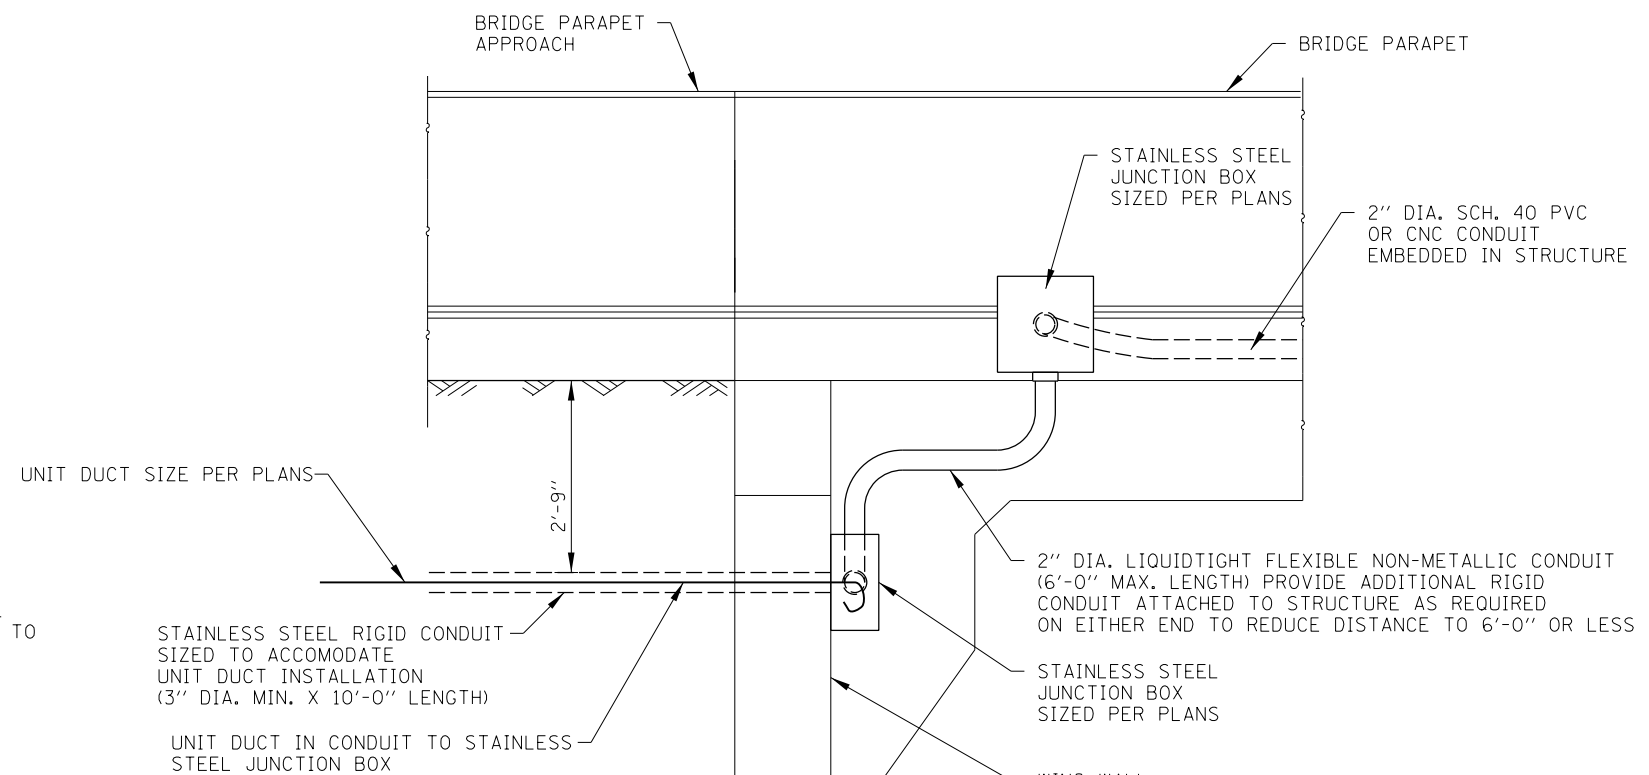

ELEVATION

NOTE:
SEE SHEET 1 OF THIS SERIES FOR NOTES.

SHEET 3 OF 4




BRIDGE
CONDUIT DETAILS


STANDARD H3-03

APPROVED: *Paul Kovacs*
CHIEF ENGINEER DATE: 2-7-2012


CONDUIT EMBEDDED IN BRIDGE PARAPET WALLS
(INTEGRAL/SEMI-INTEGRAL ABUTMENT WITH PARAPET ENDING ON BRIDGE DECK)

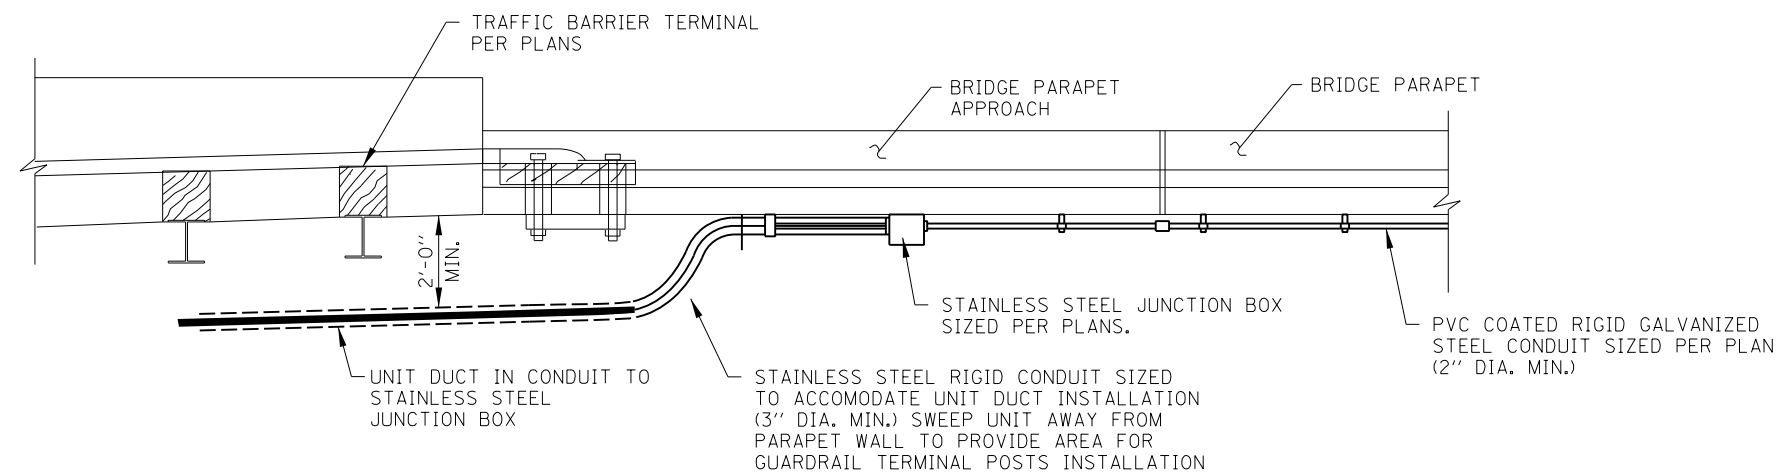

PLAN VIEW

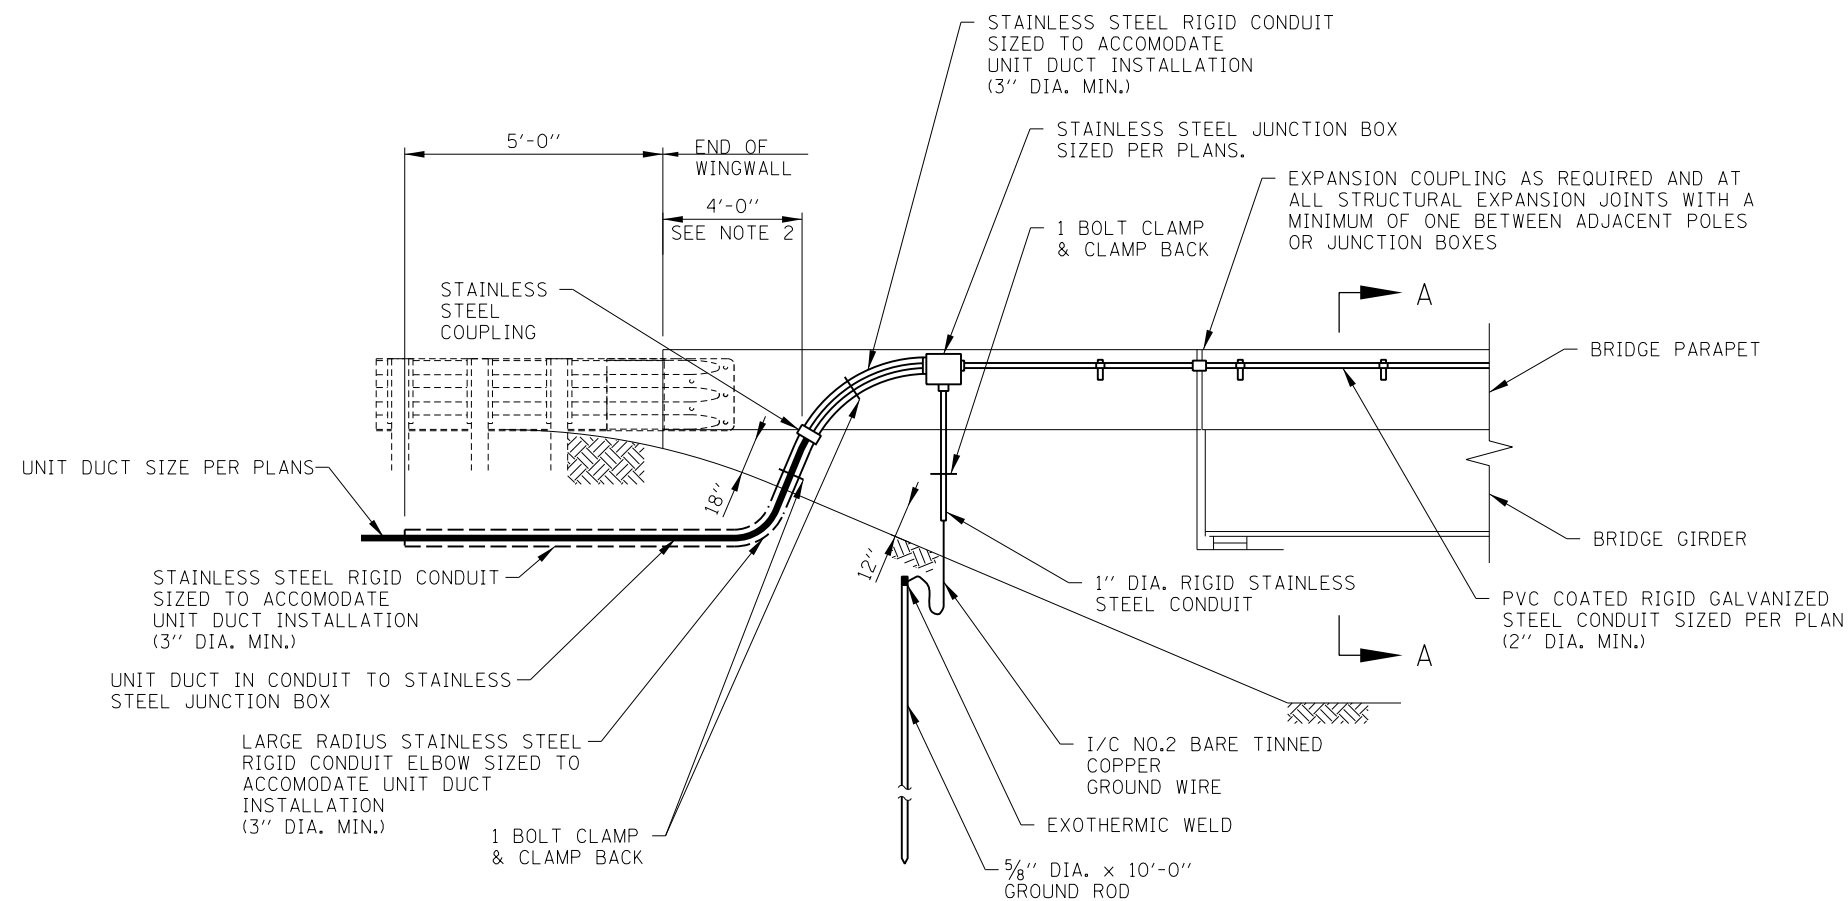

ELEVATION OF TYPICAL WINGWALL CONDUIT TRANSITION

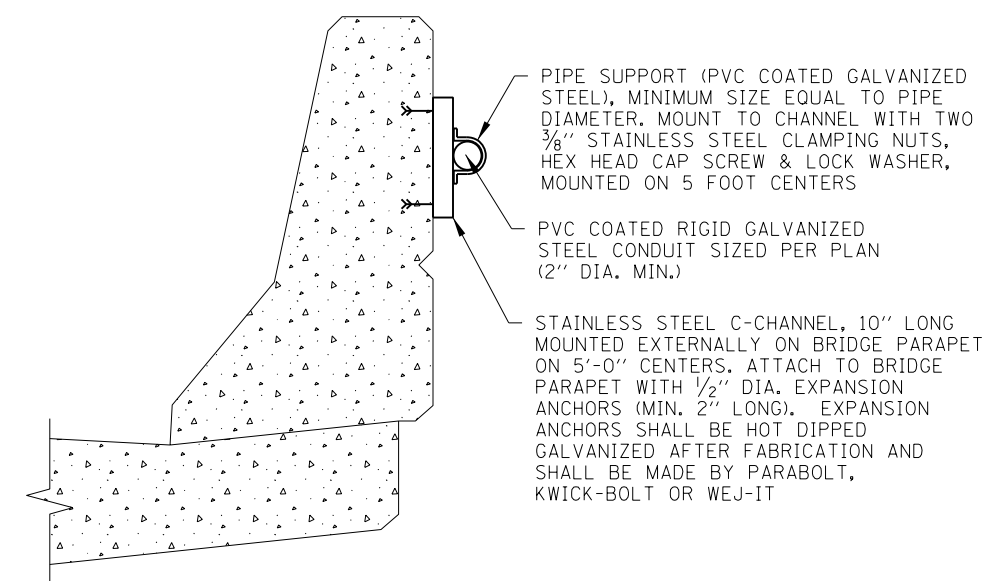


SECTION A-A


CONDUIT ATTACHED TO BRIDGE PARAPET

APPROVED: *Paul Kovacs* DATE: 2-7-2012
CHIEF ENGINEER


NOTE:
SEE SHEET 1 OF THIS SERIES FOR NOTES.

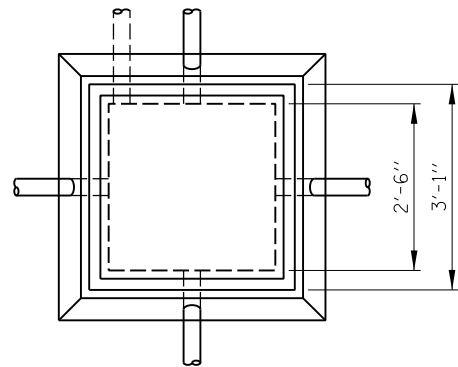

PLAN

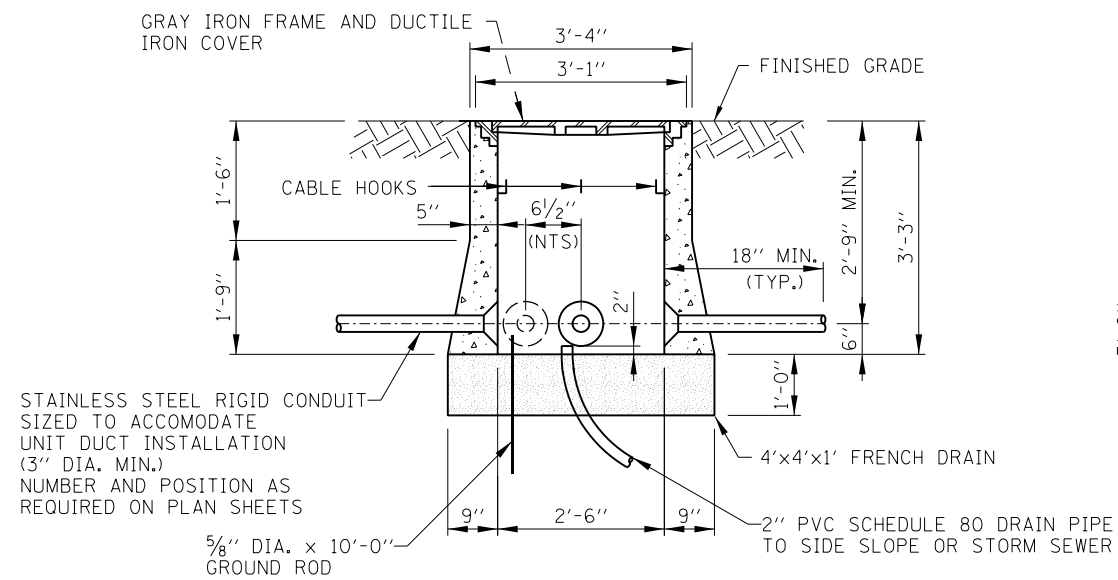

ELEVATION

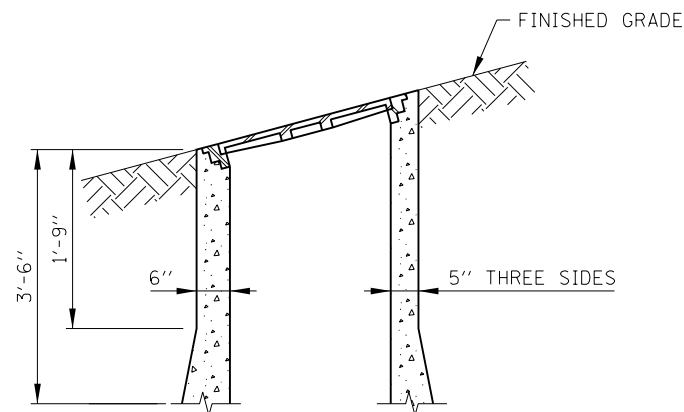


SLOPE INSTALLATION


HEAVY-DUTY HANDHOLE DETAILS

NOTES:

1. HEAVY-DUTY HANDHOLE LOCATED IN UNPAVED AREAS AND NOT SHIELDED BY GUARDRAIL SHALL BE CONSTRUCTED WITH THE TOP FLUSH WITH THE ADJACENT SLOPE.
2. HEAVY-DUTY HANDHOLE SHALL BE CONSTRUCTED IN NON-PAVED AREAS AND ITS FRAME AND COVER SHALL BE EITHER NEENAH FOUNDRY R-6662-PP WITH TYPE G LIFTING HANDLE OR EAST JORDAN IRON WORKS NO. 8213 WITH EPIC PICKBAR, OR APPROVED EQUAL.
3. AGGREGATE FOR FRENCH DRAIN SHALL BE PER ARTICLE 1003.04 OF THE STANDARD SPECIFICATIONS.
4. 10 FEET OF EXTRA CABLE SHALL BE COILED IN EACH HANDHOLE.
5. TRENCH AND BACKFILL FOR ELECTRICAL WORK SHALL BE INCLUDED IN THE COST OF THE UNDERGROUND RACEWAY AND WILL NOT BE MEASURED FOR PAYMENT.
6. ALL EQUIPMENT SHALL BE GROUNDED AND BONDED IN ACCORDANCE WITH THE NATIONAL ELECTRICAL CODE AND THE NATIONAL ELECTRICAL SAFETY CODE.

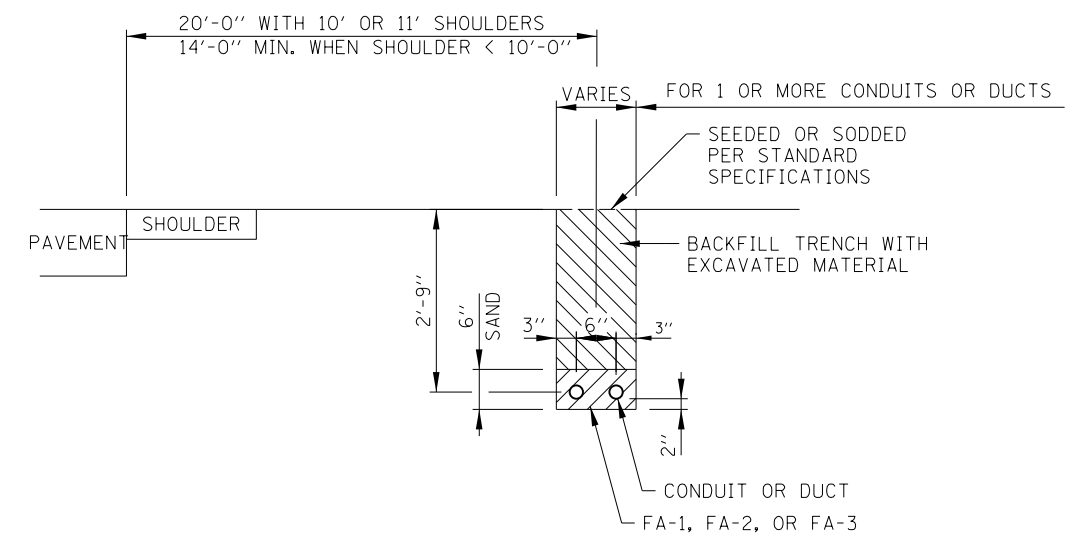

TRENCHING FOR CONDUIT IN NON-PAVED AREAS



 APPROVED..... CHIEF ENGINEER..... DATE 2-7-2012

DATE	REVISIONS
2-07-2012	MODIFY TRENCH DETAIL, NEW HANDHOLE. DETAILS AND REVISED NOTES.
3-11-2015	DELETED NON HEAVY-DUTY HANDHOLE.
7-7-2015	REVISED NOTE 2




HEAVY-DUTY HANDHOLE AND
BURIED WIRING DETAILS

STANDARD H4-03

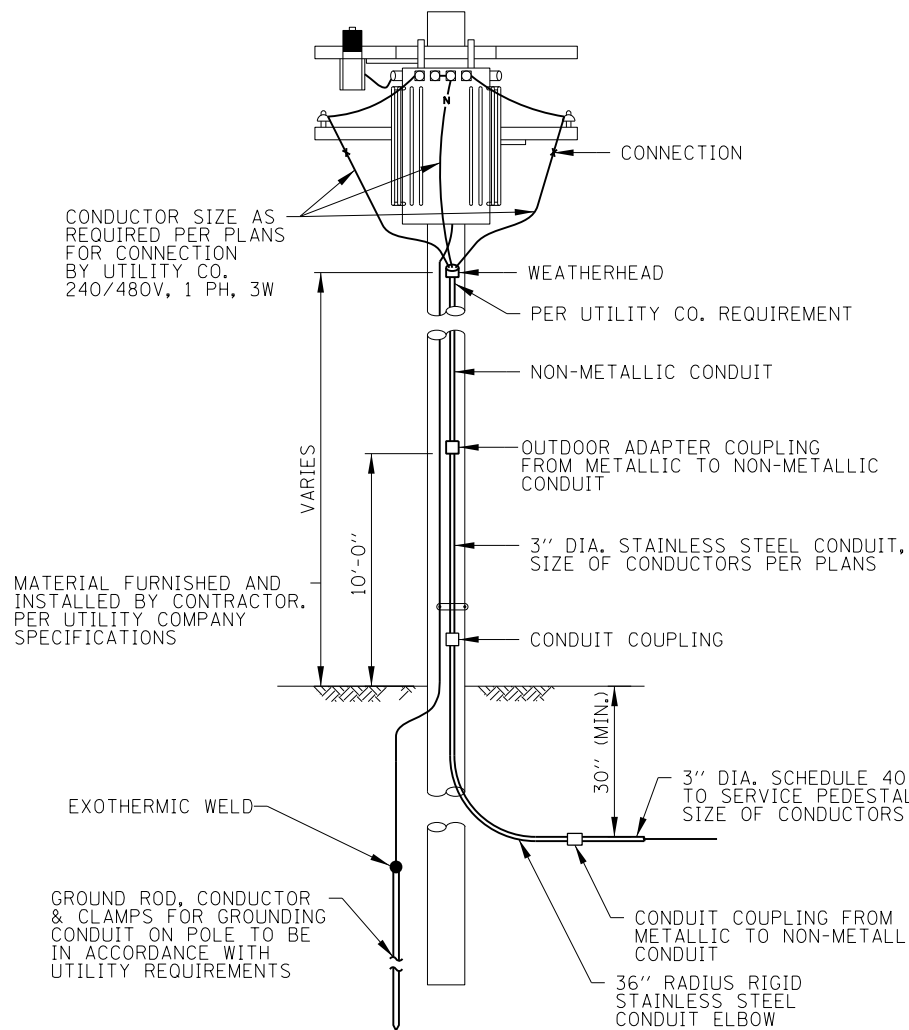


UTILITY SERVICE POLE

SUBJECT TO UTILITY COMPANY APPROVAL

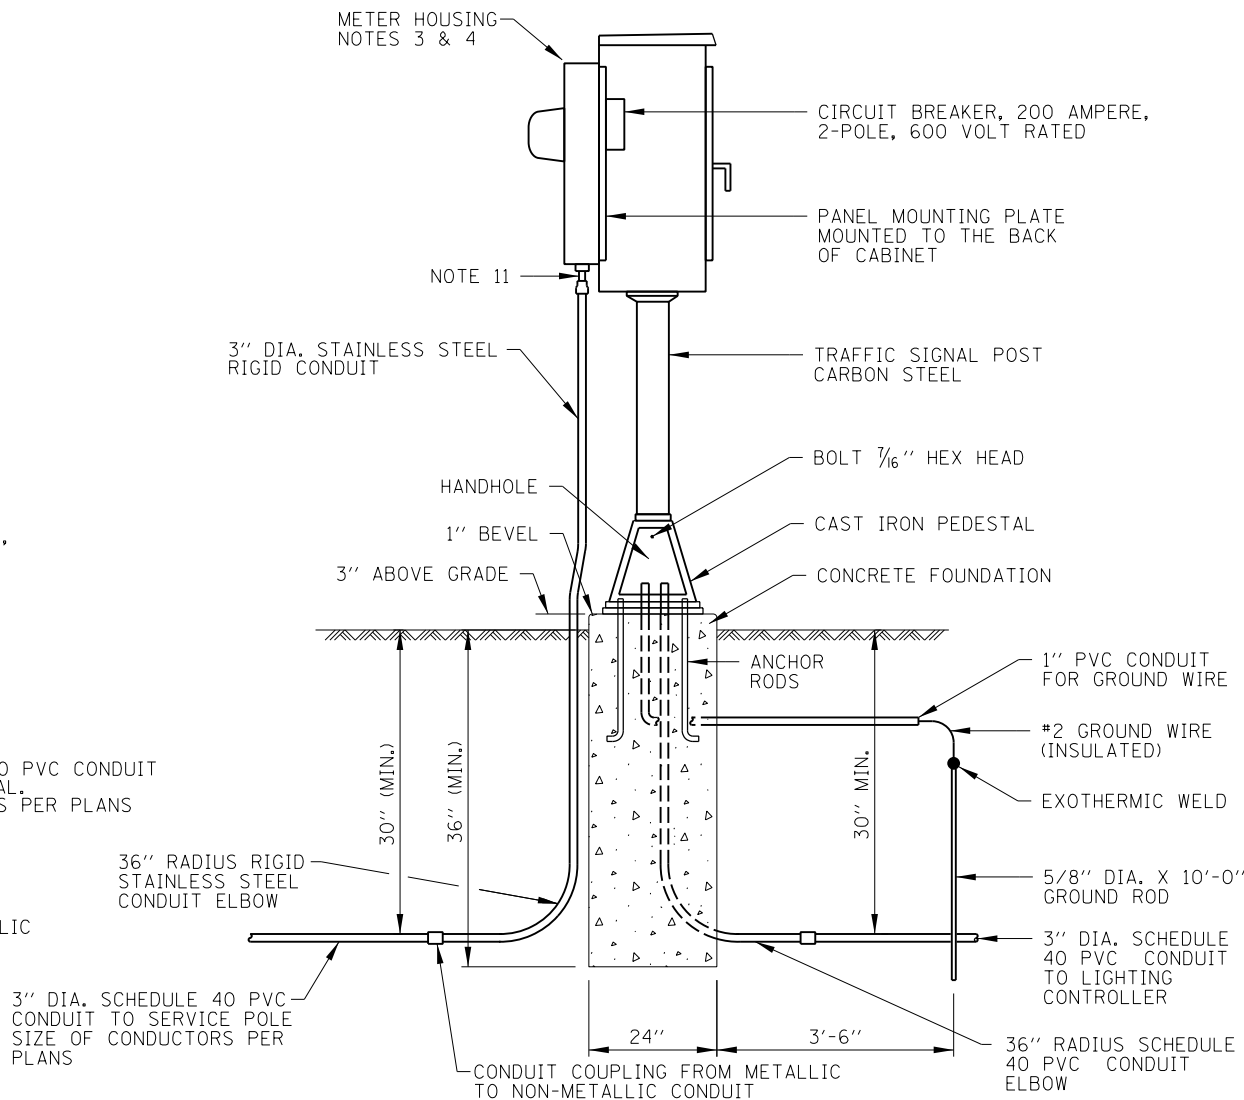

SERVICE PEDESTAL WITH METER DETAIL

(NOTE 9)

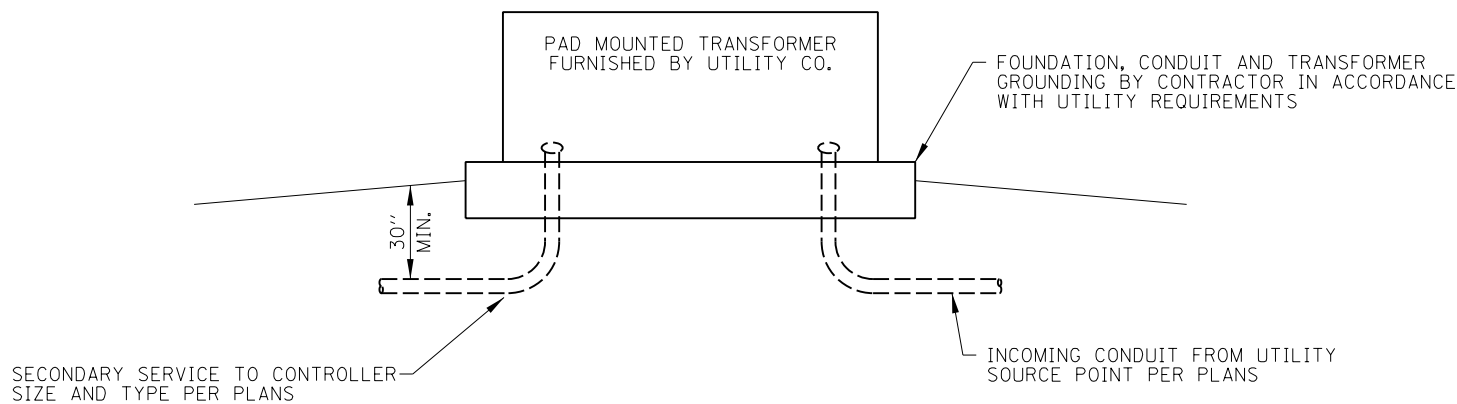

PAD MOUNTED TRANSFORMER

SUBJECT TO UTILITY COMPANY APPROVAL

NOTES:

- CABINETS, CABINET POSTS AND CABINET PEDESTALS SHALL BE PRIMED AND PAINTED. THE EXTERIOR SHALL HAVE TWO EPOXY FINISH COATS OF ANSI-61 GRAY. THE INTERIOR SHALL BE PAINTED WHITE.
- METER HOUSING SHALL BE MOUNTED TO BACK WALL OF CONTROL CABINET. PROVIDE A GATE IN ROW FENCE TO ALLOW UTILITY ACCESS TO READ THE METER.
- CABLES FROM METER HOUSING SHALL PASS THROUGH BACK WALL OF CONTROL CABINET.
- METER HOUSING SHALL BE MILBANK CATALOG NUMBER U8949.
- THE CABINET SHALL BE 36"H x 20"W x 15"D, FABRICATED FROM ALUMINUM WITH A MINIMUM THICKNESS OF .125", RATED NEMA TYPE 3R AND HAVE A MOUNTING BACK PLATE.
- THE CABINET DOOR SHALL HAVE A CONTINUOUS HINGE THAT IS BOLTED TO THE CABINET AND DOOR WITH 1/4-20 STAINLESS STEEL CARRIAGE BOLTS AND NY-LOCK NUTS. THE HINGE SHALL BE INSTALLED ON THE RIGHT SIDE WHEN FACING THE CABINET AND BE MADE OF STAINLESS STEEL WITH A 0.25 INCH DIAMETER STAINLESS STEEL HINGE PIN. THE HINGE PIN SHALL BE CAPPED TOP AND BOTTOM BY WELD TO RENDER IT TAMPER-PROOF. THE CABINET SHALL HAVE A GASKET THAT FORMS A WEATHER-TIGHT SEAL BETWEEN THE CABINET AND DOOR. THE DOOR LATCHING MECHANISM SHALL BE THE 3-POINT DRAW ROLLER TYPE. WHEN THE DOOR IS CLOSED AND LATCHED, IT WILL BE LOCKED. THE LATCHING HANDLE SHALL BE FABRICATED FROM A 0.75" STAINLESS STEEL ROUND BAR AND SHALL HAVE A PROVISION FOR PADLOCKING IN THE CLOSED POSITION.
- THE ENCLOSURE SHALL BE EQUIPPED WITH TWO ADJUSTABLE "C" MOUNTING CHANNELS WELDED ON BOTH SIDE WALLS AND BACK WALL OF THE ENCLOSURE, ALLOWING VERSATILE POSITIONING OF SHELVES OR PANELS. MOUNTING CHANNELS SHALL BE FACTORY PAINTED SAME COLOR AS INTERIOR OF CABINET.
- CABINET DOOR SHALL NOT HAVE COMPARTMENT DOORS OR LOUVERS.
- THE CABINET, POST, PEDESTAL BASE, METER HOUSING, FOUNDATION, GROUND ROD, GROUND WIRE AND GROUND CONNECTIONS SHALL BE INCLUDED IN THE COST OF EACH ELECTRIC SERVICE INSTALLATION.
- CONTRACTOR MUST COORDINATE WITH PEDESTAL BASE SUPPLIER AND FURNISH THE NECESSARY ANCHOR RODS.
- PROVIDE A 2 1/2" CONDUIT HUB, 2 1/2" NIPPLE AND 2 1/2" TO 3" CONDUIT REDUCER FITTING.
- ALL EQUIPMENT SHALL BE GROUNDED AND BONDED IN ACCORDANCE WITH THE NATIONAL ELECTRICAL CODE AND THE NATIONAL ELECTRICAL SAFETY CODE.


APPROVED: *Paul Kovacs* DATE 2-7-2012
CHIEF ENGINEER

DATE	REVISIONS
2-07-2012	NEW SERVICE PEDESTAL DETAIL, MODIFIED UTILITY SERVICE POLE.
3-11-2015	REVISED CONDUITS TO STAINLESS STEEL.




SERVICE POLE AND PEDESTAL DETAILS


STANDARD H5-02

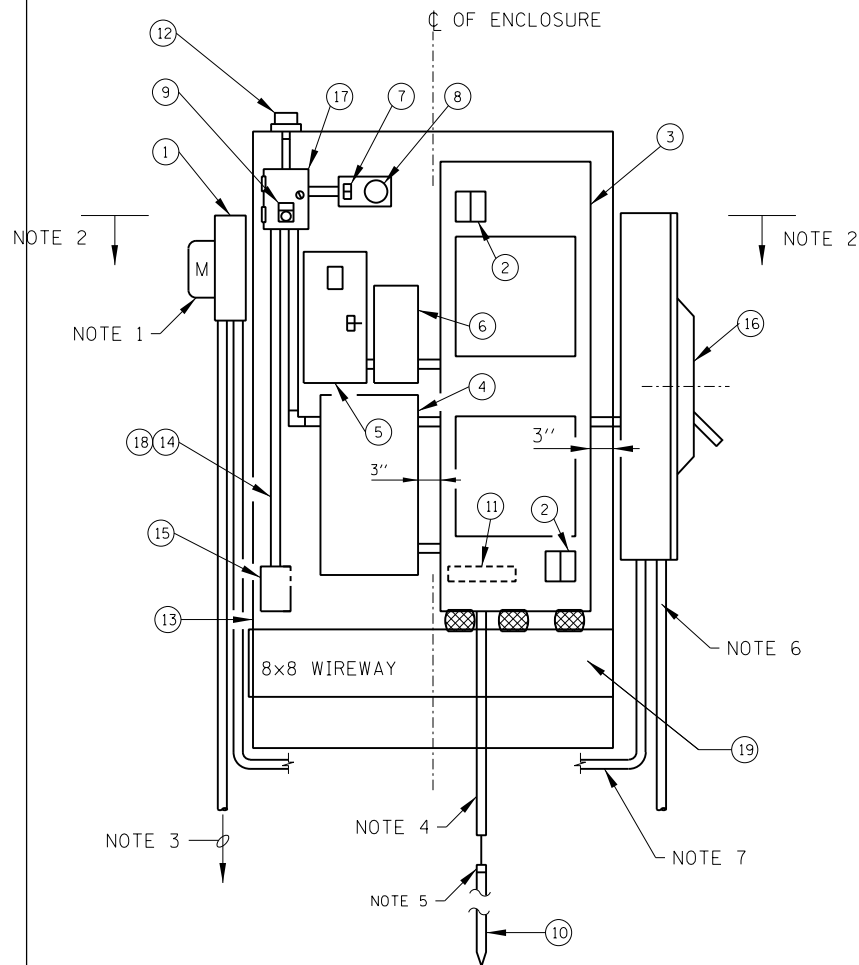


INTERIOR EQUIPMENT LAYOUT

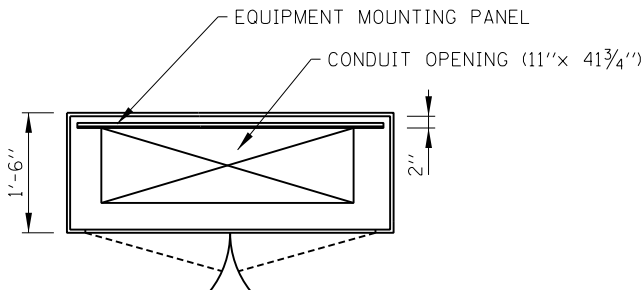

SECTION B-B

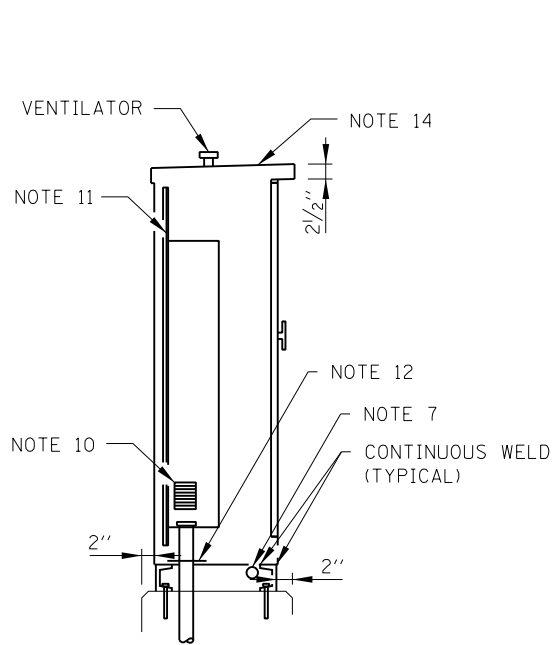

SECTION A-A

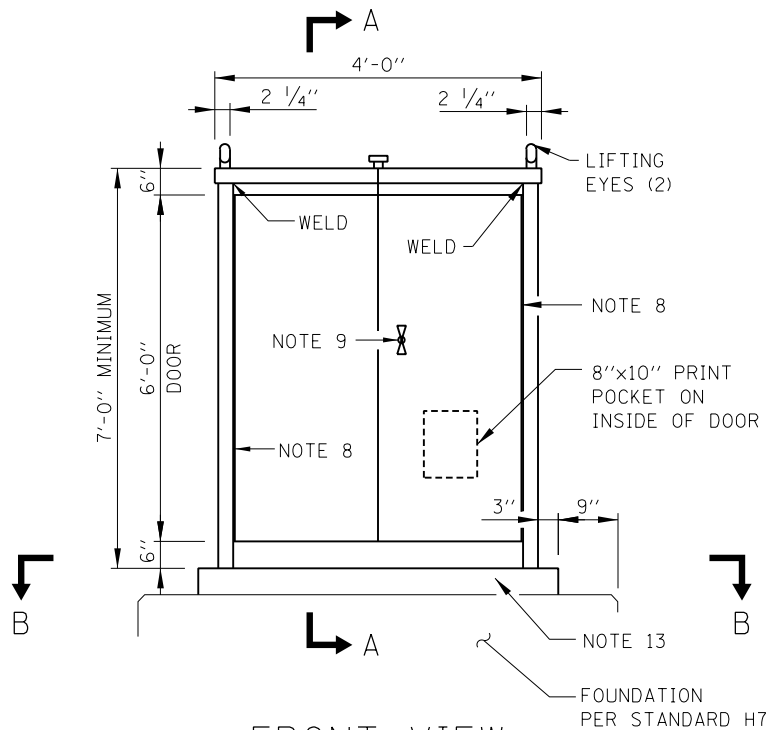

FRONT VIEW

CONTROL CONSOLE DETAILS
(EXTERIOR INSTALLATION)

NOTES:

1. PROVIDE METER HOUSING WHEN SERVICE PEDESTAL IS NOT PROVIDED.
2. 6'-0" MAXIMUM HEIGHT ABOVE GRADE.
3. STAINLESS STEEL CONDUIT TO UTILITY SERVICE AS INDICATED ON PLANS WHEN SERVICE PEDESTAL IS NOT PROVIDED.
4. 3/4" PVC CONDUIT IN CONCRETE, SEE FOUNDATION DETAILS (STANDARD H7).
5. EXOTHERMIC WELD NO. 2 BARE TINNED COPPER GROUND CABLE TO GROUND ROD.
6. TO SERVICE PEDESTAL AS INDICATED ON PLANS.
7. CONDUIT AND CABLE BETWEEN METER FITTING AND DISCONNECT SWITCH ROUTED BETWEEN CONTROL CONSOLE AND CONCRETE FOUNDATION, WHEN A METER HOUSING IS REQUIRED. CONDUIT AND CABLE SHALL BE THE SAME AS THE SERVICE.
8. CONTINUOUS STAINLESS STEEL PIANO HINGES.
9. 3-POINT LATCH VAULT TYPE HANDLE WITH MASTER KEYED CHICAGO CYLINDER LOCK CATALOG NO. 60
10. SCREENED LOUVERS ON SIDES OF CABINET.
11. 10 GAUGE GALVANIZED STEEL EQUIPMENT MOUNTING PANEL (PAINTED WHITE).
12. REMOVABLE #10 GAUGE 13"x43 3/4" STAINLESS STEEL PLATE. DRILL PLATE AS REQUIRED FOR CONDUIT ENTRY.
13. 4" x 2 1/2" STAINLESS STEEL CHANNEL (2 REQUIRED-FRONT AND BACK). EXTEND CHANNEL 3" BEYOND ENCLOSURE (CONTINUOUSLY WELD CHANNEL TO ENCLOSURE).
14. TOP SLOPED 1/2" TO REAR FOR DRAINAGE.
15. FOR WIRING DIAGRAM SEE SHEET 2 OF 4 IN THIS SERIES.
16. ALL EQUIPMENT SHALL BE GROUNDED AND BONDED IN ACCORDANCE WITH THE NATIONAL ELECTRICAL CODE AND THE NATIONAL ELECTRICAL SAFETY CODE.

ITEM DESCRIPTION:

- 1 METER HOUSING
- 2 SECONDARY SURGE ARRESTERS, 2 POLE, 650 VOLT.
- 3 MAIN PANELBOARD IN A NEMA 1 ENCLOSURE, 480/240 VOLT, 1 PHASE, 3 WIRE, 2 SECTION, 200 AMP, 2 POLE MAIN CIRCUIT BREAKER 65,000 AMPERES SYMMETRICAL INTERRUPTING CAPACITY WITH CIRCUIT BREAKERS PER SCHEDULE ON PLANS. DOOR HINGES ON RIGHT SIDE.
- 4 LIGHTING CONTACTOR, 480 VOLT, 200 AMP, 2 POLE, 120 VOLT CONTROL, WITH RELAY FOR 2 WIRE CONTROL, ONE NORMALLY OPEN AND ONE NORMALLY CLOSED AUXILIARY CONTACTS, CONTROL LINE FUSE, IN A NEMA 1 ENCLOSURE.
- 5 SECONDARY BREAKER, 15 AMPERE TRIP, 120 VOLT, SINGLE POLE, 65,000 AMPERES SYMMETRICAL INTERRUPTING CAPACITY IN A NEMA 1 SURFACE MOUNTED ENCLOSURE.
- 6 STEP DOWN TRANSFORMER, 1500 VA, 480 VOLT PRIMARY, 120 VOLT SECONDARY, SINGLE PHASE, 60 HERTZ, DRY TYPE, NEMA 3R ENCLOSURE.
- 7 SINGLE POLE, 15 AMPERE SWITCH, IN A NEMA 1 ENCLOSURE (WITH ITEM 8), RATED AT 120-277 VAC.
- 8 LAMP HOLDER 660W, 600V, MOUNTED ON A NEMA 1 ENCLOSURE (WITH ITEM 7), W/LED LAMP.
- 9 HAND-OFF-AUTO SELECTOR SWITCH WITH LEGEND PLATE. MOUNTED IN THE COVER OF ITEM 17.
- 10 5/8" DIA. x 10'-0" LONG GROUND ROD DRIVEN EXTERNAL TO THE FOUNDATION WITHIN GROUND WELL.
- 11 GROUND BUS MOUNTED IN PANELBOARD ENCLOSURE.
- 12 PHOTO ELECTRIC CONTROL SWITCH,WITH RECEPTACLE.
- 13 NEMA TYPE 3R STAINLESS STEEL ENCLOSURE WITH DRIP SHIELD AND STAINLESS STEEL HARDWARE. ENCLOSURE SHALL CONFORM TO J.I.C. STANDARDS WITH CELLULAR NEOPRENE GASKETED DOORS, ALL SEAMS CONTINUOUSLY WELDED, 10 GAUGE STAINLESS STEEL BODY, REMOVABLE STEEL PAINTED WHITE) PANEL INSIDE THE BACK AND A FACTORY INSTALLED DRIP SHIELD. THE ENCLOSURE SHALL HAVE CONTINUOUS HINGED DOORS MEETING IN THE CENTER, OVERLAPPED AND GASKETED, WITH NO CENTERPOST. AN OIL TIGHT KEY LOCKING HANDLE WITH 3 POINT LATCH SHALL BE PROVIDED (FURNISH 6 KEYS). EACH END OF THE ENCLOSURE SHALL HAVE A SCREENED, GASKETED VENTILATING LOUVER AND THE TOP OF THE ENCLOSURE SHALL HAVE A VENTILATOR. INTERNAL CONDUIT SHALL HAVE LOCKNUTS, INSULATING BUSHING AND CONDULET FITTINGS AS REQUIRED. INTERNAL WIRING SHALL BE XLP INSULATED NEC TYPE RHH/RHW-2. PROVIDE A WIRING DIAGRAM IN A PRINT POCKET ON THE INSIDE OF THE CABINET DOOR.
- 14 INTERNAL CONTROL WIRING SHALL BE #12 AWG, STRANDED, XLP INSULATED NEC TYPE RHH/RHW-2 RATED 600 VOLT, WITH SUITABLE COLOR CODING TO BE APPROVED BY THE ENGINEER BEFORE CONSTRUCTION.
- 15 200 WATT, 120 VOLT CABINET HEATER WITH INTEGRAL THERMOSTAT.
- 16 SERVICE SAFETY SWITCH, 200 AMP, 600 VOLT, NON-FUSED, NEMA 4X STAINLESS STEEL ENCLOSURE.
- 17 NEMA TYPE 1, 8"x6"x4" JUNCTION BOX & COVER WITHOUT KNOCKOUTS. ITEM 9 IS MOUNTED IN THE COVER.
- 18 INTERNAL CONDUIT AND FITTINGS SHALL BE 3/4" MINIMUM.
- 19 8"x8" WIREWAY WITH 3-3" NIPPLES.

SHEET 1 OF 2



EXTERIOR
CONTROL CONSOLE
DETAILS

STANDARD H6-03


DATE	REVISIONS
2-07-2012	MODIFY ENCLOSURE DIMENSIONS, REVISED NOTES AND ITEM DESCRIPTIONS.
3-31-2014	REVISED NOTES AND ITEM DESCRIPTIONS.
3-11-2015	REVISED CONDUITS TO STAINLESS STEEL.

APPROVED.....
CHIEF ENGINEER

DATE 2-7-2012

NOTES:




1. TO UTILITY SERVICE, 480/240V, 1 PHASE, 3 WIRE, GROUNDED, WHEN A METER HOUSING IS REQUIRED (FED FROM PAD MOUNTED UTILITY TRANSFORMER WITHIN TOLLWAY RIGHT-OF-WAY).
2. TO SERVICE PEDESTAL, 480/240V, 1 PHASE, 3 WIRE, GROUNDED. SEE STANDARD H5.
3. ITEM NUMBERS REFER TO EQUIPMENT LIST ON SHEET 1 OF THIS SERIES.
4. PROVIDE CIRCUIT BREAKERS PER SCHEDULE ON THE CONTRACT PLANS (MINIMUM OF 12).
5. FOR INTERIOR EQUIPMENT LAYOUT SEE SHEET 1 OF THIS SERIES.
6. ALL EQUIPMENT SHALL BE GROUNDED AND BONDED IN ACCORDANCE WITH THE NATIONAL ELECTRICAL CODE AND THE NATIONAL ELECTRICAL SAFETY CODE.

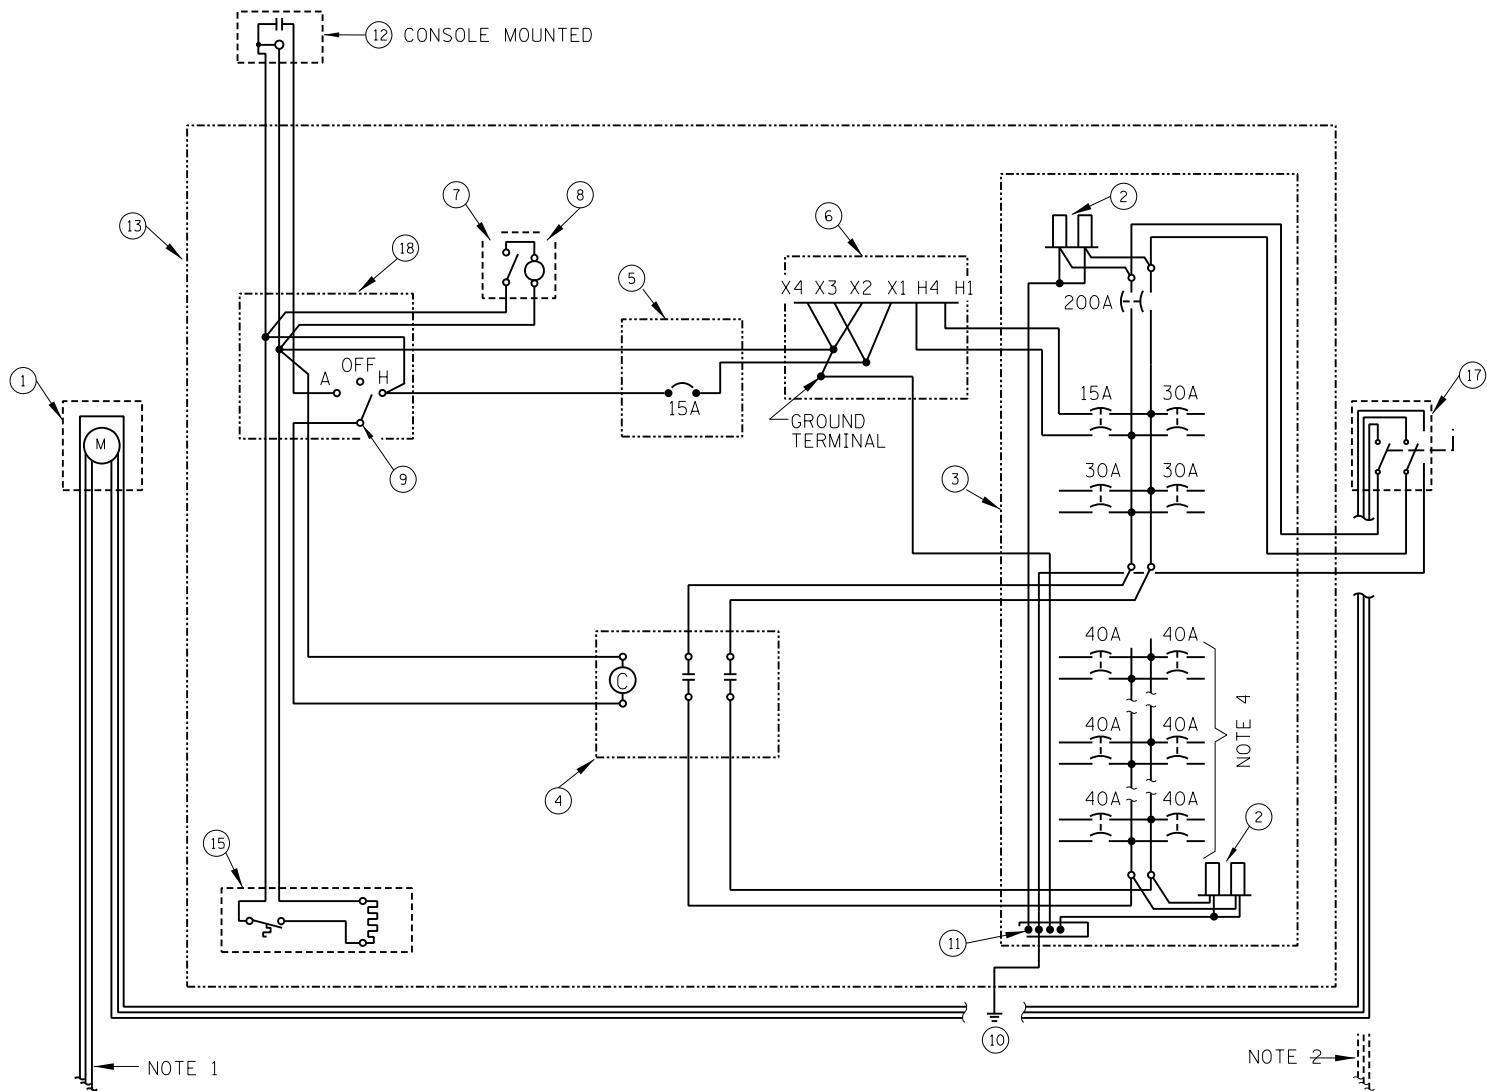


CONTROL CONSOLE WIRING DIAGRAM

CONTROL CONSOLE DETAILS
(EXTERIOR INSTALLATION)

APPROVED: *Paul Kovacs* CHIEF ENGINEER DATE: 2-7-2012

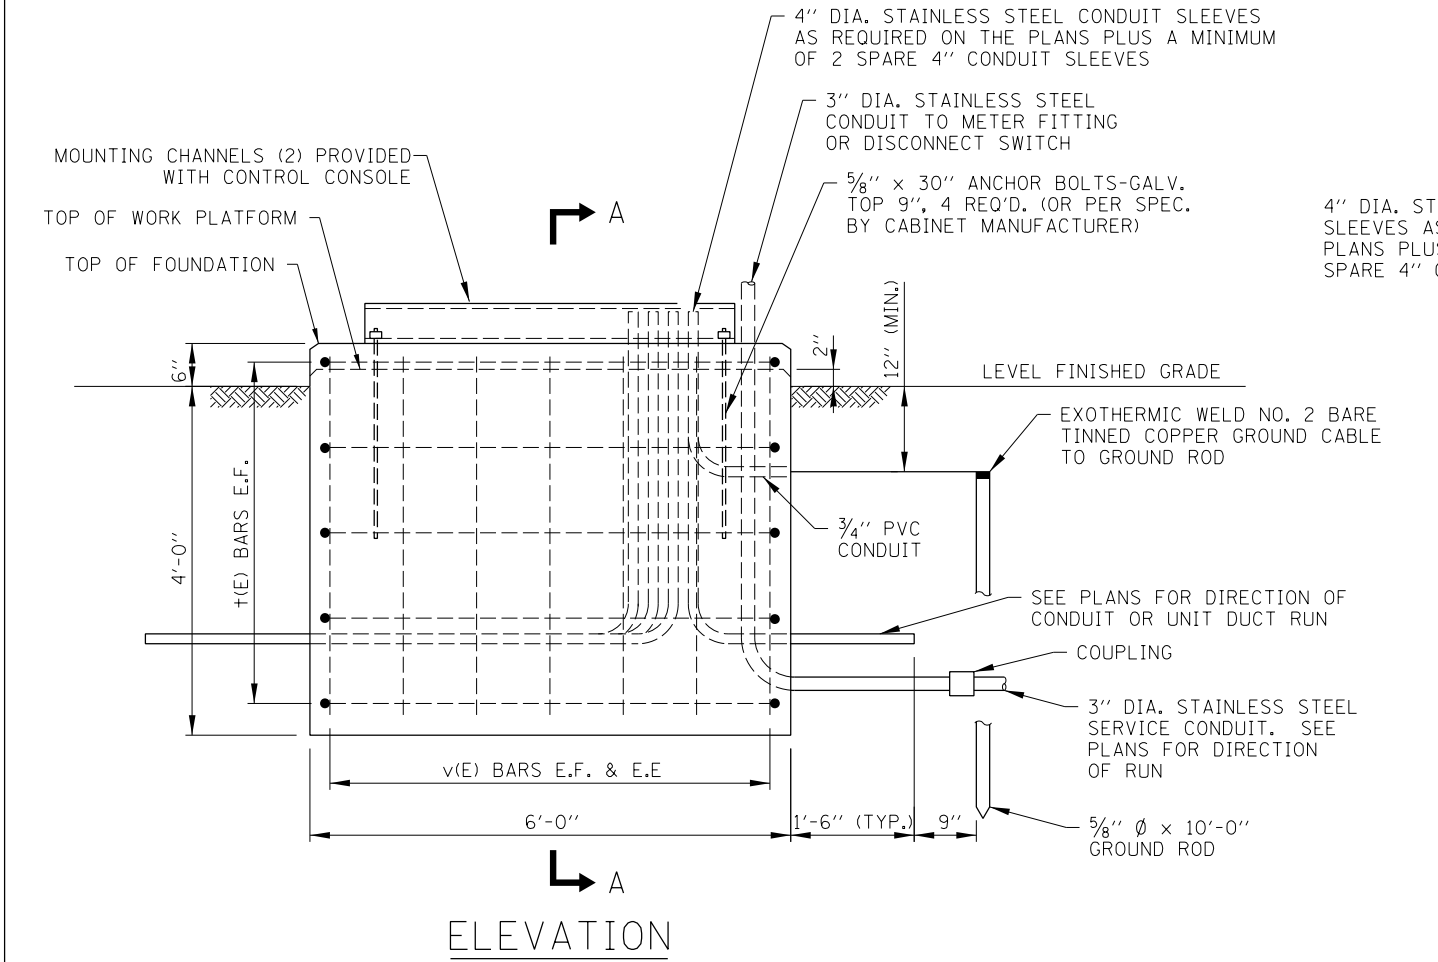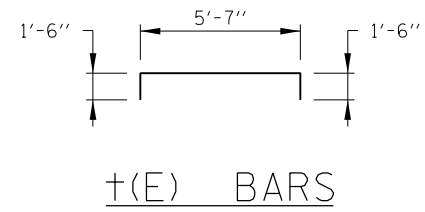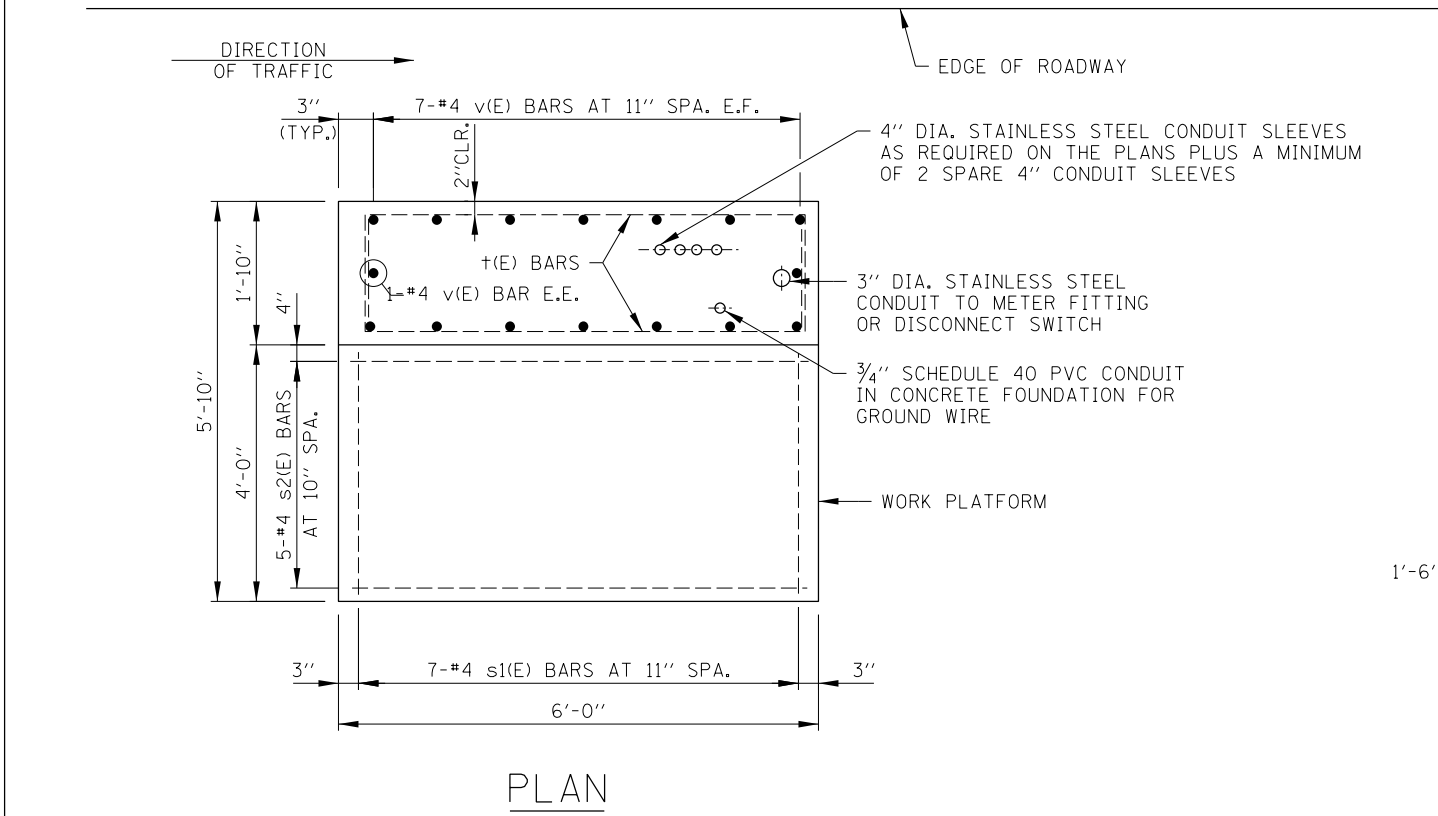

4" DIA. STAINLESS STEEL CONDUIT SLEEVES AS REQUIRED ON THE PLANS PLUS A MINIMUM OF 2 SPARE 4" CONDUIT SLEEVES

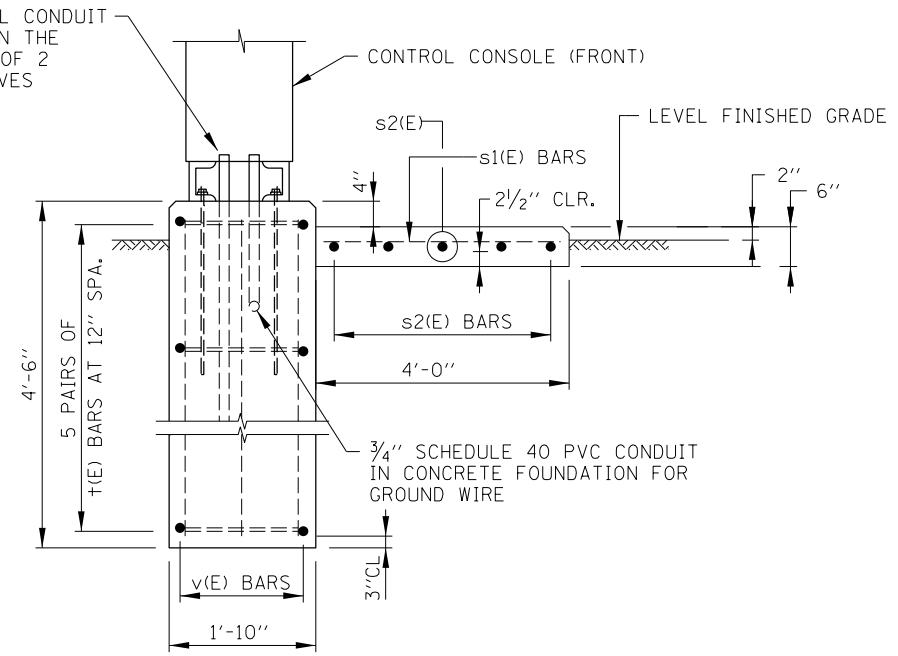

NOTES:

1. EXPOSED CONCRETE EDGES SHALL HAVE 3/4"x45° CHAMFERS EXCEPT WHERE SHOWN OTHERWISE. CHAMFERS ON VERTICAL EDGES SHALL BE CONTINUED A MINIMUM OF ONE FOOT BELOW FINISHED GROUND LEVEL.
2. ALL REINFORCEMENT BARS SHALL BE EPOXY COATED (E) AND SHALL CONFORM TO THE REQUIREMENTS OF AASHTO M-31 (ASTM A615), GRADE 60 DEFORMED BARS.
3. REINFORCEMENT BENDING DETAILS SHALL BE IN ACCORDANCE WITH THE "MANUAL OF STANDARD PRACTICE FOR DETAILING REINFORCED CONCRETE STRUCTURES", ACI 315, LATEST EDITION.
4. REINFORCEMENT BAR BENDING DIMENSIONS ARE OUT TO OUT.
5. COVER FROM THE FACE OF CONCRETE TO FACE OF REINFORCEMENT BARS SHALL BE 3" FOR ALL SURFACES UNLESS OTHERWISE SHOWN.
6. FOR CLARITY, CONTROL CONSOLE AND RAILINGS ARE NOT SHOWN IN PLAN VIEW.
7. ALL EQUIPMENT SHALL BE GROUNDED AND BONDED IN ACCORDANCE WITH THE NATIONAL ELECTRICAL CODE AND THE NATIONAL ELECTRICAL SAFETY CODE.

REINFORCEMENT BARS SCHEDULE					
BARS	NO.	SIZE	LENGTH	WT. LB.	SHAPE
v(E)	16	#4	4'-0"	43	—
t(E)	10	#4	8'-7"	57	┌
s1(E)	7	#4	3'-8"	17	—
s2(E)	5	#4	5'-8"	19	—

BILL OF MATERIAL		
DESCRIPTION	UNIT	QUANTITY
REINF. BARS, EPOXY COATED	POUND	136
CLASS "SI" CONCRETE	CU. YD.	2.3

APPROVED *Paul Kovacs* DATE 2-7-2012
CHIEF ENGINEER


TYPE A CONTROL CONSOLE FOUNDATION


DATE	REVISIONS
2-07-2012	REVISED TYPE A AND TYPE B CONTROL CONSOLE FOUNDATIONS.
3-11-2015	REVISED CONDUITS TO STAINLESS STEEL.

ILLINOIS
Tollway


EXTERIOR CONTROL CONSOLE FOUNDATION DETAILS

STANDARD H7-02

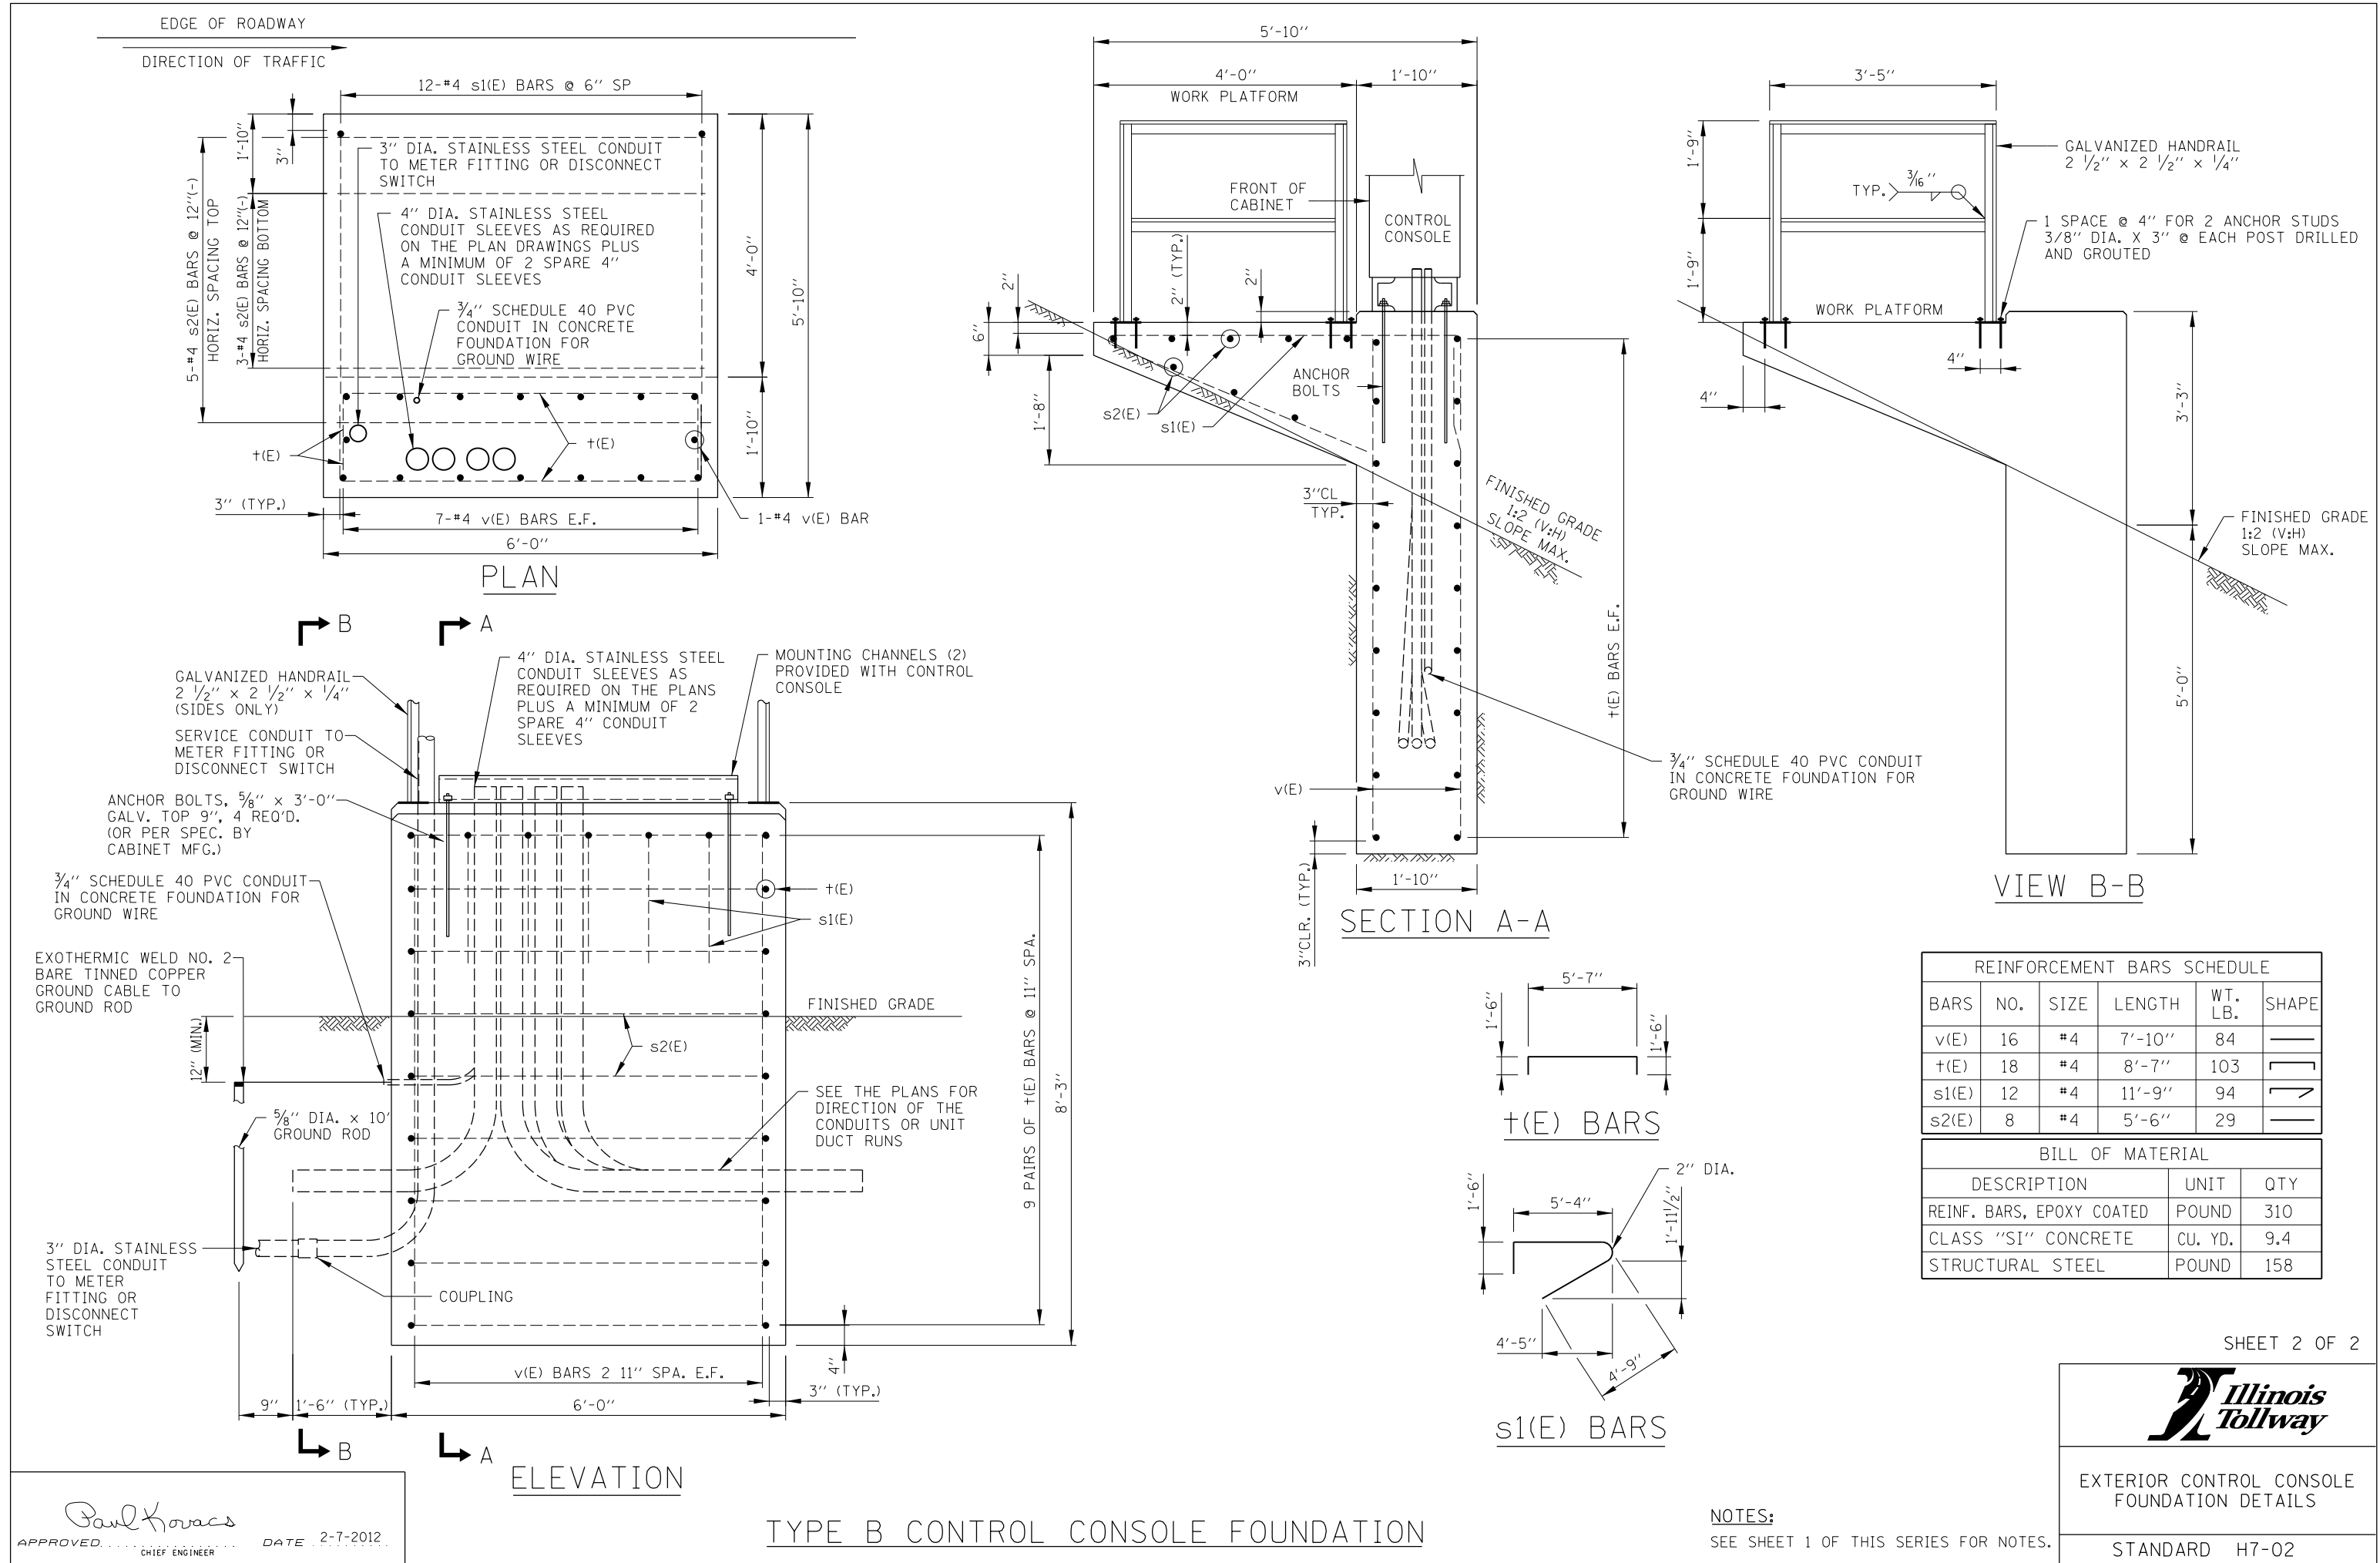

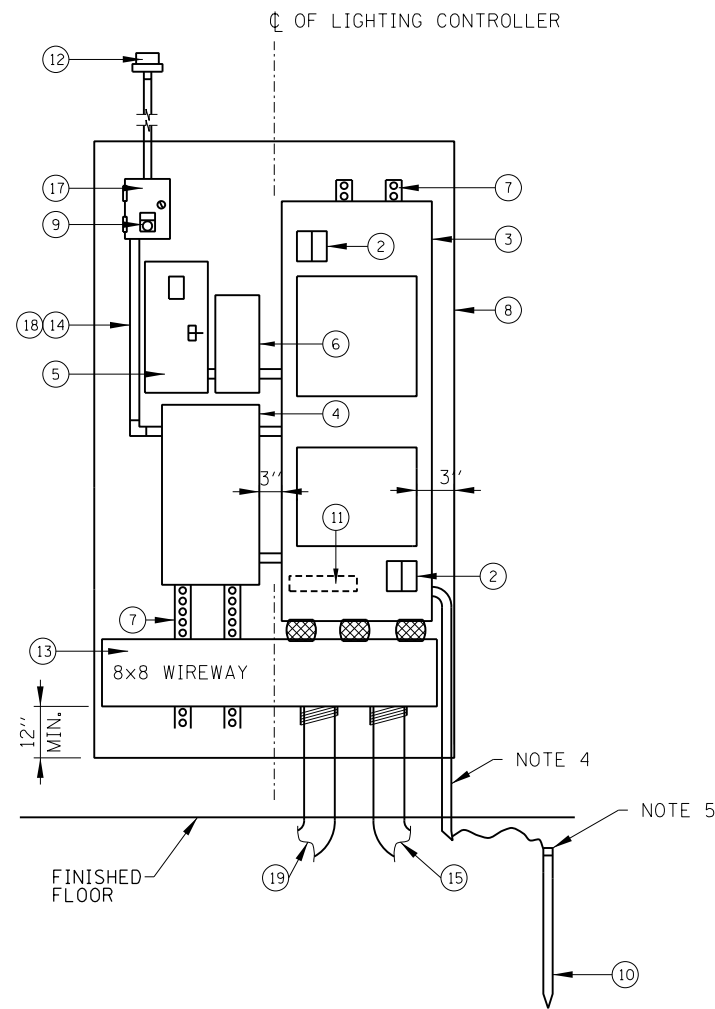

INTERIOR EQUIPMENT LAYOUT

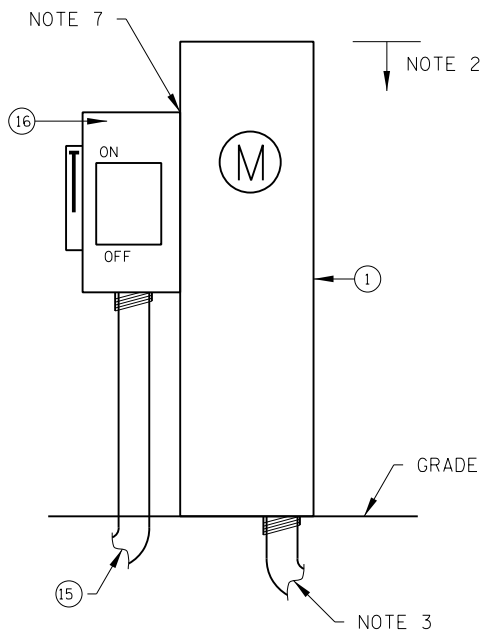

SERVICE ENTRANCE DETAIL

NOTES:

1. PROVIDE POWER UTILITY CO. METER HOUSING AS INDICATED ON PLANS.
2. 6'-0" MAXIMUM HEIGHT ABOVE GRADE.
3. STAINLESS STEEL CONDUIT TO UTILITY SERVICE AS INDICATED ON PLANS.
4. 3/4" PVC CONDUIT.
5. EXOTHERMIC WELD NO. 2 BARE TINNED COPPER GROUND CABLE TO GROUND ROD 12"-24" BELOW GRADE.
6. TO POWER UTILITY COMPANY, SERVICE AS INDICATED ON PLANS.
7. CONDUIT AND CABLE BETWEEN METER FITTING AND DISCONNECT SWITCH. CONDUIT AND CABLE SHALL BE THE SAME AS THE SERVICE.
8. LABEL ALL EQUIPMENT AS "ROADWAY LIGHTING" + DEVICE AND BUILDING* (IF APPLICABLE).
9. FOR WIRING DIAGRAM SEE SHEET 4 OF 4 IN THIS SERIES.
10. ALL EQUIPMENT SHALL BE GROUNDED AND BONDED IN ACCORDANCE WITH THE NATIONAL ELECTRICAL CODE AND THE NATIONAL ELECTRICAL SAFETY CODE.

ITEM

DESCRIPTION

- 1 METER HOUSING, MILBANK U8436-0.
- 2 SECONDARY SURGE ARRESTERS, 2 POLE, 650 VOLT. (JOSLYN Z2-650-0)
- 3 MAIN PANELBOARD, 480/240 VOLT, 1 PHASE, 3 WIRE, 2 SECTION, 200 AMP, 2 POLE MAIN CIRCUIT BREAKER 65,000 AMPERES SYMMETRICAL INTERRUPTING CAPACITY. EATON PANELBOARD TYPE POW-R-LINE 3a IN A NEMA 1 ENCLOSURE, WITH CIRCUIT BREAKERS PER SCHEDULE ON PLANS. DOOR HINGES ON RIGHT SIDE.
- 4 LIGHTING CONTACTOR, 480 VOLT, 200 AMP, 2 POLE, 120 VOLT CONTROL, WITH RELAY FOR 2 WIRE CONTROL, (MAGNECRAFT W389ACX-9) ONE NORMALLY OPEN AND ONE NORMALLY CLOSED AUXILIARY CONTACTS, CONTROL LINE FUSE, IN A NEMA 1 ENCLOSURE, SQUARE-D CLASS 8903, TYPE PB.
- 5 SECONDARY BREAKER, 15 AMPERE TRIP, 120 VOLT, SINGLE POLE, 65,000 AMPERES SYMMETRICAL INTERRUPTING CAPACITY IN A NEMA 1 SURFACE MOUNTED ENCLOSURE.
- 6 STEP DOWN TRANSFORMER, 1500 VA, 480 VOLT PRIMARY, 120 VOLT SECONDARY, SINGLE PHASE, 60 HERTZ, DRY TYPE, NEMA 3R ENCLOSURE. (JEFFERSON 411-0081-000)
- 7 1 1/4" X 3/4" C-CHANNEL (UNISTRUT) FOR ALL EQUIPMENT STANDOFF
- 8 1/2" EQUIPMENT MOUNTING PANEL (4' W X 7' H)
- 9 HAND-OFF-AUTO SELECTOR SWITCH WITH LEGEND PLATE. MOUNTED IN THE COVER OF ITEM 17. (SQ D 9001KS43BH13)
- 10 ROUTED TO BUILDING GROUND SYSTEM. IF NO GROUND AVAILABLE CONTRACTOR SHALL PROVIDE 5/8" DIA. X 10'-0" LONG GROUND ROD WITHIN GROUND WELL.
- 11 GROUND BUS MOUNTED IN PANELBOARD ENCLOSURE.
- 12 PHOTO ELECTRIC CONTROL SWITCH, (TORK 2100 SERIES) MOUNTED ON SOUTH EXTERIOR SIDE OF BUILDING (VIEW UNOBSTRUCTED)
- 13 8"x8" WIREWAY WITH 3-3" NIPPLES.
- 14 INTERNAL CONTROL WIRING SHALL BE #12 AWG, STRANDED, INSULATED NEC TYPE THWN/THHN RATED 600 VOLT, WITH SUITABLE COLOR CODING TO BE APPROVED BY THE ENGINEER BEFORE CONSTRUCTION.
- 15 2" STAINLESS STEEL CONDUIT FROM SERVICE SAFETY SWITCH TO LIGHTING CONTROLLER WIREWAY.
- 16 SERVICE SAFETY SWITCH, 200 AMP, 600 VOLT, NON-FUSED, NEMA 4X STAINLESS STEEL ENCLOSURE.
- 17 NEMA TYPE 1, 8"x6"x4" JUNCTION BOX & COVER WITHOUT KNOCKOUTS. ITEM 9 IS MOUNTED IN THE COVER.
- 18 INTERNAL CONDUIT AND FITTINGS SHALL BE 3/4" MINIMUM.
- 19 (2) 4" STAINLESS STEEL CONDUIT TO LIGHTING CONTROLLER HANDHOLE. REFER TO SITE PLAN FOR LOCATION.



INTERIOR
CONTROL CONSOLE
DETAILS

STANDARD H8-00


DATE	REVISIONS

CONTROL CONSOLE DETAILS
(INTERIOR INSTALLATION)


APPROVED CHIEF ENGINEER DATE 2-7-2012

NOTES:

- 1. TO UTILITY SERVICE. 480/240V, 1 PHASE, 3 WIRE, GROUNDED, WHEN A METER HOUSING IS REQUIRED (FED FROM PAD MOUNTED UTILITY TRANSFORMER WITHIN TOLLWAY RIGHT-OF-WAY).
- 2. TO SERVICE PEDESTAL, 480/240V, 1 PHASE, 3 WIRE, GROUNDED. SEE STANDARD H5.
- 3. ITEM NUMBERS REFER TO EQUIPMENT LIST ON SHEET 1 OF THIS SERIES.
- 4. PROVIDE CIRCUIT BREAKERS PER SCHEDULE ON THE CONTRACT PLANS (MINIMUM OF 12).
- 5. FOR INTERIOR EQUIPMENT LAYOUT SEE SHEET 1 OF THIS SERIES.
- 6. ALL EQUIPMENT SHALL BE GROUNDED AND BONDED IN ACCORDANCE WITH THE NATIONAL ELECTRICAL CODE AND THE NATIONAL ELECTRICAL SAFETY CODE.
- 7. CONDUIT AND CABLE BETWEEN METER FITTING AND DISCONNECT SWITCH ROUTED BETWEEN CONTROL CONSOLE AND CONCRETE FOUNDATION, WHEN A METER HOUSING IS REQUIRED. CONDUIT AND CABLE SHALL BE THE SAME AS THE SERVICE.

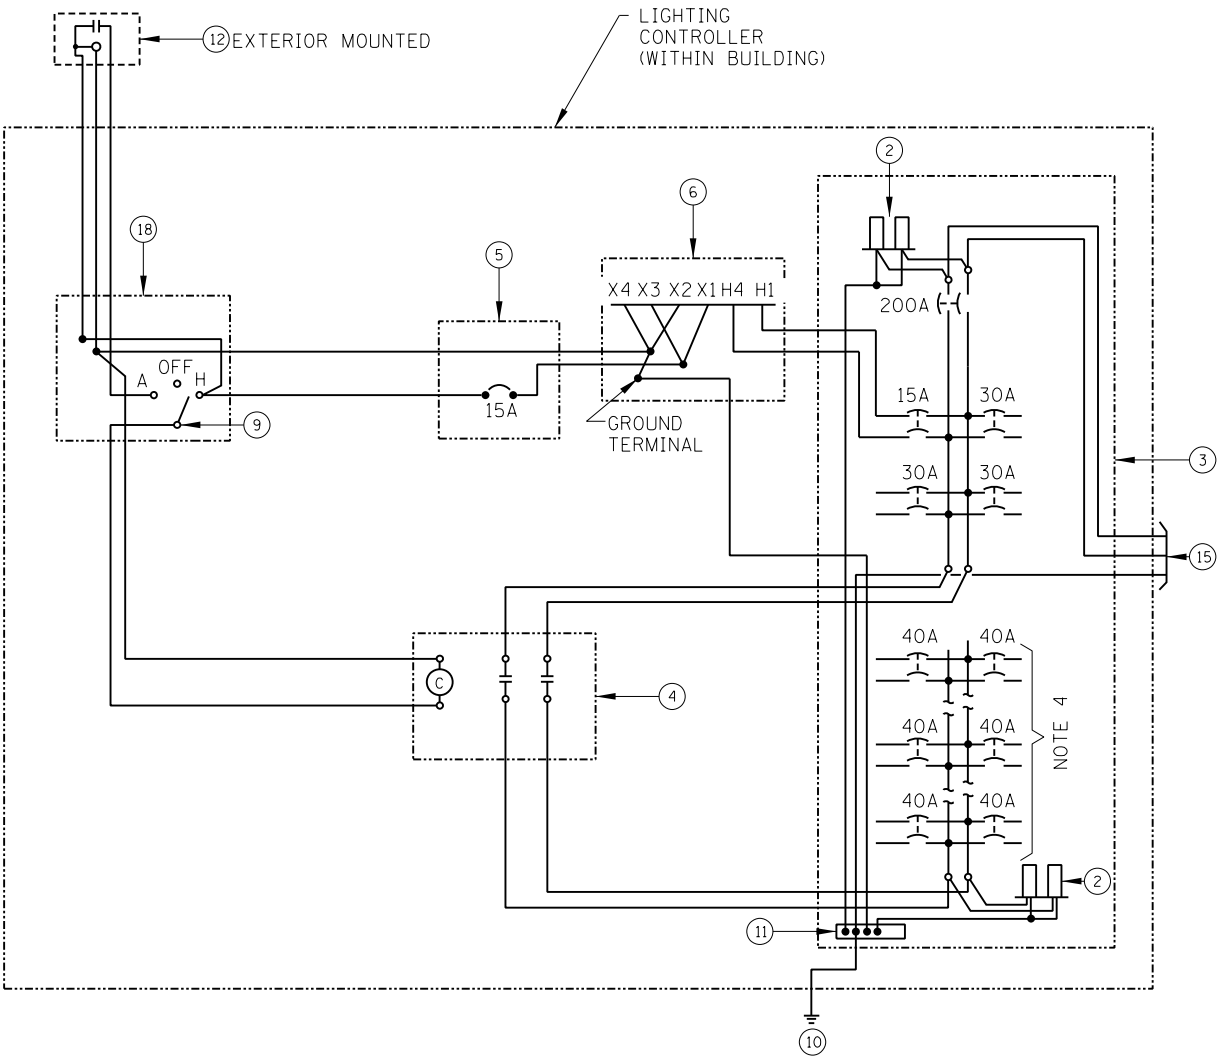

CONTROL CONSOLE WIRING DIAGRAM

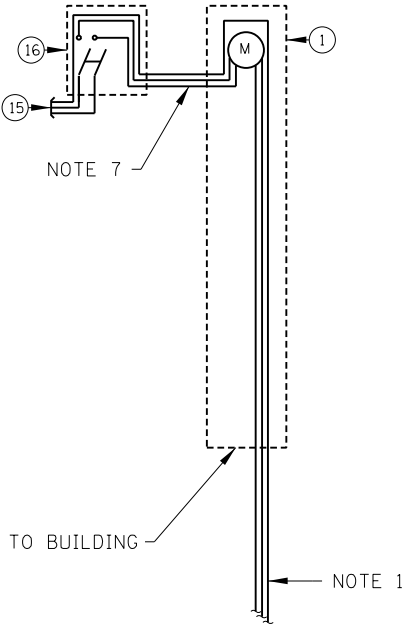

EXTERIOR TO BUILDING

CONTROL CONSOLE DETAILS
(INTERIOR INSTALLATION)

APPROVED.....
CHIEF ENGINEER

DATE 2-7-2012



INTERIOR
CONTROL CONSOLE
DETAILS


STANDARD H8-00

RESERVED


APPROVED..... CHIEF ENGINEER DATE

DATE	REVISIONS




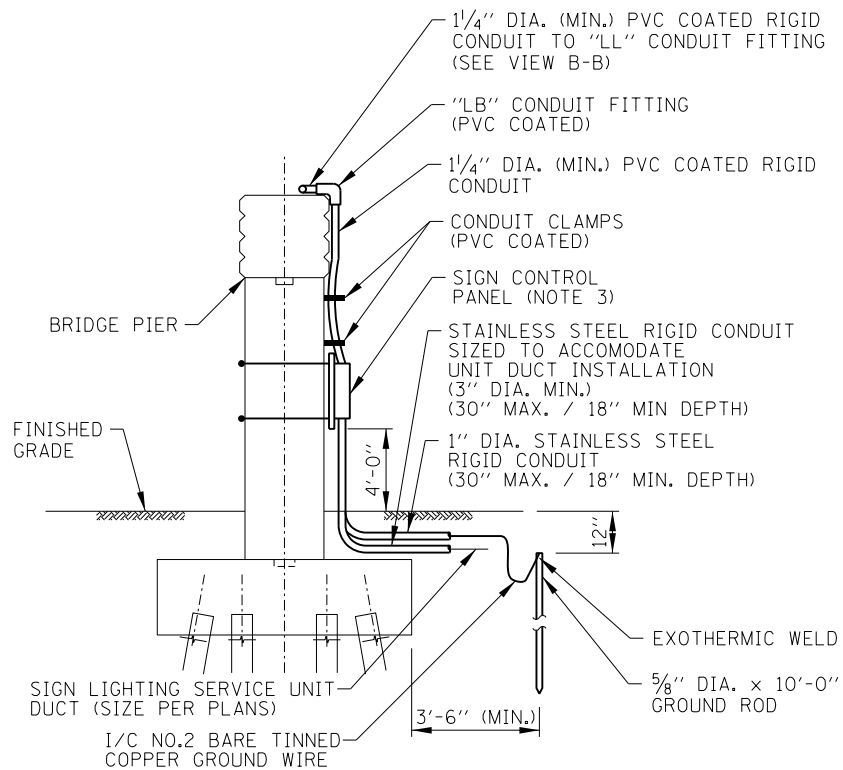


SECTION A-A

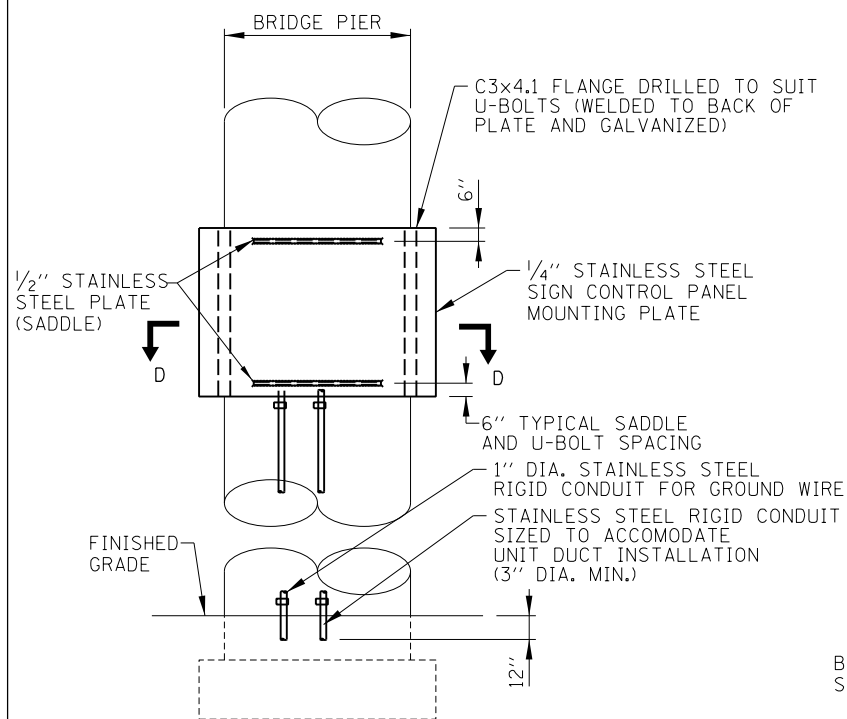


VIEW C-C

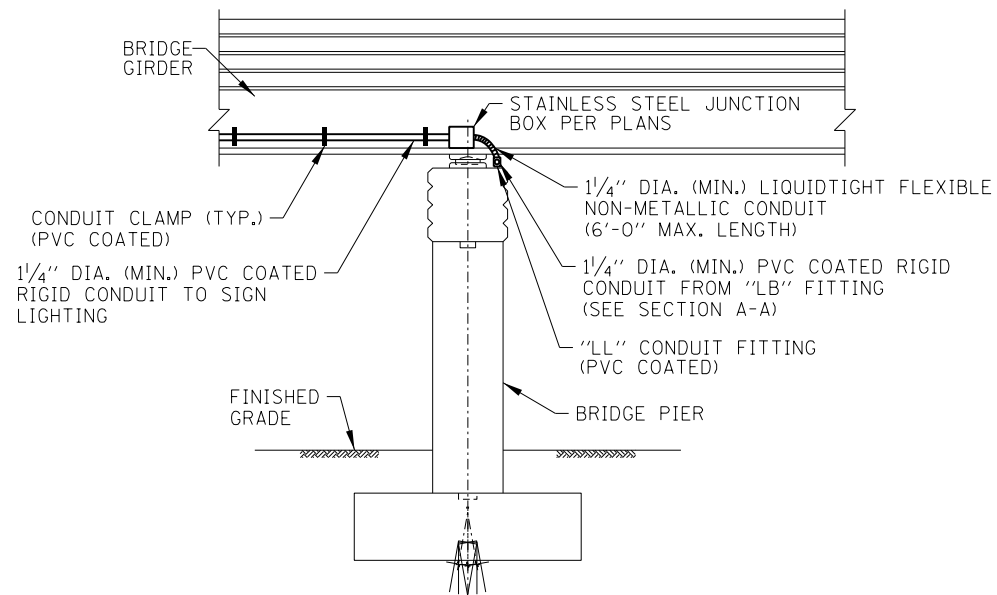

SECTION B-B

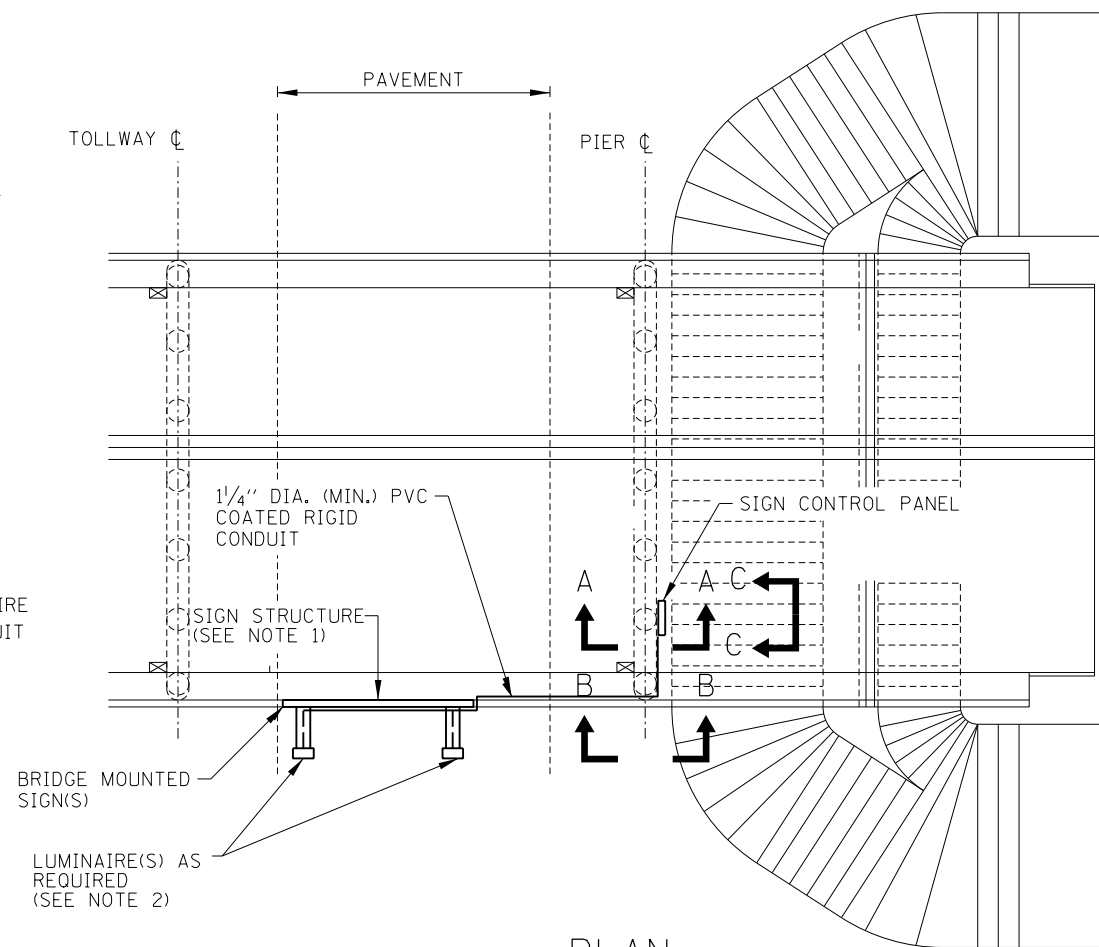

PLAN

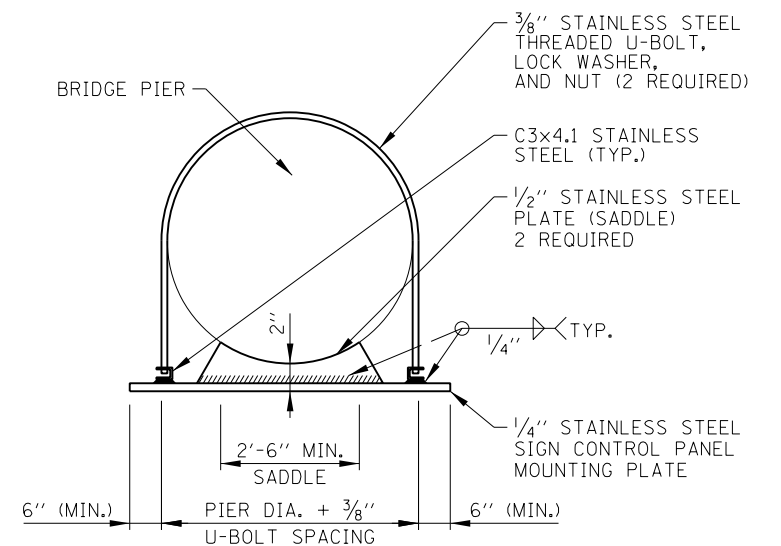

SECTION D-D

NOTES:

- FOR SIGN STRUCTURE INSTALLATION DETAILS SEE SHEET 3 OF 3 IN THIS SERIES.
- FOR SIGN LUMINAIRE INSTALLATION AND WIRING AND FOR INSTALLATION OF CONDUIT IN FIXTURE SUPPORT CHANNEL, SEE STANDARD H14.
- FOR TYPICAL SIGN CONTROL PANEL DETAILS SEE SHEET 2 OF 3 IN THIS SERIES.
- DETAILS SHOWN ON THIS SHEET ARE WITHOUT FLASHING BEACON. INSTALLATION OF FLASHING BEACON REQUIRES ADDITIONAL WORK AS SHOWN ON TYPICAL SIGN CONTROL PANEL DETAIL (SHEET 2 OF 3 IN THIS SERIES).
- LUMINAIRE SUPPORT MEMBERS TO BE INSTALLED ONLY WHEN THE SIGN IS TO BE ILLUMINATED. MAINLINE TOLL PLAZA APPROACH SIGNS SHALL BE ILLUMINATED. DESIGNER TO DETERMINE REQUIREMENTS FOR LIGHTING ALL OTHER SIGNS BASED ON ROADWAY GEOMETRY.
- PROVIDE 12" FLASHING BEACON ONLY WHERE INDICATED ON PLANS. FLASHING BEACON TO BE ATTACHED TO SUPPORT WITH STAINLESS STEEL SCREWS AND NEOPRENE SPACERS. DRILLED SCREW HOLES TO BE SEALED WATERTIGHT.
- SEE STRUCTURAL DRAWINGS FOR DETAILS OF SIGN SUPPORTS AND FIXTURE SUPPORT CHANNELS.
- CONDUITS, CONDUIT FITTINGS, CLAMPS, AND APPURTENANCES ATTACHED TO ALUMINUM STRUCTURAL SUPPORTS SHALL BE PVC COATED ALUMINUM. PVC COATED GALVANIZED STEEL CONDUITS, CONDUIT FITTINGS, CLAMPS, AND APPURTENANCES SHALL BE UTILIZED WHERE ATTACHED TO STEEL STRUCTURAL SUPPORTS OR WHERE ATTACHED TO CONCRETE STRUCTURES UNLESS NOTED OTHERWISE HEREIN. THREADED JOINTS BETWEEN DISSIMILAR METALS SHALL BE COATED WITH AN APPROVED THREAD LUBRICANT.
- ALL EQUIPMENT SHALL BE GROUNDED AND BONDED IN ACCORDANCE WITH THE NATIONAL ELECTRICAL CODE AND THE NATIONAL ELECTRICAL SAFETY CODE.

SHEET 1 OF 3




DATE	REVISIONS
2-07-2012	ADDED CONTROL PANEL MOUNTING DETAILS
	REVISED NOTES, REMOVED CANISTOR BALLASTS, NEW JUNCTION BOX, AND REVISED CONDUCTOR DESIGNATION.
3-11-2015	REVISED CONDUITS TO STAINLESS STEEL.

BRIDGE MOUNT SIGN LIGHTING DETAILS


STANDARD H10-02

APPROVED: *Paul Kovacs* CHIEF ENGINEER DATE: 2-7-2012


BRIDGE MOUNTED SIGN LIGHTING (BRIDGE PIER MOUNTED FEEDER INSTALLATION)

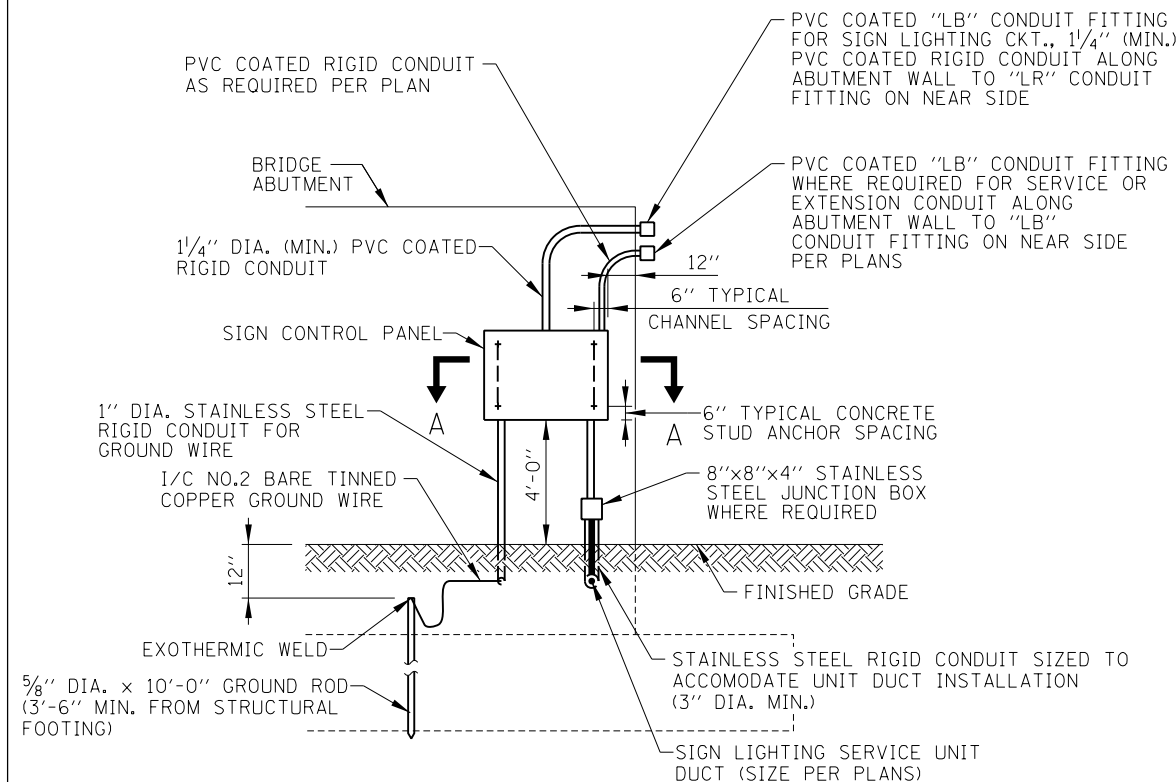


FAR SIDE ABUTMENT END ELEVATION

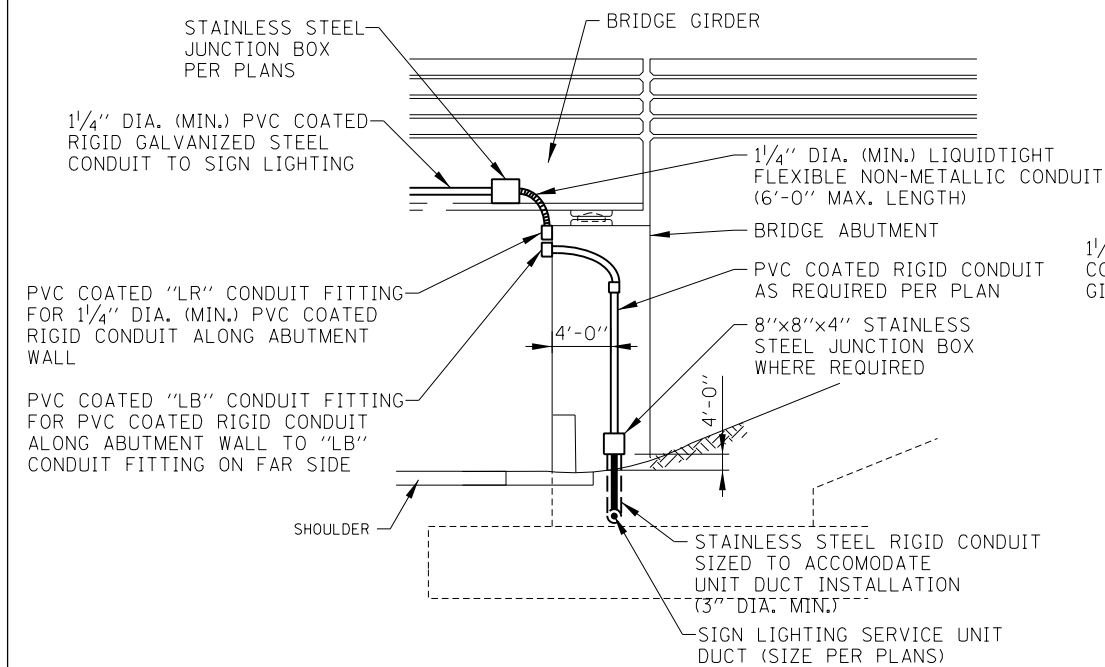


NEAR SIDE ABUTMENT END ELEVATION

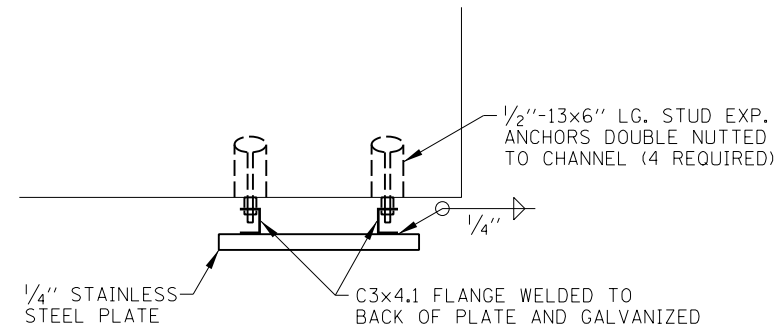

SECTION A-A

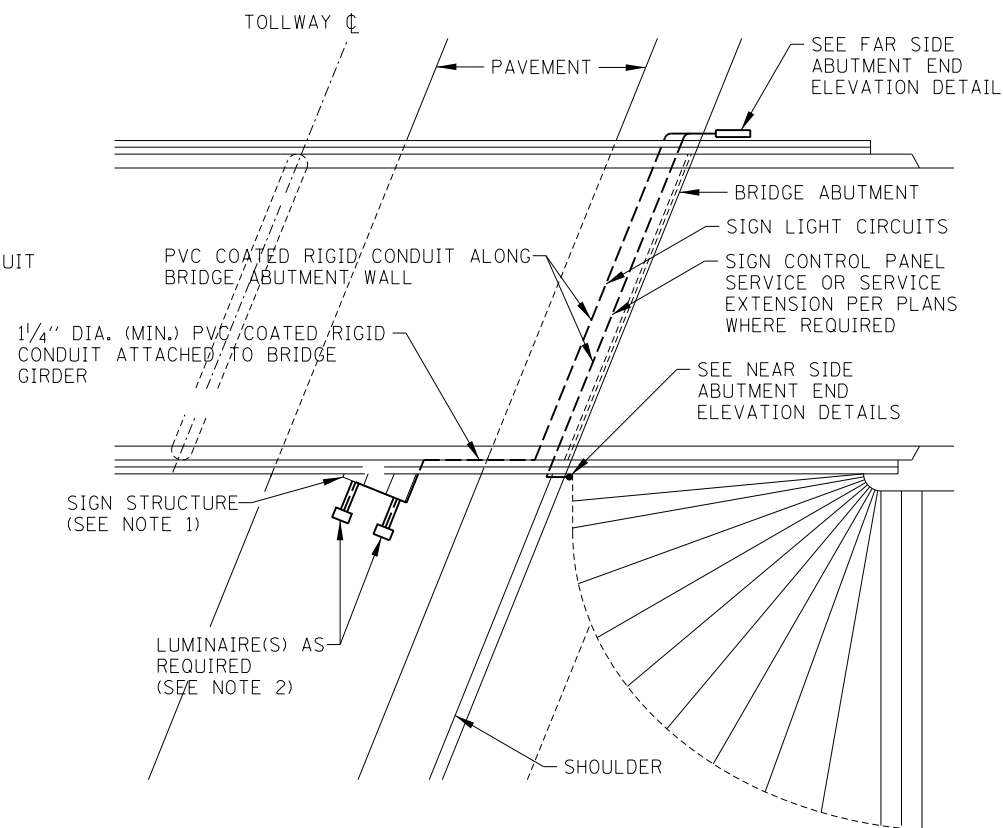

PLAN

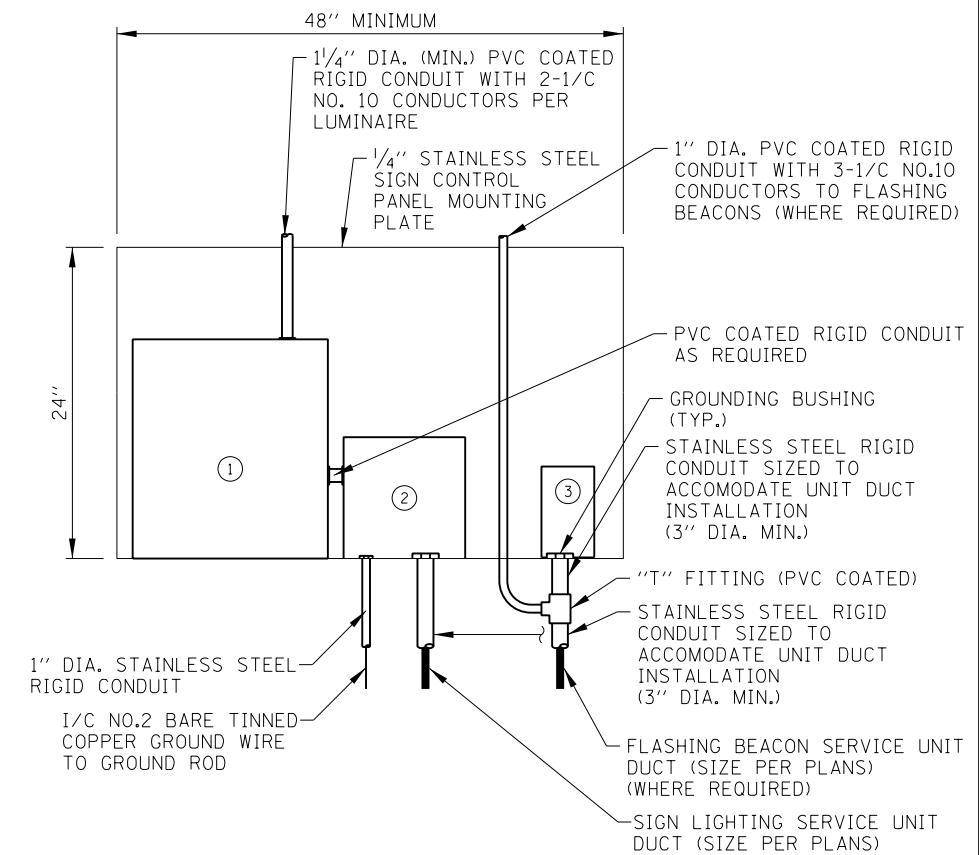

LEGEND:

- ① 18"x18"x8" STAINLESS STEEL JUNCTION BOX. PROVIDE SUFFICIENT 30 AMPERE, 600 VOLT TERMINAL BLOCKS TO SPLIT 480 VOLT WIRING FROM SIGN SERVICE CIRCUIT BREAKER TO TWO NO. 10 WIRES FOR EACH LUMINAIRE.
- ② SIGN LIGHTING SERVICE - CIRCUIT BREAKER (30 AMP/2 POLE) IN NEMA TYPE 4 C.I. ENCLOSURE, OZ TYPE "YW" WITH MOUNTING FEET OR APPROVED EQUAL.
- ③ FLASHING BEACON CONTROLLER.

TYPICAL SIGN CONTROL PANEL DETAIL

(FOR TYPICAL WIRING DIAGRAM SEE STANDARD H14)

APPROVED: *Paul Kovacs* CHIEF ENGINEER DATE: 2-7-2012

BRIDGE MOUNTED SIGN LIGHTING
(BRIDGE ABUTMENT MOUNTED FEEDER INSTALLATION)


NOTES:
SEE SHEET 1 OF THIS SERIES FOR NOTES.

SHEET 2 OF 3




BRIDGE MOUNT SIGN
LIGHTING DETAILS


STANDARD H10-02

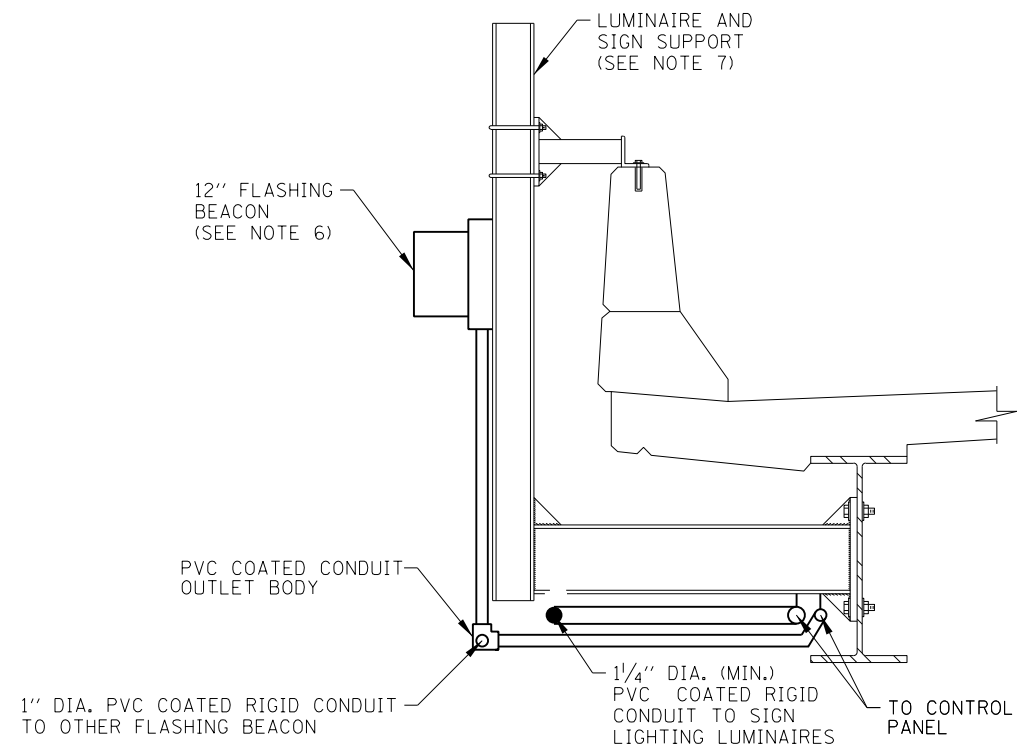


SECTION A-A
(STEEL BRIDGE SHOWN)

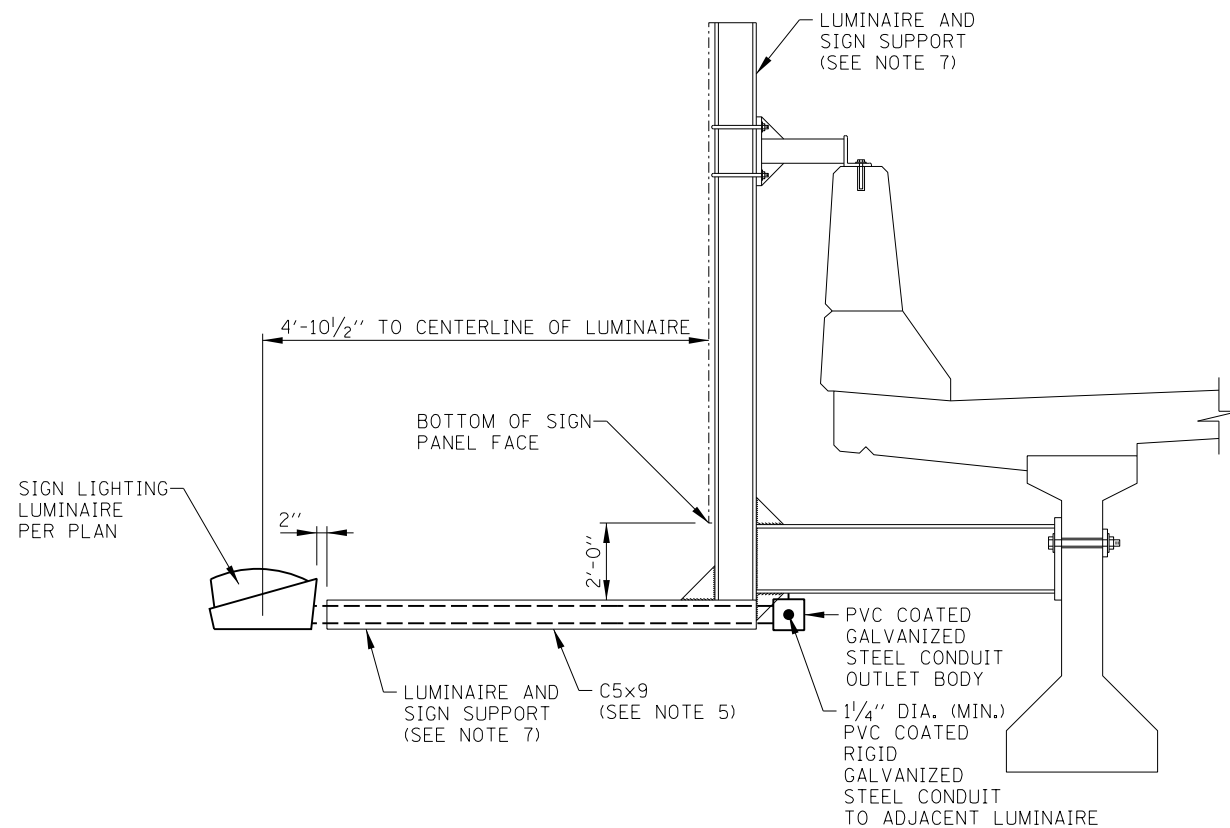

SECTION B-B
(CONCRETE BRIDGE SHOWN)

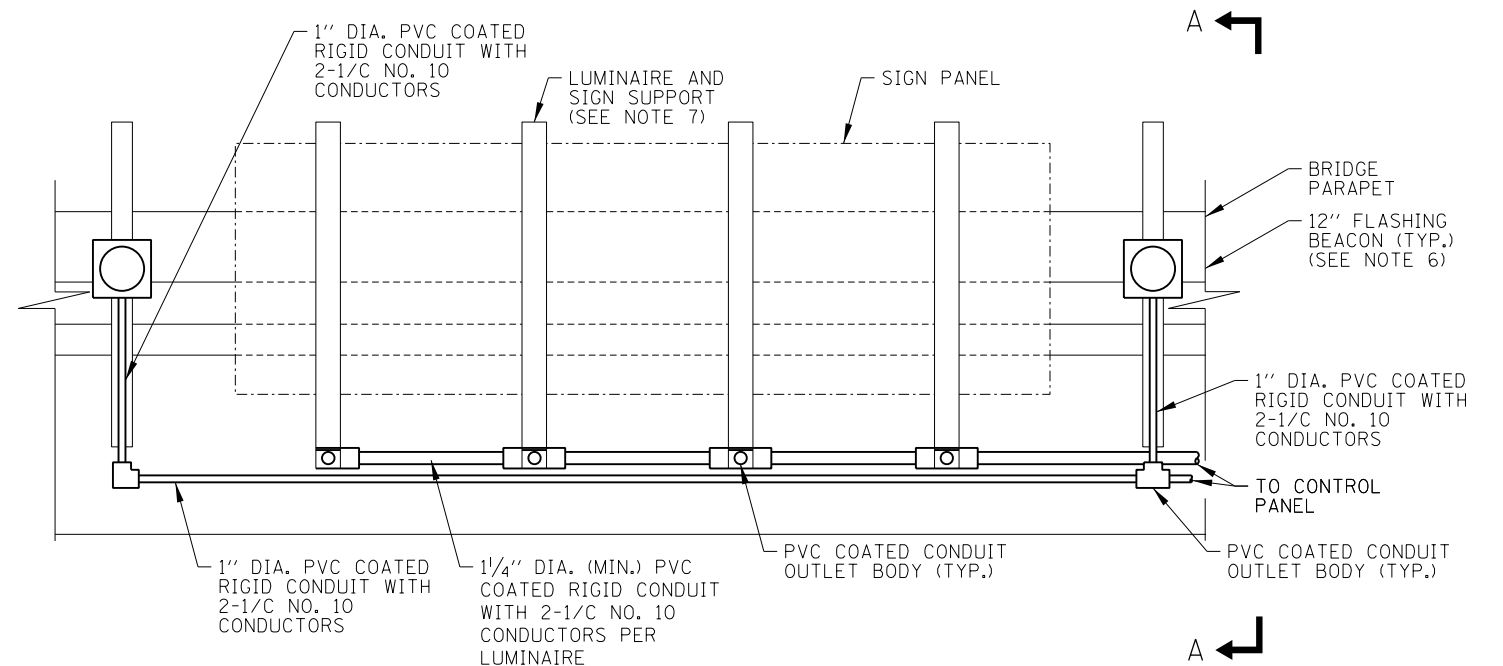

TYPICAL FRONT ELEVATION WITH FLASHING BEACON
(LUMINAIRES NOT SHOWN FOR CLARITY)

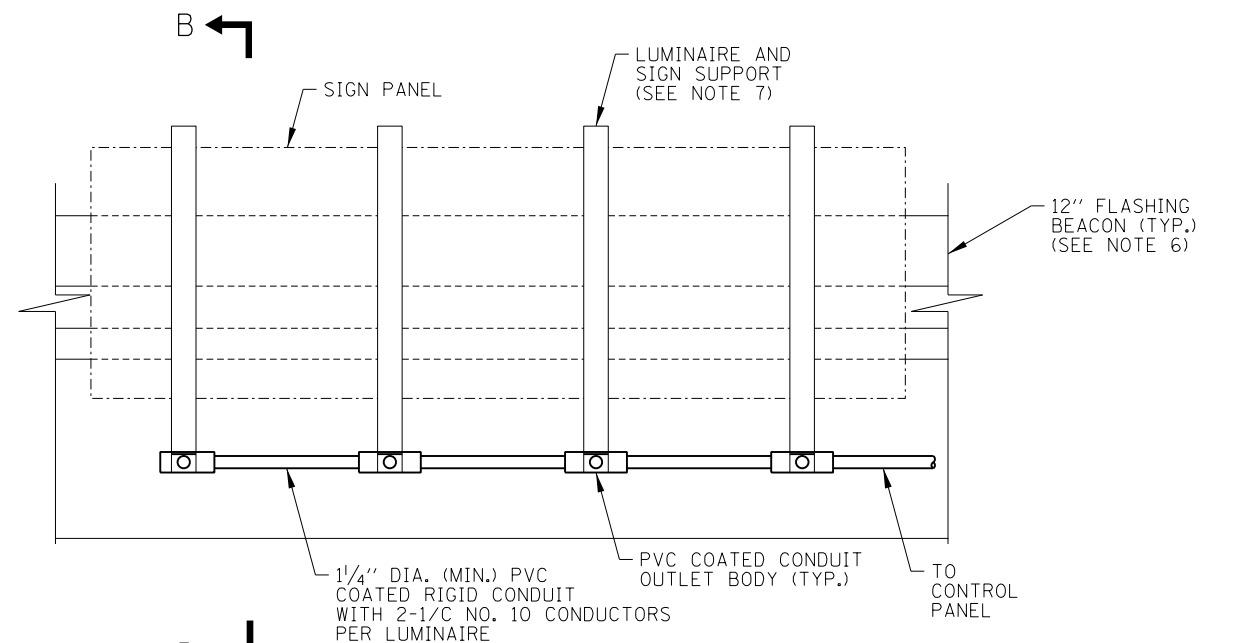


TYPICAL FRONT ELEVATION
WITHOUT FLASHING BEACON
(LUMINAIRES NOT SHOWN FOR CLARITY)


BRIDGE MOUNTED SIGN LIGHTING (LUMINAIRE MOUNTING & CONDUIT DETAILS)

APPROVED *Paul Kovacs* CHIEF ENGINEER DATE 2-7-2012

NOTES:
SEE SHEET 1 OF THIS SERIES FOR NOTES.

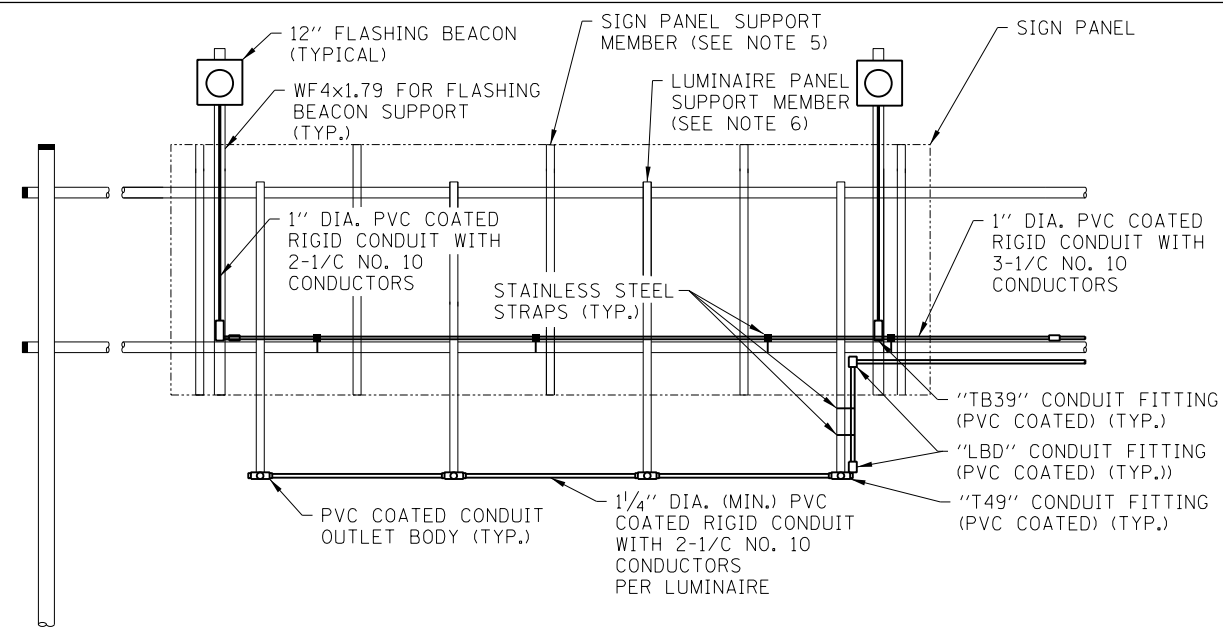


FRONT ELEVATION WITH FLASHING BEACON
(LUMINAIRES NOT SHOWN FOR CLARITY)

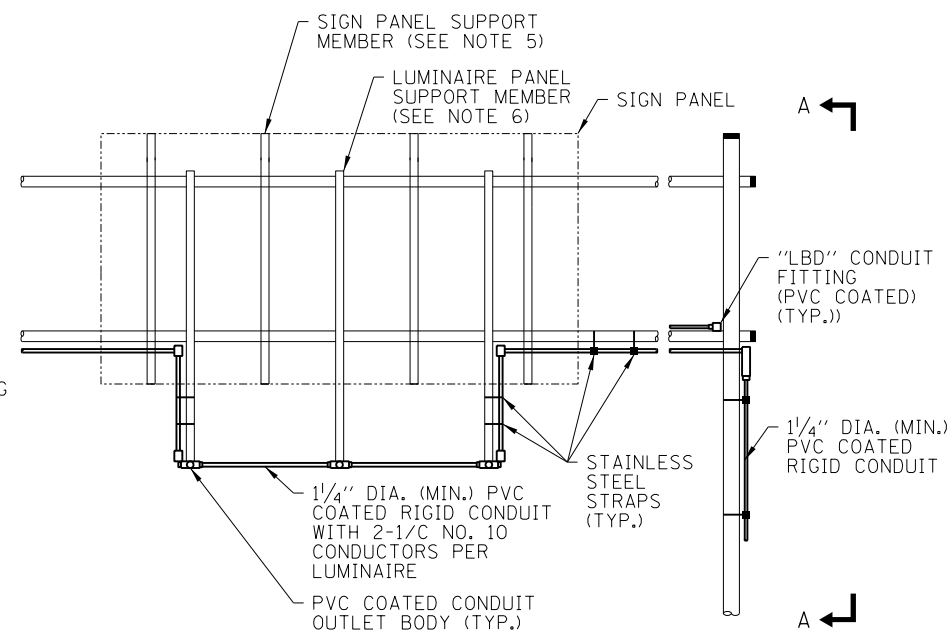


FRONT ELEVATION WITHOUT FLASHING BEACON
(LUMINAIRES NOT SHOWN FOR CLARITY)

NOTES:

- CONDUITS, CONDUIT FITTINGS, CLAMPS, AND APPURTENANCES ATTACHED TO ALUMINUM STRUCTURAL SUPPORTS SHALL BE PVC COATED ALUMINUM. PVC COATED GALVANIZED STEEL CONDUITS, CONDUIT FITTINGS, CLAMPS, AND APPURTENANCES SHALL BE UTILIZED WHERE ATTACHED TO STEEL STRUCTURAL SUPPORTS OR WHERE ATTACHED TO CONCRETE STRUCTURES UNLESS NOTED OTHERWISE HEREIN. THREADED JOINTS BETWEEN DISSIMILAR METALS SHALL BE COATED WITH AN APPROVED THREAD LUBRICANT.
- PROVIDE 12" FLASHING BEACON ONLY WHERE INDICATED ON PLANS. FLASHING BEACON TO BE ATTACHED TO SUPPORT WITH STAINLESS STEEL SCREWS AND NEOPRENE SPACERS. DRILLED SCREW HOLES TO BE SEALED WATERTIGHT.
- ALL EQUIPMENT SHALL BE GROUNDED AND BONDED IN ACCORDANCE WITH THE NATIONAL ELECTRICAL CODE AND THE NATIONAL ELECTRICAL SAFETY CODE.
- ALL STEEL TO BE HOT DIPPED GALVANIZED AFTER WELDING PER TOLLWAY SUPPLEMENTAL SPECIFICATION SECTION 733.
- SEE STRUCTURAL DRAWINGS FOR DETAILS OF SIGN SUPPORTS AND FIXTURE SUPPORT CHANNELS.
- LUMINAIRE SUPPORT MEMBERS TO BE INSTALLED ONLY WHEN STRUCTURE IS TO BE ILLUMINATED. MAINLINE PLAZA APPROACH SIGNS SHALL BE ILLUMINATED.
- FOR SIGN LUMINAIRE INSTALLATION AND WIRING AND FOR INSTALLATION OF CONDUIT IN FIXTURE SUPPORT CHANNEL, SEE STANDARD H14.

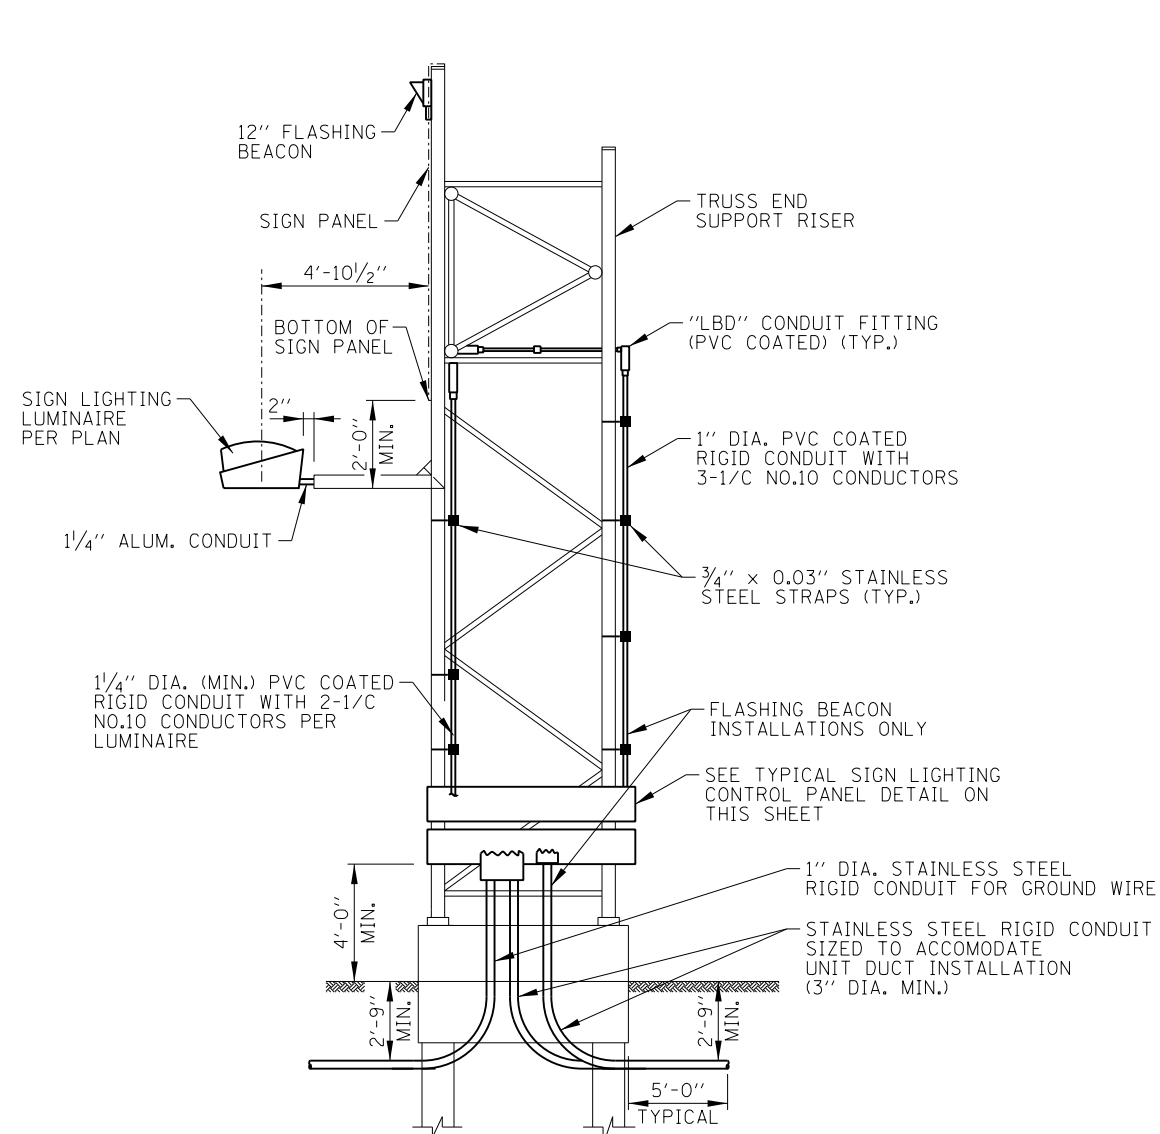

SECTION A-A
FULL ELEVATION (OUTSIDE FOUNDATION)

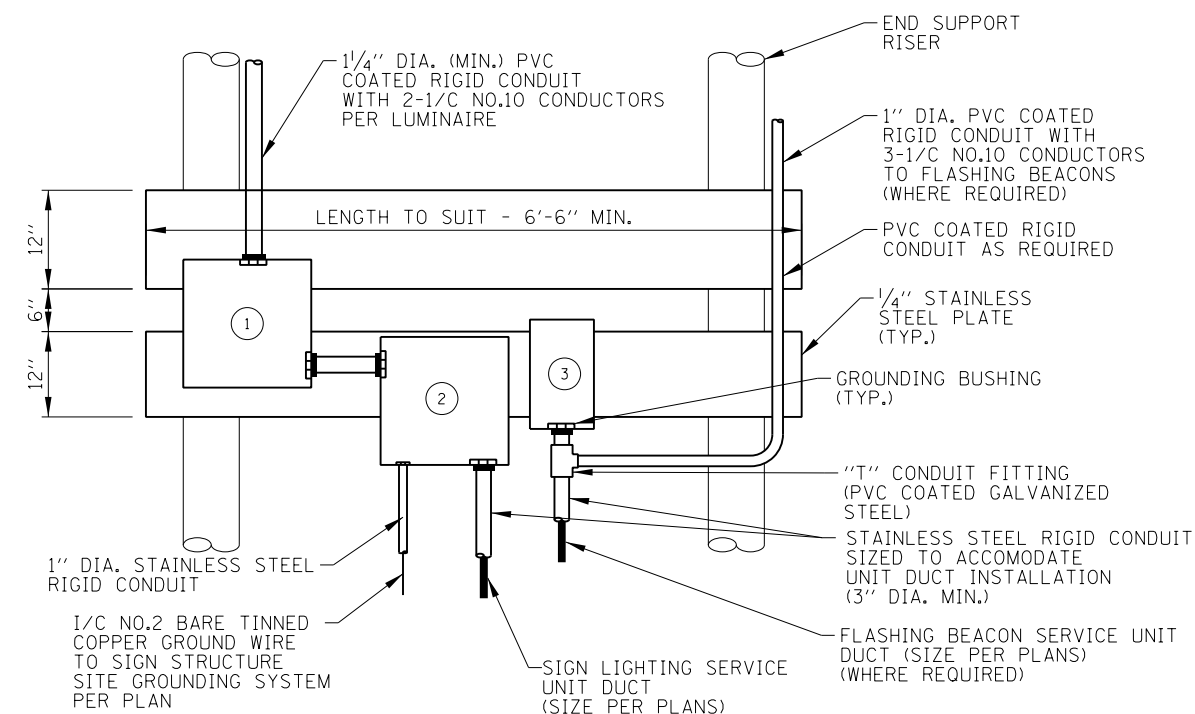

LEGEND:

- 18"x18"x8" STAINLESS STEEL JUNCTION BOX. PROVIDE SUFFICIENT 30 AMPERE, 600 VOLT TERMINAL BLOCKS TO SPLIT 480 VOLT WIRING FROM SIGN SERVICE CIRCUIT BREAKER TO TWO NO. 10 WIRES FOREACH LUMINAIRE.
- SIGN LIGHTING SERVICE - CIRCUIT BREAKER (30 AMP/2 POLE) IN NEMA TYPE 4 C.I. ENCLOSURE, OZ TYPE "YW" WITH MOUNTING FEET OR APPROVED EQUAL.
- FLASHING BEACON CONTROLLER.

TYPICAL SIGN LIGHTING CONTROL PANEL
(FOR TYPICAL WIRING DIAGRAM SEE STANDARD H14)


APPROVED: *Paul Kovacs* DATE 2-7-2012
CHIEF ENGINEER

DATE	REVISIONS
02-07-12	ADDED SIGN PANEL SUPPORT MEMBER
	REVISED NOTES, BANNER SIGN REMOVED.
	BEACONS RELOCATED, REMOVED CANISTAR
	BALLASTS AND ADDED JUNCTION BOX.
03-31-14	REVISED FOUNDATION.
3-11-2015	REVISED CONDUIT MATERIALS



SPAN TYPE STRUCTURE
SIGN LIGHTING DETAILS

STANDARD H11-03

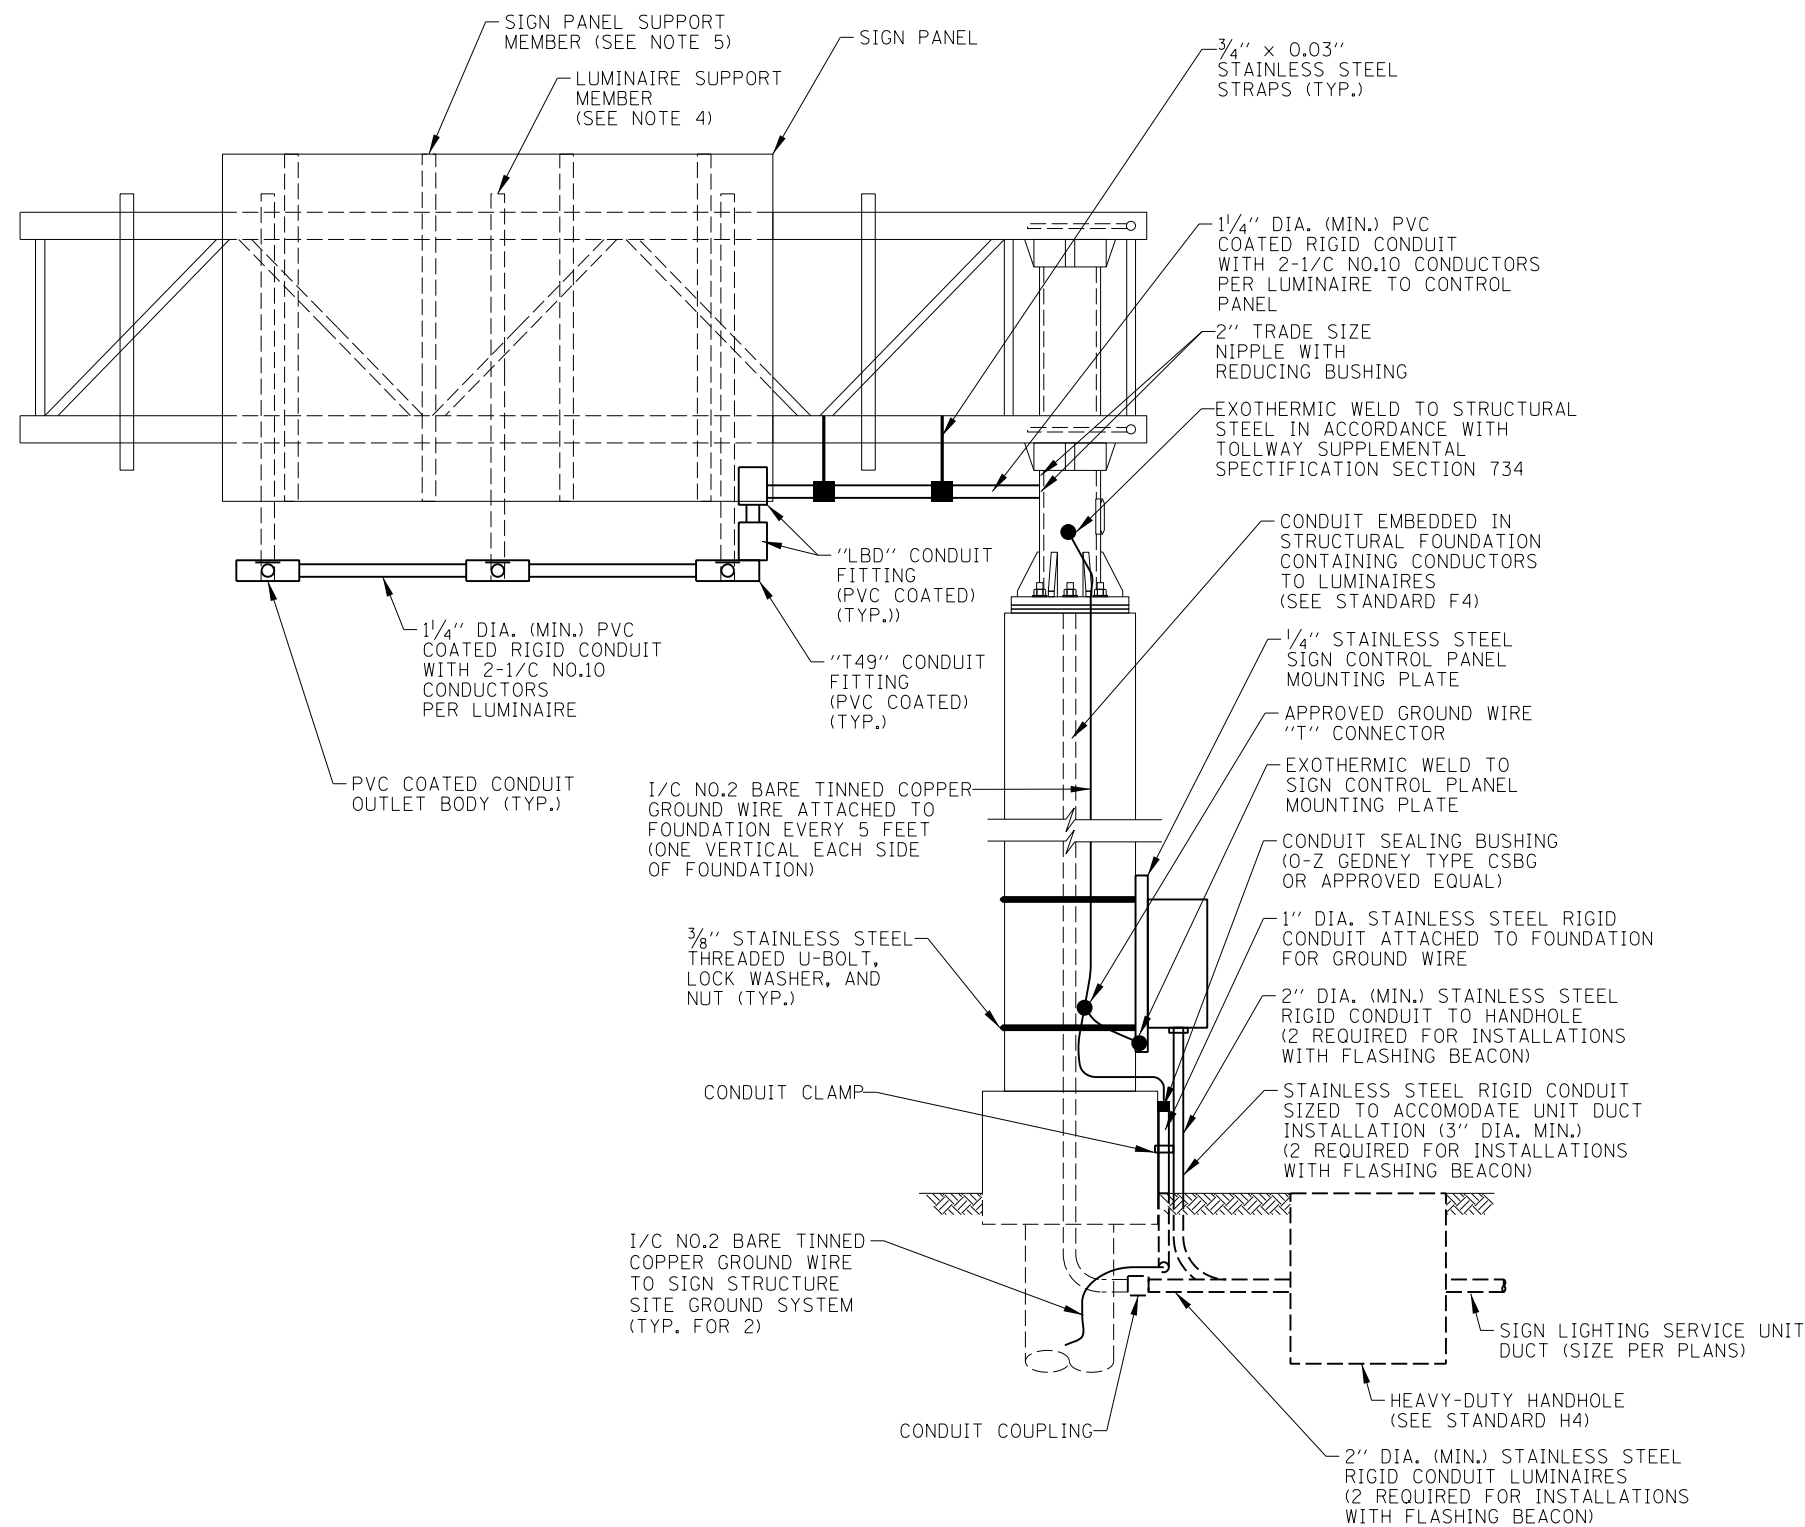

TYPICAL FRONT ELEVATION WITH FLASHING BEACON
(LUMINAIRES NOT SHOWN FOR CLARITY)

NOTES:

1. A GROUND WIRE (NO. 12 AWG.) WILL BE RUN FROM THE GROUNDING BUSHING (OVERHEAD SUPPORT) TO THE GROUNDING BUSHING IN THE JUNCTION BOX.
2. ALL EQUIPMENT SHALL BE GROUNDED AND BONDED IN ACCORDANCE WITH THE NATIONAL ELECTRICAL CODE AND THE NATIONAL ELECTRICAL SAFETY CODE.
3. CONDUITS, CONDUIT FITTINGS, CLAMPS, AND APPURTENANCES ATTACHED TO ALUMINUM STRUCTURAL SUPPORTS SHALL BE PVC COATED ALUMINUM. PVC COATED GALVANIZED STEEL CONDUITS, CONDUIT FITTINGS, CLAMPS, AND APPURTENANCES SHALL BE UTILIZED WHERE ATTACHED TO STEEL STRUCTURAL SUPPORTS OR WHERE ATTACHED TO CONCRETE STRUCTURES UNLESS NOTED OTHERWISE HEREIN. THREADED JOINTS BETWEEN DISSIMILAR METALS SHALL BE COATED WITH AN APPROVED THREAD LUBRICANT.
4. LUMINAIRE SUPPORT MEMBERS TO BE INSTALLED ONLY WHEN THE SIGN IS TO BE ILLUMINATED. MAINLINE TOLL PLAZA APPROACH SIGNS SHALL BE ILLUMINATED.
5. SEE STRUCTURAL DRAWINGS FOR DETAILS OF SIGN SUPPORTS AND FIXTURE SUPPORT CHANNELS.
6. FOR SIGN LUMINAIRE INSTALLATION AND WIRING AND FOR INSTALLATION OF CONDUIT IN FIXTURE SUPPORT CHANNEL, SEE STANDARD H14.
7. ALL STEEL TO BE HOT DIPPED GALVANIZED AFTER WELDING PER TOLLWAY SUPPLEMENTAL SPECIFICATION SECTION 733.
8. PROVIDE 12" FLASHING BEACON ONLY WHERE INDICATED ON PLANS. FLASHING BEACON TO BE ATTACHED TO SUPPORT WITH STAINLESS STEEL SCREWS AND NEOPRENE SPACERS. DRILLED SCREW HOLES TO BE SEALED WATERTIGHT.

SHEET 1 OF 2




DATE	REVISIONS
2-07-2012	ADDED SIGN POST SUPPORT MEMBERS, REVISED NOTES, REMOVED CANISTER BALLAST AND ADDED JUNCTION BOX.
3-11-2015	REVISED CONDUITS TO STAINLESS STEEL.


CANTILEVER STRUCTURE
SIGN LIGHTING DETAILS

STANDARD H12-03

APPROVED: *Paul Kovacs* DATE: 2-7-2012
CHIEF ENGINEER

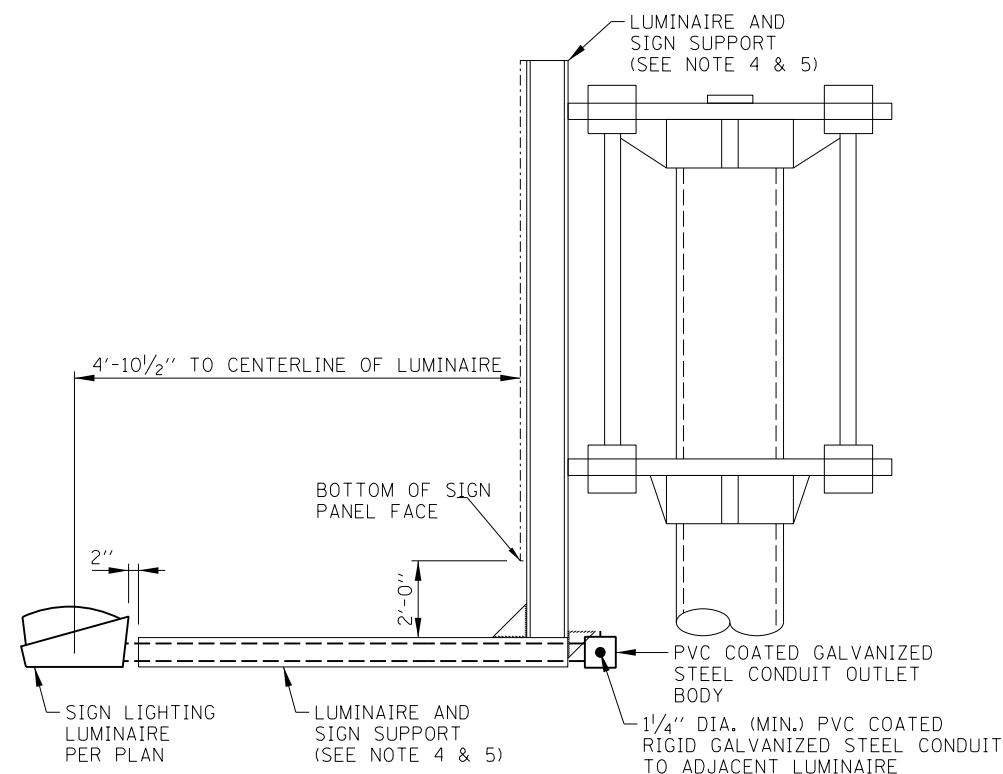


SIGN LUMINAIRE INSTALLATION

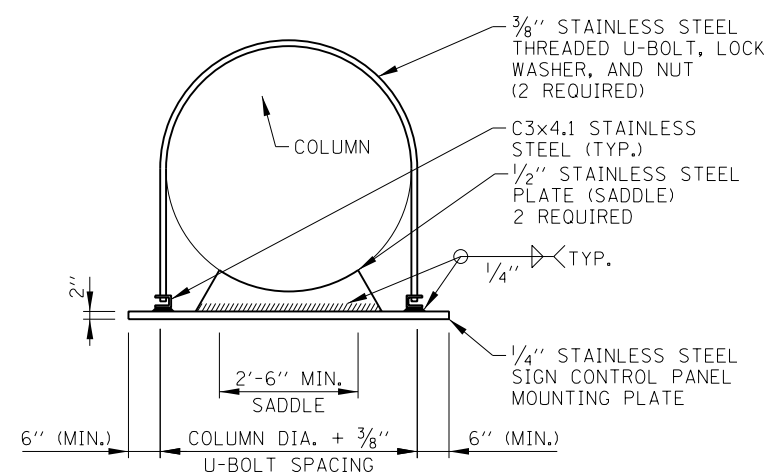


SECTION A-A

(CONTROL EQUIPMENT NOT SHOWN FOR CLARITY)

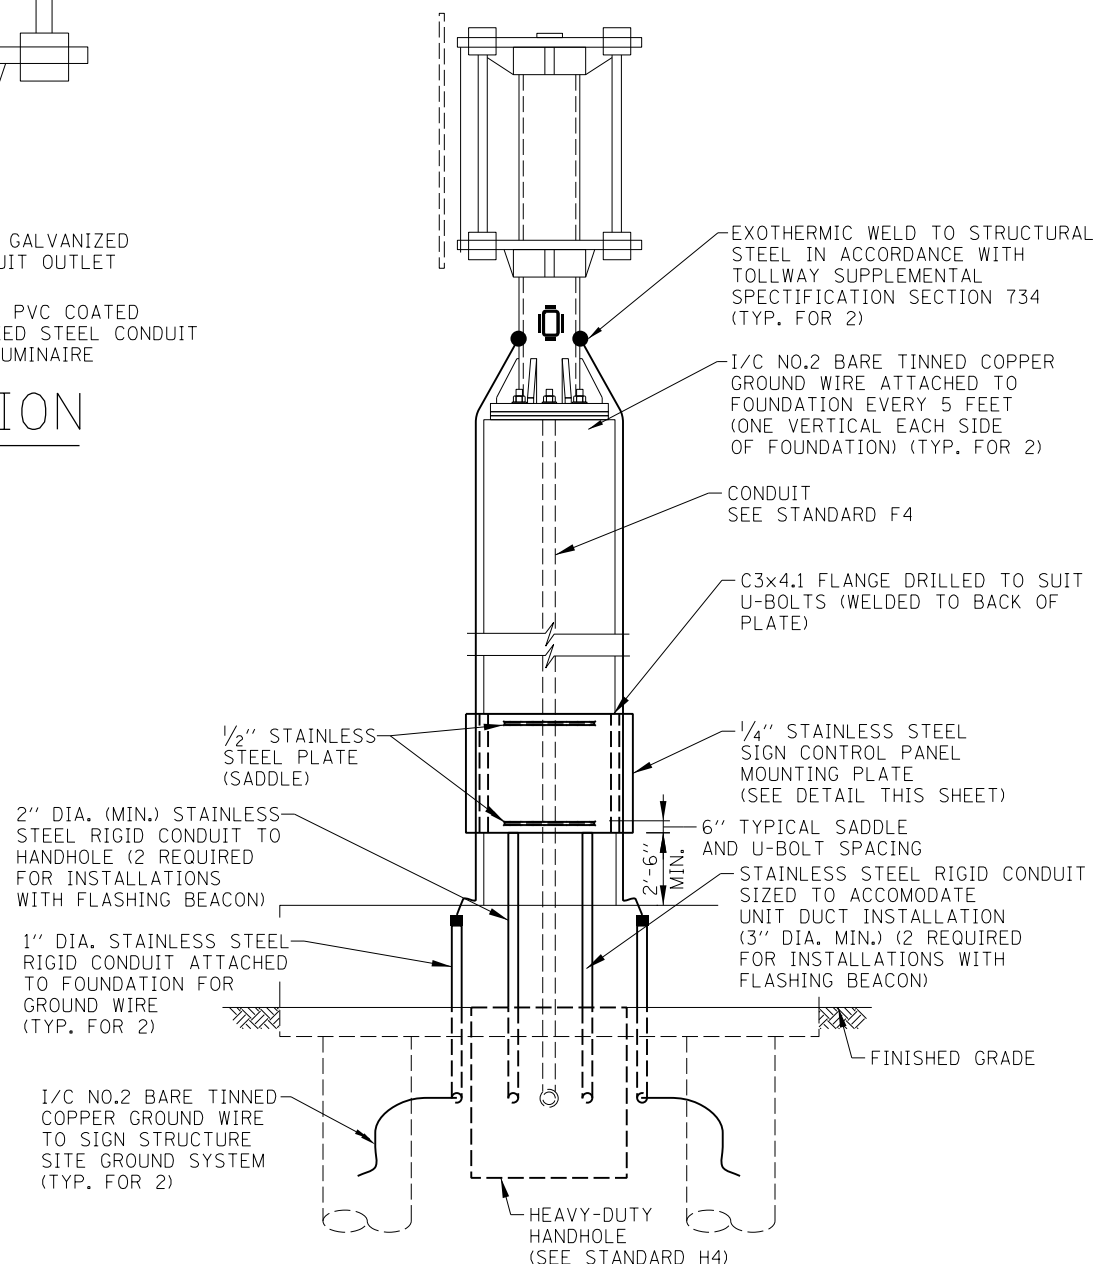

TYPICAL SIDE ELEVATION

(LUMINAIRES NOT SHOWN FOR CLARITY)

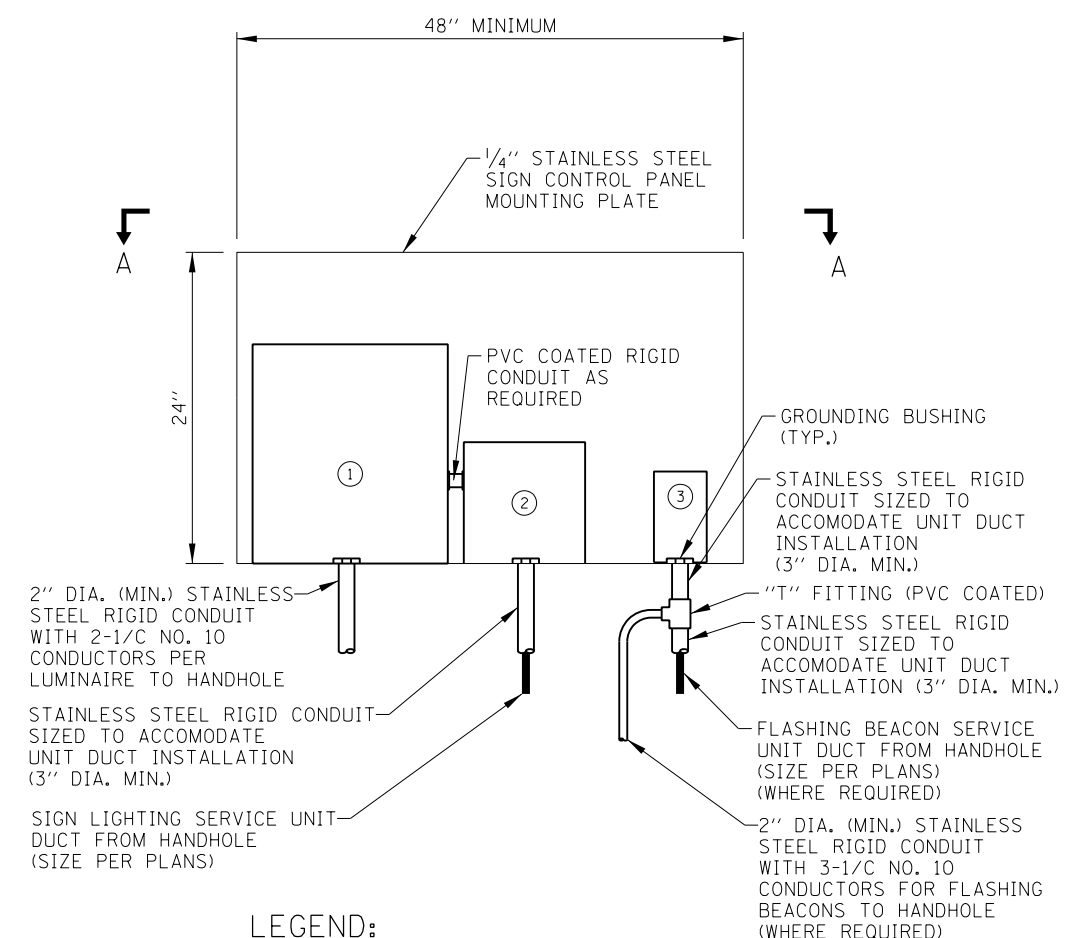


LEGEND:

- ① 18"x18"x8" STAINLESS STEEL JUNCTION BOX. PROVIDE SUFFICIENT 30 AMPERE, 600 VOLT TERMINAL BLOCKS TO SPLIT 480 VOLT WIRING FROM SIGN SERVICE CIRCUIT BREAKER TO TWO NO. 10 WIRES FOR EACH LUMINAIRE.
- ② SIGN LIGHTING SERVICE - CIRCUIT BREAKER (30 AMP/2 POLE) IN NEMA TYPE 4 C.I. ENCLOSURE, OZ TYPE "YW" WITH MOUNTING FEET OR APPROVED EQUAL.
- ③ FLASHING BEACON CONTROLLER.

TYPICAL SIGN CONTROL PANEL DETAIL

(FOR TYPICAL WIRING DIAGRAM SEE STANDARD H14)

SHEET 2 OF 2


 APPROVED..... DATE 2-7-2012
 CHIEF ENGINEER

NOTES:
 SEE SHEET 1 OF THIS SERIES FOR NOTES.



CANTILEVER STRUCTURE
SIGN LIGHTING DETAILS

STANDARD H12-03


RESERVED

APPROVED..... CHIEF ENGINEER DATE


DATE	REVISIONS



STANDARD H13-00

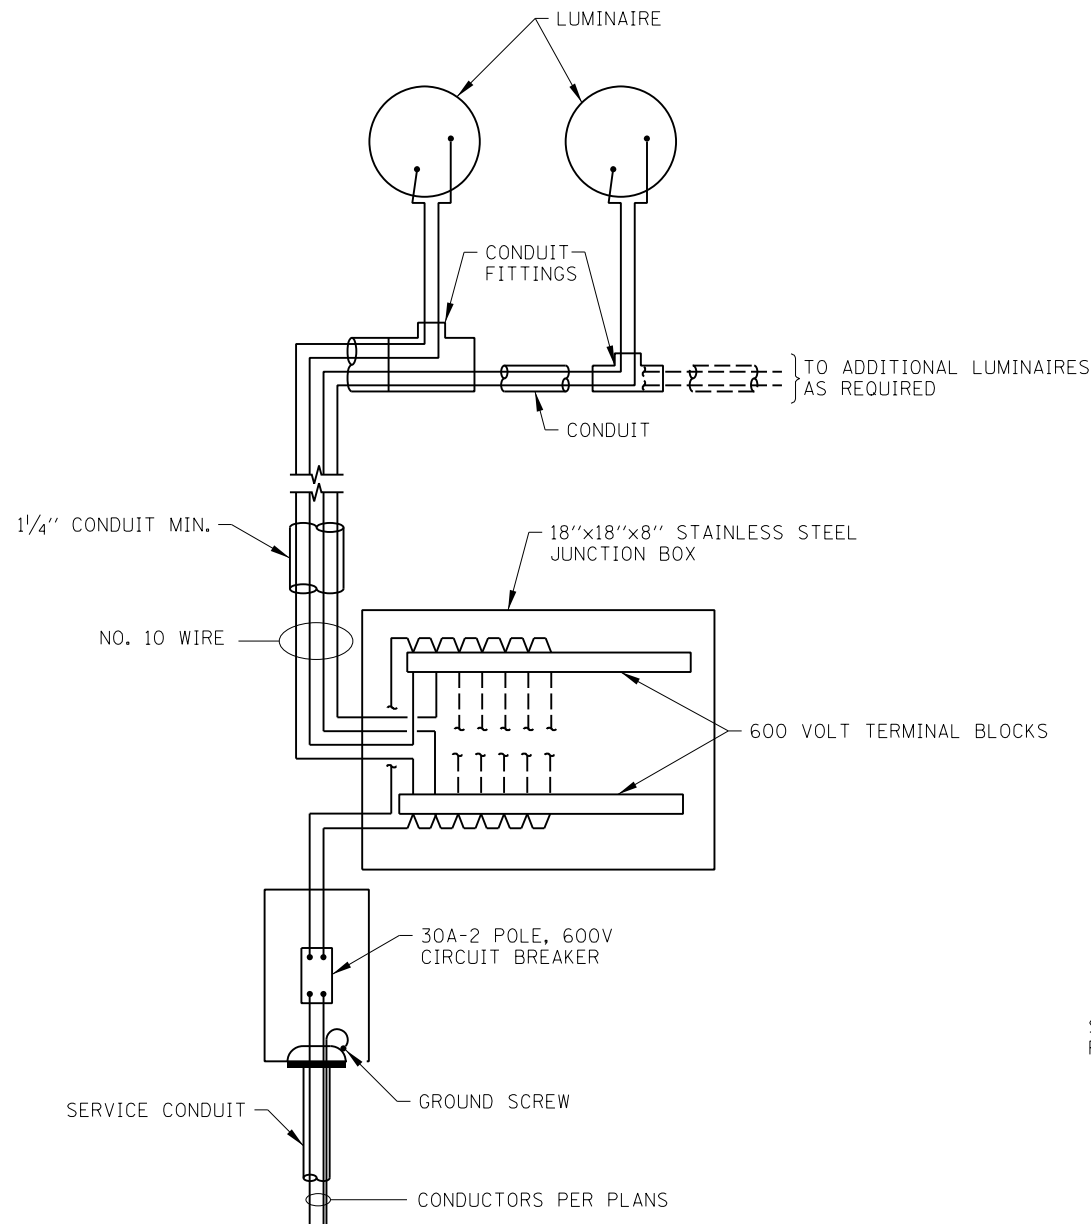


SIGN WIRING DIAGRAM
NO SCALE

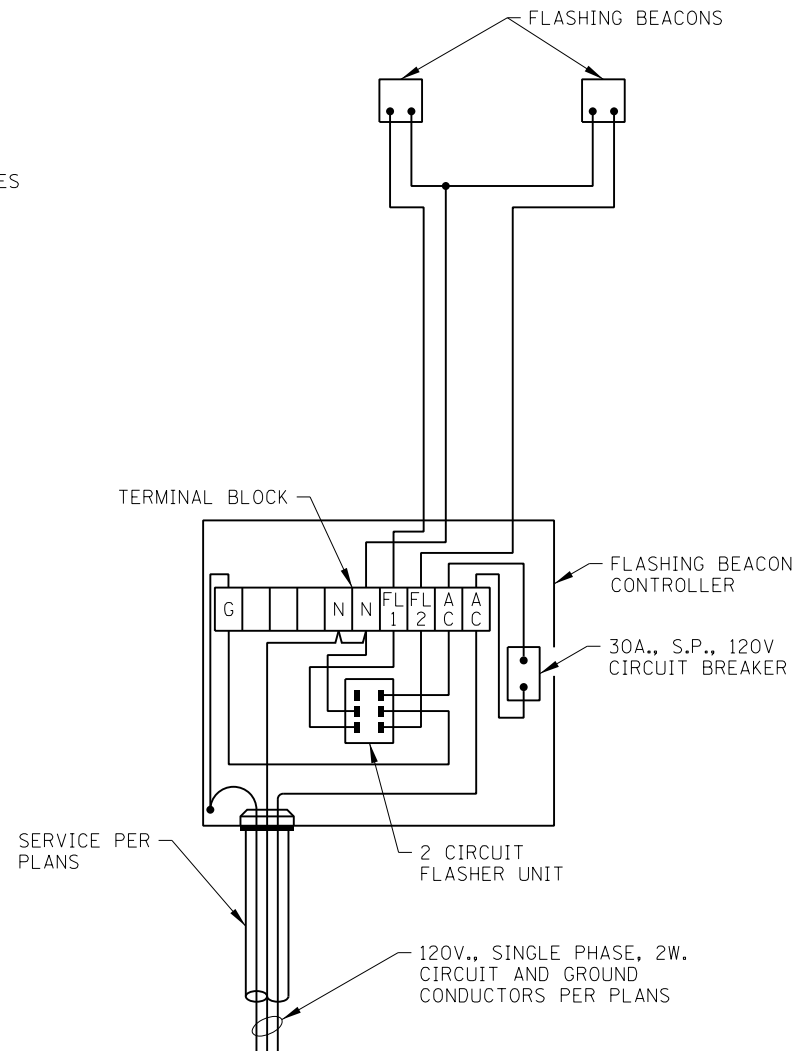

FLASHING BEACON WIRING DIAGRAM
NO SCALE

NOTES:

1. SEE STRUCTURAL DRAWINGS FOR DETAILS OF SIGN SUPPORTS AND FIXTURE SUPPORT CHANNELS.
2. CONDUITS, CONDUIT FITTINGS, CLAMPS, AND APPURTENANCES ATTACHED TO ALUMINUM STRUCTURAL SUPPORTS SHALL BE PVC COATED ALUMINUM. PVC COATED GALVANIZED STEEL CONDUITS, CONDUIT FITTINGS, CLAMPS, AND APPURTENANCES SHALL BE UTILIZED WHERE ATTACHED TO STEEL STRUCTURAL SUPPORTS OR WHERE ATTACHED TO CONCRETE STRUCTURES UNLESS NOTED OTHERWISE HEREIN. THREADED JOINTS BETWEEN DISSIMILAR METALS SHALL BE COATED WITH AN APPROVED THREAD LUBRICANT.
3. ALL EQUIPMENT SHALL BE GROUNDED AND BONDED IN ACCORDANCE WITH THE NATIONAL ELECTRICAL CODE AND THE NATIONAL ELECTRICAL SAFETY CODE.

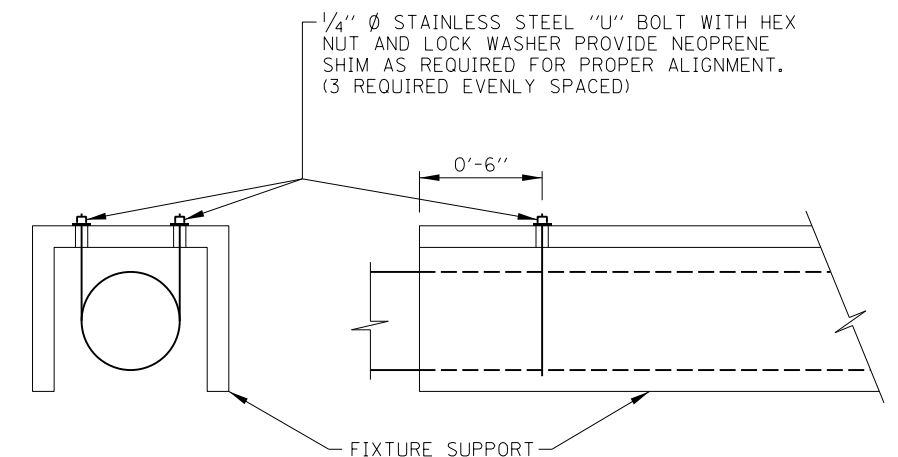

LUMINAIRE SUPPORT DETAIL
NO SCALE

Paul Kovacs
APPROVED..... CHIEF ENGINEER..... DATE 2-7-2012

DATE	REVISIONS
2-07-2012	REMOVED CANISTER BALLASTS, NEW JUNCTION BOX AND TERMINAL BLOCKS
3-11-2015	REVISED NOTES



SIGN LUMINAIRE
MOUNTING DETAIL
AND WIRING DIAGRAMS
STANDARD H14-02

RESERVED

APPROVED..... CHIEF ENGINEER DATE

DATE	REVISIONS



STANDARD H15-00